

Airwell

Technical Manual

DUO N Series

DUO Outdoor Models
DUO OU7 (9+9)
DUO OU7 (9+12)



REFRIGERANT	
R410A	HEAT PUMP COOLING ONLY

LIST OF EFFECTIVE PAGES

LIST OF EFFECTIVE PAGES

Note: Changes in the pages are indicated by a "Revision#" in the footer of each effected page (when none indicates no changes in the relevant page). All pages in the following list represent effected/ non effected pages divided by chapters.

Dates of issue for original and changed pages are:

Original 0 5 March 2005

Total number of pages in this publication is 44 consisting of the following:

Page No.	Revision No. #		Page No.	Revision No. #		Page No.	Revision No. #
----------	----------------	--	----------	----------------	--	----------	----------------

Title 1
 A 1
 i 0
 1-1 1
 2-1 - 2-9 1
 3-1 0
 4-1 - 4-2 1
 5-1 - 5-21 2
 6-1 1
 7-1 0
 8-1 0
 9-1 0
 10-1 0
 11-1 1
 12-1 1
 13-1-13-2 0

- Zero in this column indicates an original page.

*Due to constant improvements please note that the data on this service manual can be modified with out notice.

**Photos are not contractual

Table of Contents

1. INTRODUCTION1-1

2. PRODUCT DATA SHEET2-1

3. RATING CONDITIONS3-1

4. OUTLINE DIMENSIONS4-1

5. PERFORMANCE DATA AND PRESSURE CURVES5-1

6. CHARACTERISTICS SOUND LEVEL6-1

7. ELECTRICAL DATA.....7-1

8. WIRING DIAGRAMS8-1

9. ELECTRICAL CONNECTIONS.....9-1

10. REFRIGERATION DIAGRAMS10-1

11. TUBING CONNECTIONS.....11-1

12. CONTROL SYSTEM12-1

13. TROUBLESHOOTING13-1

REFRIGERANT	R410A
-------------	-------

INDOOR	ALPHA 9	ALPHA 12	WNG 9	WNG 12
	AME 20	AME 30	NXE 20	NXE 30
	WAF 9	WAF 12	FLO 9	FLO 12

1. INTRODUCTION

1.1 General

The DUO multi split R410A outdoor unit series, comprise the following ST (cooling only) and RC (heat pump) models:

- **Cooling Only** OU7 (9+9) ST, OU7 (9+12) ST, OU7 (12+12) ST
- **Heat Pump** OU7 (9+9) RC, OU7 (9+12) RC, OU7 (12+12) RC

1.2 Main Features

- R410A refrigerant
- Built in Deicing Controller.
- High COP
- Outdoor coil with hydrophilic louver fins for RC units.
- Metal sheets protected by anti - corrosion paint work allowing long life resistance.
- Compressor mounted in a soundproofed compartment
- Easy installation and service.




1.3 Tubing Connections

Flare type interconnecting tubing to be produced on site.
For further details please refer to APPENDIX A on this manual, and to the relevant indoor service Manual,

1.4 Inbox Documentation

Each indoor unit is supplied with its own installation and operation manuals, an additional instillation guide is provided in the DUO outdoor package.

1.5 Matching Table

OUTDOOR UNITS		INDOOR UNITS				
						
	MODEL	REFRIGERANT	WNG9	WNG12	ALPHA 9	ALPHA 12
	DUO 9+9 ST/RC	R410A	√		√	
	DUO 9+12 ST/RC	R410A	√	√	√	√
	DUO 12+12 ST/RC	R410A		√		√

2. PRODUCT DATA SHEET

Model Indoor Unit			WNG 9+9		
Model Outdoor Unit			OU7-0909		
Installation Method			Wall Mounted		
Characteristics		Units	Cooling	Heating	
Capacity ⁽¹⁾	Btu/hr		19520	18315	
	kW		5.72	5.37	
Power Input ⁽¹⁾	kW		1.9	1.79	
COP ⁽¹⁾	W/W		3.0	3.0	
Power Supply	V/Ph/Hz		230/1/50+/-10%		
Rated Current	A		7.7	7.3	
Starting Current	A		37.4		
Circuit Breaker Rating	A		16		
INDOOR	Fan Type & Quantity		Crossflow*1		
	Airflow ⁽²⁾	H/M/L	m ³ /hr	450	380 330
	External Static Pressure	Min-Max	Pa	N/A	
	Sound Power Level ⁽³⁾	H/M/L	dB (A)	44	46 49
	Sound Pressure Level ⁽⁴⁾	H/M/L	dB (A)	28	31 35
	Moisture Removal	L/hr		2*0.9	
	Condensate Drain Tube I.D.	mm		16	
	Dimensions	W/H/D	mm	810*190*285	
	Weight	kg		11	
	Package Dimensions	W/H/D	mm	945*395*655	
	Units per Pallet	Units		32	
Stacking Height	Units		8		
OUTDOOR	Refrigerant Control		Capillary tube		
	Compressor Type, Model		Rotary		
	Fan Type & Quantity		Axial*1		
	Fan Speeds	H/L	RPM	850	
	Airflow	H/L	m ³ /hr	1520	1100
	Sound Power Level	H/L	dB (A)	66.8	
	Sound Pressure Level ⁽⁴⁾	H/L	dB (A)	59	
	Dimensions	W/H/D	mm	900*680*340	
	Weight	kg		72	
	Package Dimensions	W/H/D	mm	985*730*406	
	Packaged Weight	kg		74	
	Units per Pallet	Units		6	
	Stacking Height	Units		2	
	Refrigerant Type		R410A		
	Refrigerant Charge ST/ RC outdoor		gr	750+750 / 730+730	
	Connections Between Units	Liquid Line	In	2*6.35(1/4")	
Suction Line		In	2*9.53(3/8")		
Max. Tubing Length		m	15		
Max. Height Difference		m	7		
Operation Control Type		LC D REMOTE CONTROL			
Heating Elements		kW	NO		
Others					

- 1) Rating conditions in accordance with ISO 5151 and ISO 13253 (for ducted units) and EN14511.
- 2) Airflow in ducted units; at nominal external static pressure.
- 3) Sound power in ducted units is measured at air discharge.
- 4) Sound pressure level measured at 1 meter distance from unit.

PRODUCT DATA SHEET

Model Indoor Unit			WNG 9+12			
Model Outdoor Unit			OU7-0912			
Installation Method			Wall Mounted			
Characteristics		Units	Cooling		Heating	
Capacity ⁽¹⁾		Btu/hr	20230		20910	
		kW	5.93		6.13	
Power Input ⁽¹⁾		kW	2.07		1.97	
COP ⁽¹⁾		W/W	2.86		3.1	
Power Supply		V/Ph/Hz	230/1/50			
Rated Current		A	9		8.7	
Starting Current		A	43			
Circuit Breaker Rating		A	16			
INDOOR	Fan Type & Quantity		Crossflow*1			
	Airflow ⁽²⁾	H/M/L	m ³ /hr	450+635	380+550 330+450	
	External Static Pressure		Min-Max	Pa		
				N/A		
	Sound Power Level ⁽³⁾		H/M/L	dB (A)	44+49	46+53 49+56
	Sound Pressure Level ⁽⁴⁾		H/M/L	dB (A)	28+35	31+39 35+43
	Moisture Removal			L/hr	0.9+1.3	
	Condensate Drain Tube I.D.			mm	16	
	Dimensions		W/H/D	mm	810*190*285	
	Weight			kg	11+11.5	
	Package Dimensions		W/H/D	mm	945*395*655	
	Units per Pallet			Units	32	
Stacking Height			Units	8		
OUTDOOR	Refrigerant Control			Capillary		
	Compressor Type, Model			Rotary		
	Fan Type & Quantity			Axial*1		
	Fan Speeds		H/L	RPM	850	
	Airflow		H/L	m ³ /hr	1520	1100
	Sound Power Level		H/L	dB (A)	66.8	
	Sound Pressure Level ⁽⁴⁾		H/L	dB (A)	59	
	Dimensions		W/H/D	mm	900*680*340	
	Weight			kg	74	
	Package Dimensions		W/H/D	mm	985*730*406	
	Packaged Weight			kg	76	
	Units per Pallet			Units	6	
	Stacking Height			Units	2	
	Refrigerant Type				R410A	
	Refrigerant Charge ST/ RC outdoor			gr	830+670 / 830+670	
Connections Between Units	Liquid Line		in	2*6.35(1/4")		
	Suction Line		in	2*9.53(3/8")		
	Max. Tubing Length			m	15	
	Max. Height Difference			m	7	
Operation Control Type				LCD REMOTE CONTROL		
Heating Elements			kW	NO		
Others						

- 1) Rating conditions in accordance with ISO 5151 and ISO 13253 (for ducted units) and EN14511.
- 2) Airflow in ducted units; at nominal external static pressure.
- 3) Sound power in ducted units is measured at air discharge.
- 4) Sound pressure level measured at 1 meter distance from unit.

Model Indoor Unit			Alpha 9+9			
Model Outdoor Unit			OU7-0909			
Installation Method			Wall Mounted			
Characteristics		Units	Cooling	Heating		
Capacity ⁽¹⁾		Btu/hr	17400	18425		
		kW	5.1	5.4		
Power Input ⁽¹⁾		kW	1.84	1.86		
COP ⁽¹⁾		W/W	2.8	2.9		
Power Supply		V/Ph/Hz	230/1/50			
Rated Current		A	7.6	7.7		
Starting Current		A	37.4			
Circuit Breaker Rating		A	16			
INDOOR	Fan Type & Quantity		Crossflow*1			
	Airflow ⁽²⁾	H/M/L	m ³ /hr	450	350	
	External Static Pressure		Min-Max	N/A		
	Sound Power Level ⁽³⁾		H/M/L	dB (A)	52	47
	Sound Pressure Level ⁽⁴⁾		H/M/L	dB (A)	40	36
	Moisture Removal		L/hr	2*0.9		
	Condensate Drain Tube I.D.		mm	16		
	Dimensions		W/H/D	680*250*180		
	Weight		kg	7		
	Package Dimensions		W/H/D	770*325*265		
	Units per Pallet		Units	36		
	Stacking Height		Units	9		
OUTDOOR	Refrigerant Control		Capillary tube			
	Compressor Type, Model		Rotary			
	Fan Type & Quantity		Axial*1			
	Fan Speeds		H/L	RPM	850	
	Airflow		H/L	m ³ /hr	1520	1100
	Sound Power Level		H/L	dB (A)	66.8	
	Sound Pressure Level ⁽⁴⁾		H/L	dB (A)	59	
	Dimensions		W/H/D	900*680*340		
	Weight		kg	72		
	Package Dimensions		W/H/D	985*730*406		
	Packaged Weight		kg	74		
	Units per Pallet		Units	6		
	Stacking Height		Units	2		
	Refrigerant Type		R410A			
	Refrigerant Charge ST/ RC outdoor		gr	750+750 / 730+730		
Connections Between Units	Liquid Line		In	2*6.35(1/4")		
	Suction Line		In	2*9.53(3/8")		
	Max. Tubing Length		m	15		
	Max. Height Difference		m	7		
Operation Control Type		LC D REMOTE CONTROL				
Heating Elements		kW	NO			
Others						

- 1) Rating conditions in accordance with ISO 5151 and ISO 13253 (for ducted units) and EN14511.
- 2) Airflow in ducted units; at nominal external static pressure.
- 3) Sound power in ducted units is measured at air discharge.
- 4) Sound pressure level measured at 1 meter distance from unit.

PRODUCT DATA SHEET

Model Indoor Unit			ALPHA 9+12			
Model Outdoor Unit			OU7-0912			
Installation Method			Wall Mounted			
Characteristics		Units	Cooling	Heating		
Capacity ⁽¹⁾	Btu/hr		19815	21020		
	kW		5.81	6.16		
Power Input ⁽¹⁾	kW		2.06	2.09		
COP ⁽¹⁾	W/W		2.82	2.94		
Power Supply	V/Ph/Hz		230/1/50+/-10%			
Rated Current	A		9	9.2		
Starting Current	A		43			
Circuit Breaker Rating	A		16			
INDOOR	Fan Type & Quantity			Crossflow *1		
	Airflow ⁽²⁾	H/M/L	m ³ /hr	600+450	450+350	
	External Static Pressure	Min-Max	Pa	N/A		
	Sound Power Level ⁽³⁾	H/M/L	dB (A)	54+52	47+47	
	Sound Pressure Level ⁽⁴⁾	H/M/L	dB (A)	42+40	36+36	
	Moisture Removal	L/hr		0.9+1.3		
	Condensate Drain Tube I.D.	mm		16		
	Dimensions	W/H/D	mm	680*250*180/840*250*180		
	Weight	kg		7+8		
	Package Dimensions	W/H/D	mm	930*325*265/770*325*265		
	Units per Pallet	Units		36		
	Stacking Height	Units		9		
	OUTDOOR	Refrigerant Control			Capillary	
Compressor Type, Model			Rotary			
Fan Type & Quantity			Axial*1			
Fan Speeds		H/L	RPM	850		
Airflow		H/L	m ³ /hr	1520	1100	
Sound Power Level		H/L	dB (A)	66.8		
Sound Pressure Level ⁽⁴⁾		H/L	dB (A)	59		
Dimensions		W/H/D	mm	900*680*340		
Weight		kg		74		
Package Dimensions		W/H/D	mm	985*730*406		
Packaged Weight		kg		76		
Units per Pallet		Units		6		
Stacking Height		Units		2		
Refrigerant Type			R410A			
Refrigerant Charge ST/ RC outdoor			830+670 / 830+670			
Connections Between Units	Liquid Line	In	2*6.35(1/4")			
	Suction Line	In	2*9.53(3/8")			
	Max. Tubing Length	m	15			
	Max. Height Difference	m	7			
Operation Control Type			LCD REMOTE CONTROL			
Heating Elements			kW	NO		
Others						


- 1) Rating conditions in accordance with ISO 5151 and ISO 13253 (for ducted units) and EN14511.
- 2) Airflow in ducted units; at nominal external static pressure.
- 3) Sound power in ducted units is measured at air discharge.
- 4) Sound pressure level measured at 1 meter distance from unit.

2.1 Capacity & Additional Charge Table

2.1.1 DUO 9+9 RC Additional Refrigerant Charge Table (as show on unit).

2.1.2 DUO 9+9 ST Additional Refrigerant Charge Table (as show on unit).

CAPACITY AND ADDITIONAL CHARGE FOR VARIOUS APPLICATIONS					
INDOOR		UNIT 1	UNIT 2	UNIT 1	UNIT 2
		ALPHA 9	ALPHA 9	WNG 9	WNG 9
		AME 20	AME 20	NXE 20	NXE 20
		WAF 9	WAF 9	FLO 9	FLO 9
COOLING CAPACITY*		17400 Btu/h, 5100W		19520 Btu/h, 5720W	
ADDITIONAL CHARGE (gr)					
	7.5m-15m				

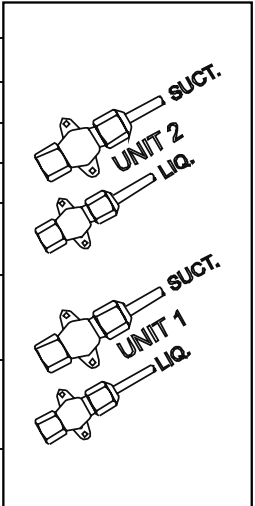

* For two units operating simultaneously.

REFRIGERANT R410A

Cat.No.433945/01

2.1.3 DUO 9+12 RC Additional Refrigerant Charge Lable (as show on unit).

CAPACITY AND ADDITIONAL CHARGE FOR VARIOUS APPLICATIONS					
INDOOR		UNIT 1	UNIT 2	UNIT 1	UNIT 2
		ALPHA 12	ALPHA 9	WNG 12	WNG 9
		WAF 12	WAF 9	FLO 12	FLO 9
		MAE 30	MAE 20	NXE 30	NXE 20
COOLING CAPACITY*		19815 Btu/h, 5810W		20230 Btu/h, 5930W	
HEATING CAPACITY*		21020 Btu/h, 6160W		20910 Btu/h, 6130W	
ADDITIONAL CHARGE (gr)	Up to 7.5m	0	0	50	50
	7.5m-15m	50	50	100	100

* For two units operating simultaneously.
REFRIGERANT R410A Cat.No.433944/01

2.1.4 DUO 9+12 ST Additional Refrigerant Charge Lable (as show on unit).

CAPACITY AND ADDITIONAL CHARGE FOR VARIOUS APPLICATIONS					
INDOOR		UNIT 1	UNIT 2	UNIT 1	UNIT 2
		ALPHA 12	ALPHA 9	WNG 12	WNG 9
		AME 30	AME 20	NXE 30	NXE 20
COOLING CAPACITY*		19815 Btu/h, 5810W		20230 Btu/h, 5930W	
ADDITIONAL CHARGE (gr)	Up to 7.5m	0	0	90	80
	7.5m-15m	100	100	190	180

* For two units operating simultaneously.
REFRIGERANT R410A Cat.No.433946/01

3. RATING CONDITIONS

Standard conditions in accordance with ISO 5151, ISO 13253 (for ducted units) and EN 14511.

Cooling:

Indoor: 27°C DB 19°C WB

Outdoor: 35°C DB

Heating:

Indoor: 20°C DB


Outdoor: 7°C DB 6°C WB

3.1 Operating Limits


		Indoor	Outdoor
Cooling	Upper limit	32°C DB 23°C WB	46°C DB
	Lower limit	21°C DB 15°C WB	21°C DB
Heating	Upper limit	27°C DB	24°C DB 18°C WB
	Lower limit	20°C DB	-9°C DB -10°C WB
Voltage	1PH	198 – 264 V	
	3PH	360 – 440 V	

4. OUTLINE DIMENSIONS

4.1 Indoor Unit: Alpha 9

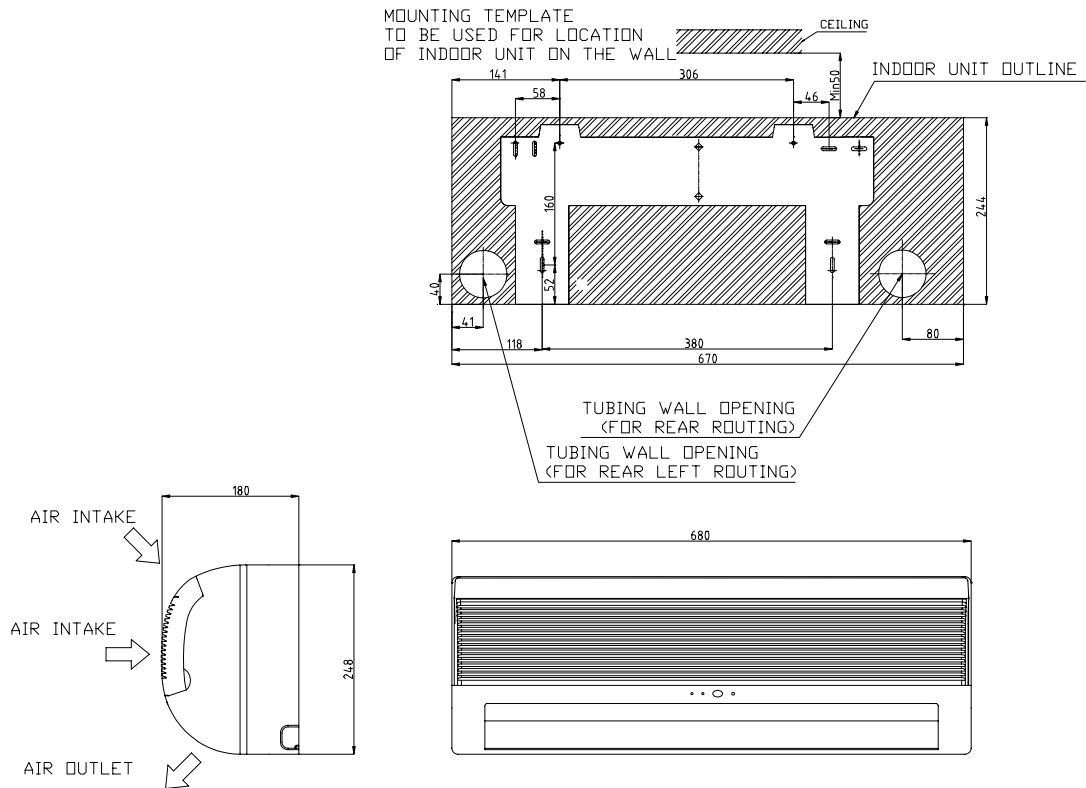


4.2 Indoor Unit: Alpha 12

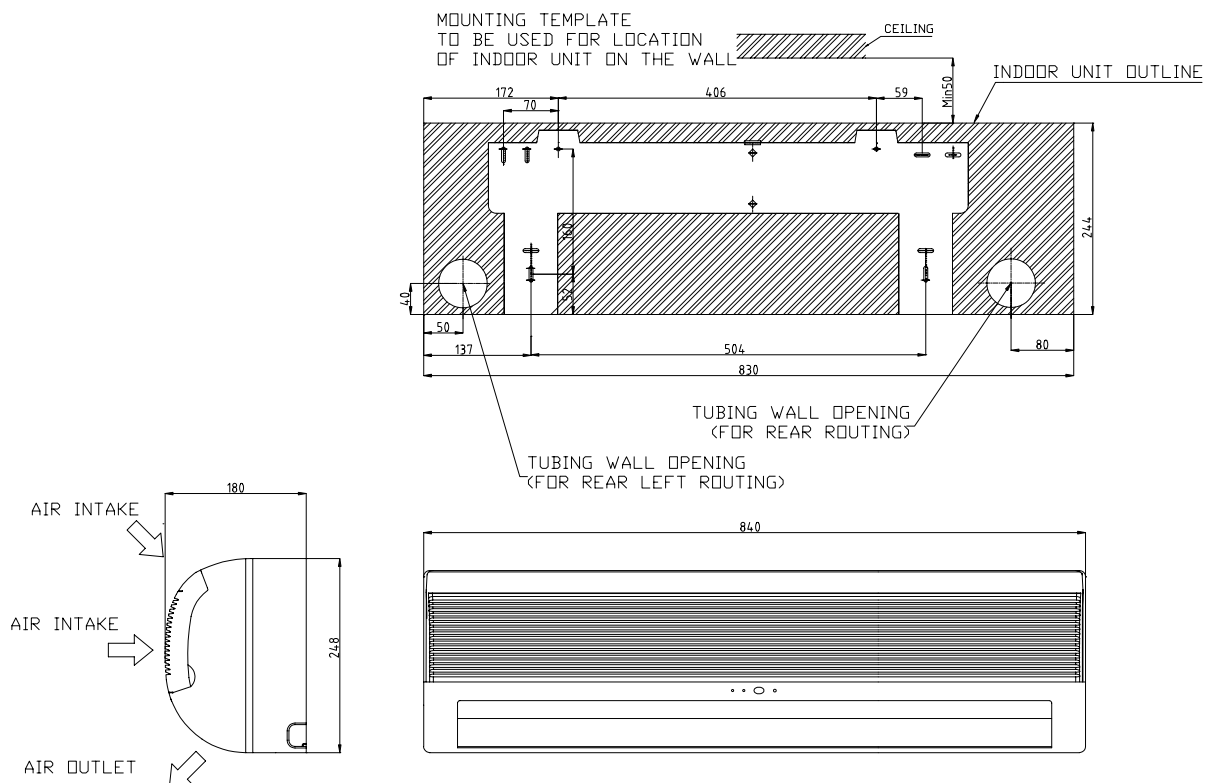


OUTLINE DIMENSIONS

4.3 Indoor Unit: WNG 9, 12

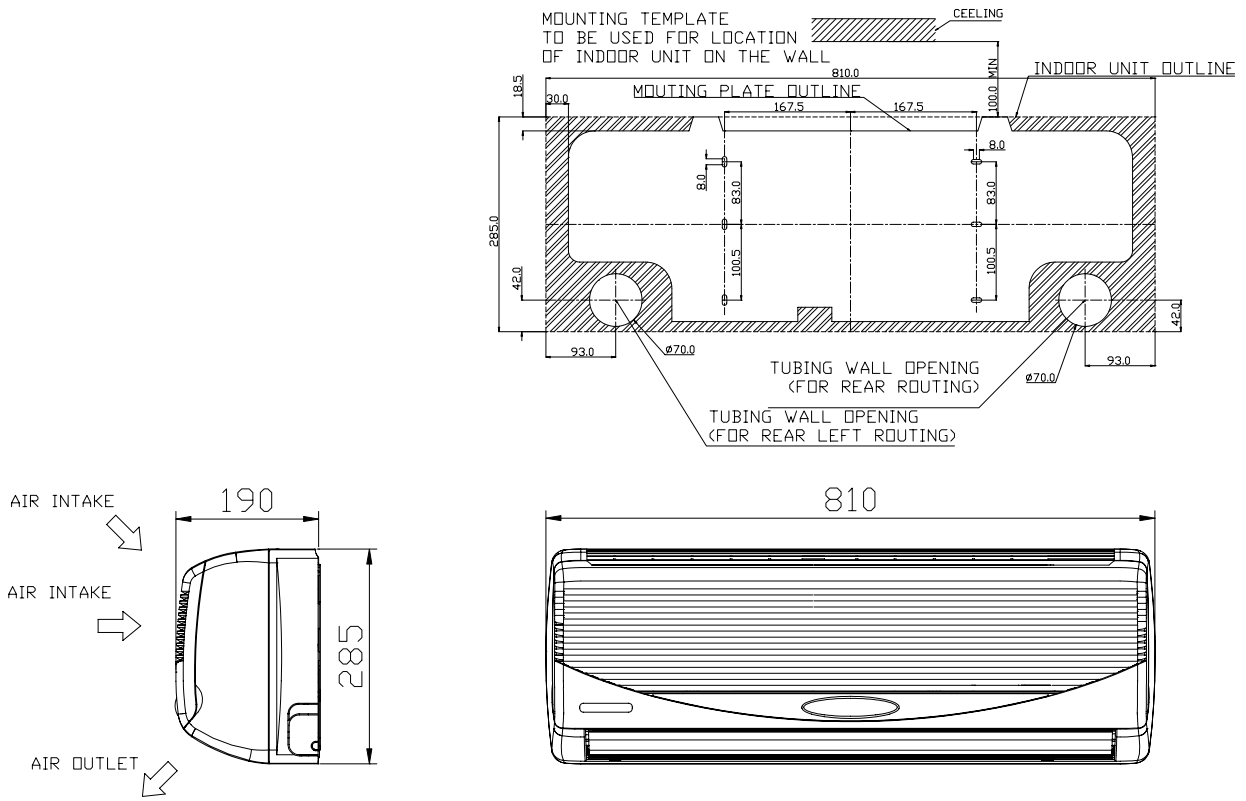

4.2 Outdoor Unit: DUO OU7

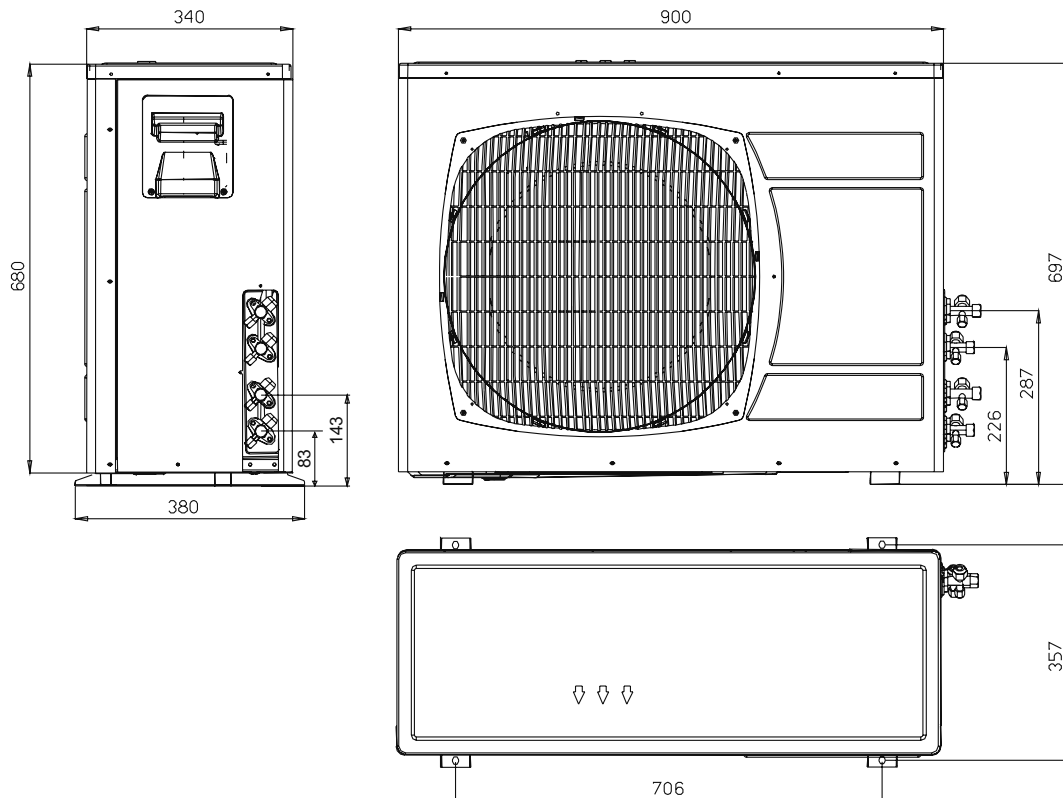

5. PERFORMANCE DATA

5.1 DUO ALPHA (9+9):Room A + Room B

5.1.1 Cooling Mode at 7.5m Tubing Connection.

230V : Indoor Fan at High Speed.

ENTERING AIR DB OU COIL (°C)	DATA	ENTERING AIR WB/DB ID COIL (°C)				
		15/21	17/24	19/27	21/29	23/32
15 ⁽¹⁾	TC	5.38	5.57	5.70	5.83	5.92
	SC	3.65	3.81	3.96	4.06	4.13
	PI	1.30	1.31	1.31	1.31	1.32
20 ⁽¹⁾	TC	5.20	5.48	5.65	5.79	5.91
	SC	3.58	3.77	3.93	4.05	4.12
	PI	1.42	1.42	1.43	1.43	1.44
25	TC	4.92	5.31	5.59	5.75	5.90
	SC	3.49	3.70	3.90	4.02	4.09
	PI	1.53	1.54	1.55	1.56	1.57
30	TC	4.60	5.01	5.41	5.61	5.77
	SC	3.38	3.59	3.82	3.93	4.00
	PI	1.65	1.68	1.69	1.70	1.72
35	TC	4.26	4.62	5.10	5.36	5.61
	SC	3.21	3.44	3.73	3.84	3.91
	PI	1.78	1.81	1.84	1.85	1.86
40	TC	3.87	4.22	4.60	5.03	5.29
	SC	3.03	3.26	3.53	3.64	3.72
	PI	1.92	1.95	1.98	2.01	2.03
46	TC	3.36	3.68	4.04	4.47	4.81
	SC	2.79	2.99	3.22	3.33	3.40
	PI	2.10	2.13	2.18	2.21	2.23

LEGEND

- TC – Total Cooling Capacity, kW
- SC – Sensible Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor

5.1.2 Heating Mode at 7.5m Tubing Connection.

230V : Indoor Fan at High Speed.

ENTERING AIR WB OU COIL (°C)	ENTERING AIR DB ID COIL (°C)					
	15		20		25	
	TH	PI	TH	PI	TH	PI
-10	3.12	1.49	3.00	1.58	2.88	1.66
-7	3.36	1.53	3.24	1.61	3.12	1.70
-2	3.56	1.54	3.45	1.64	3.33	1.73
2	4.34	1.62	4.16	1.72	3.98	1.82
6	5.56	1.74	5.40	1.86	5.21	1.98
10	6.05	1.84	5.89	1.96	5.72	2.10
15	6.53	1.92	6.37	2.06	6.21	2.19
20	6.89	1.97	6.72	2.14	6.53	2.31

* the above chart includes the weighted deicing influence.



LEGEND

- TH – Total Heating Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor



5.2 Pressure Curves.

5.2.1 ALPHA 9

5.2.2 Cooling.

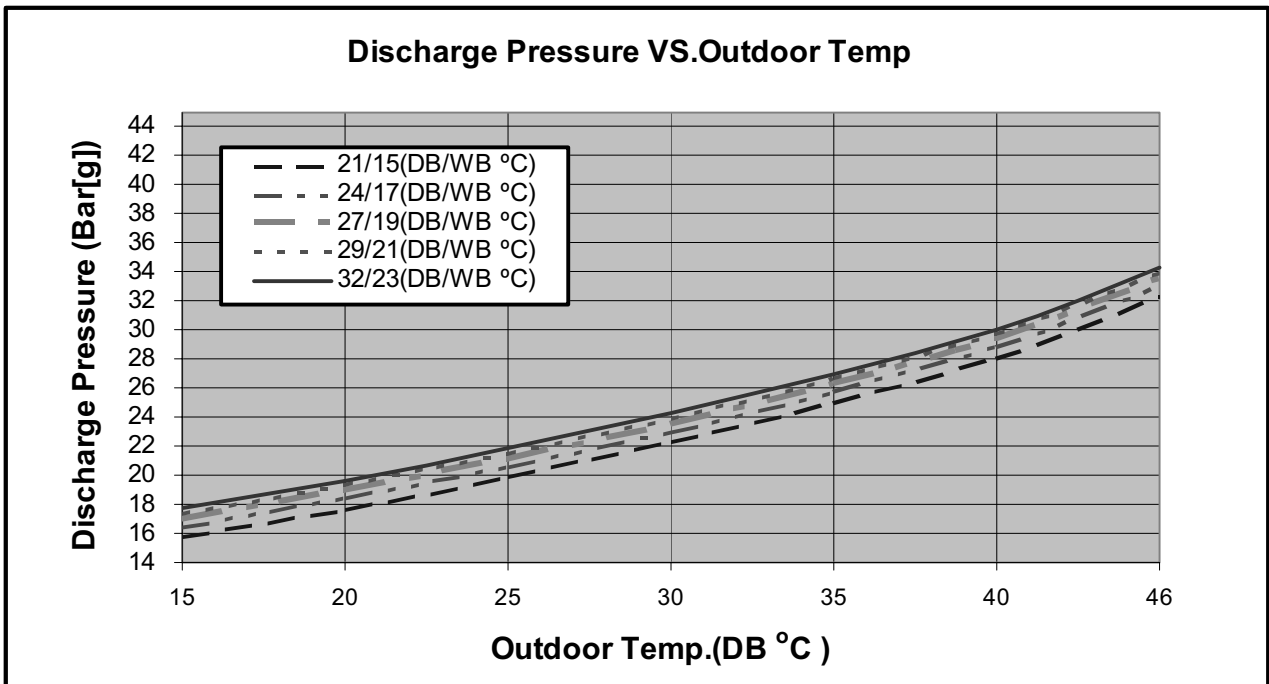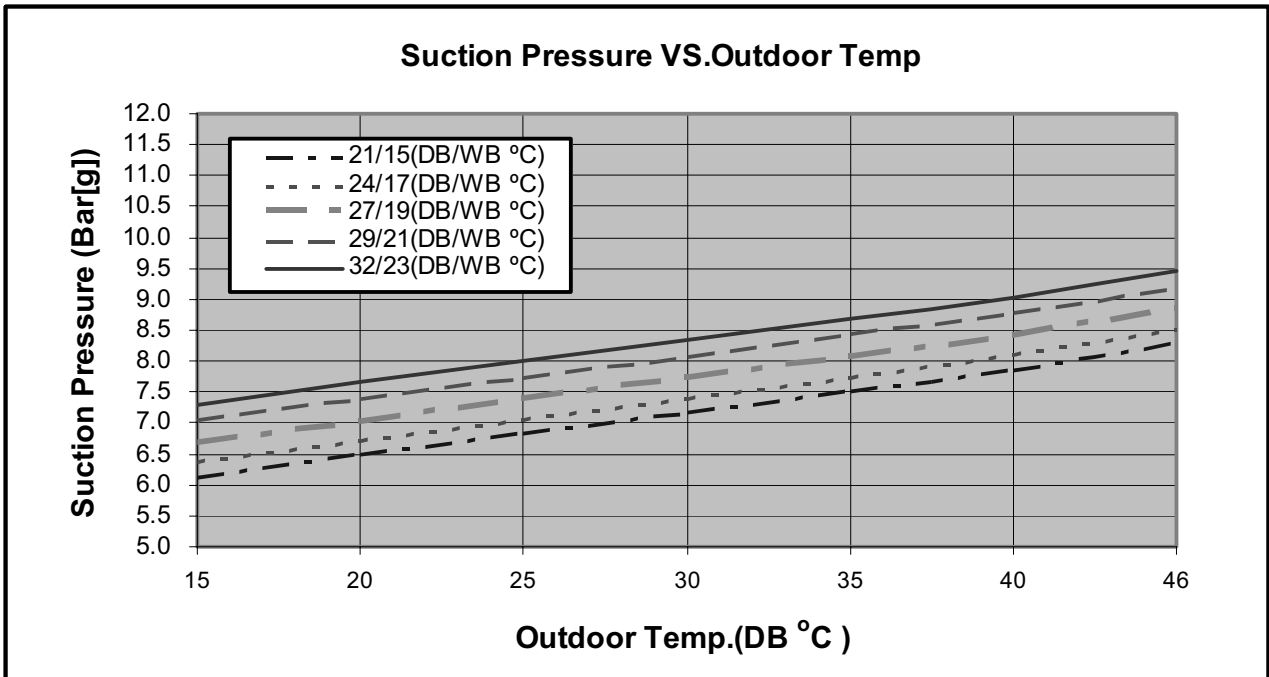

5.2.3 Heating.

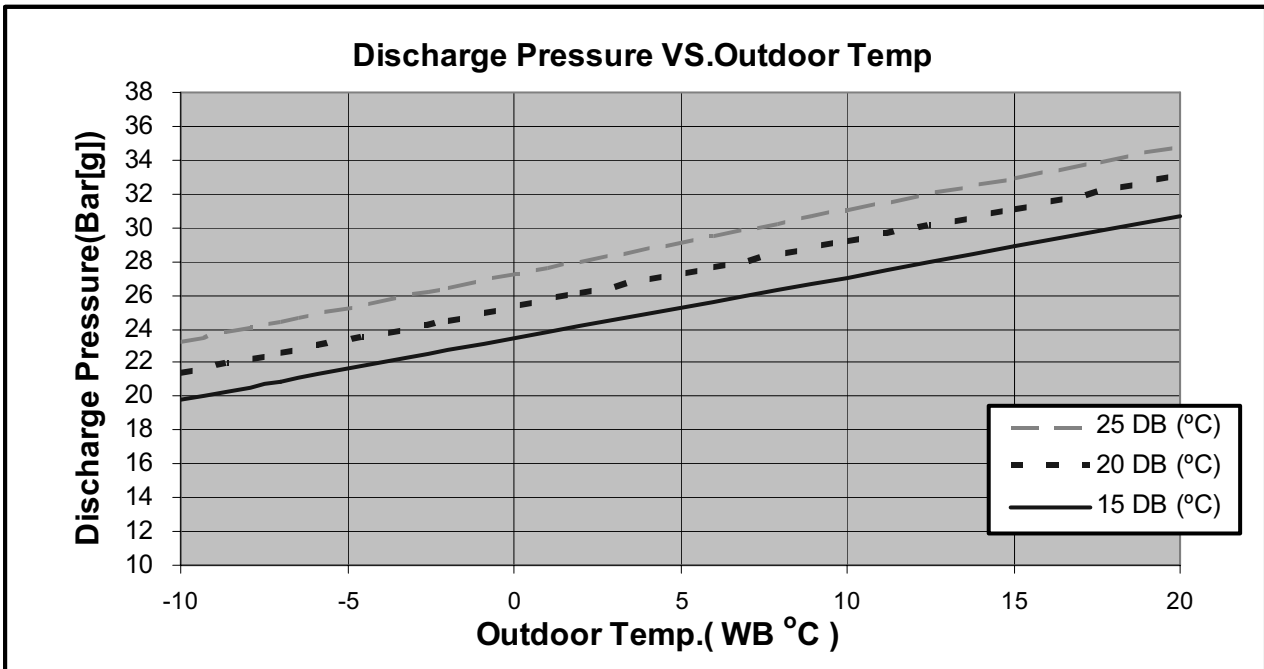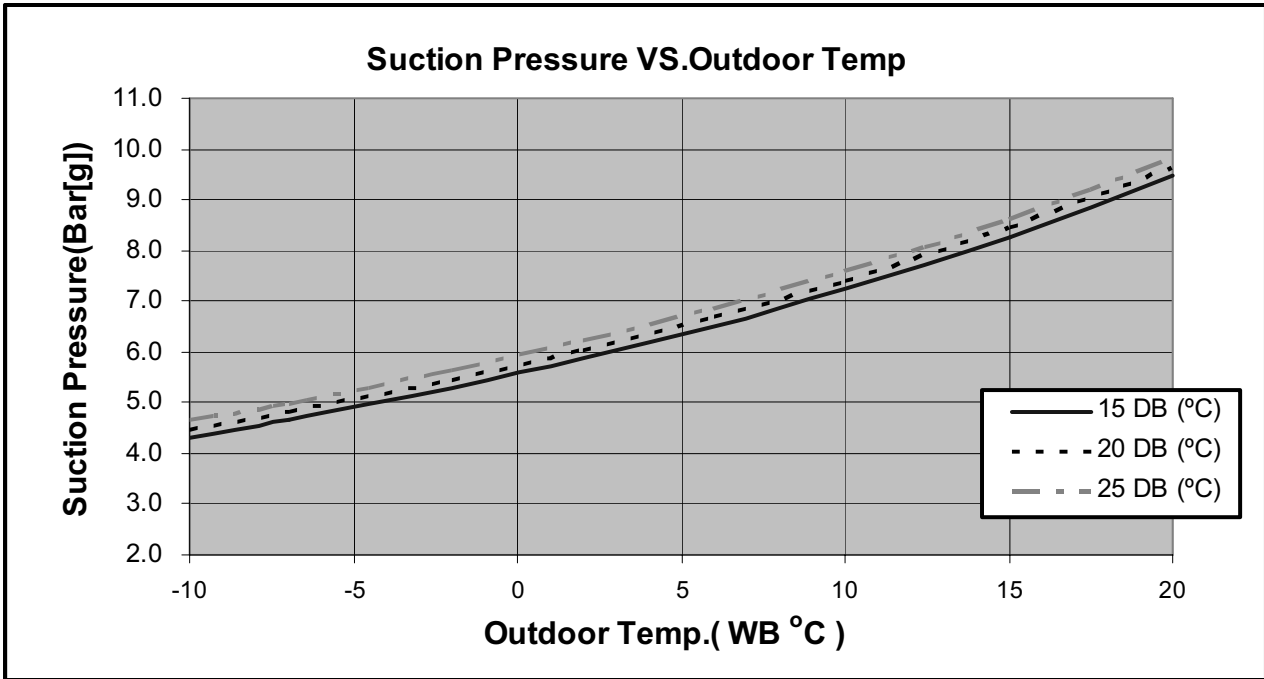

5.3 DUO ALPHA (9+12):Room A + Room B

5.3.1 Cooling Mode at 7.5m Tubing Connection.

230V : Indoor Fan at High Speed.

ENTERING AIR DB OU COIL (°C)	DATA	ENTERING AIR WB/DB ID COIL (°C)				
		15/21	17/24	19/27	21/29	23/32
15 ⁽¹⁾	TC	6.12	6.34	6.49	6.65	6.75
	SC	4.10	4.28	4.45	4.56	4.64
	PI	1.46	1.46	1.47	1.47	1.48
20 ⁽¹⁾	TC	5.92	6.24	6.44	6.59	6.74
	SC	4.02	4.24	4.42	4.54	4.63
	PI	1.59	1.59	1.60	1.60	1.61
25	TC	5.61	6.05	6.36	6.56	6.72
	SC	3.92	4.16	4.39	4.51	4.59
	PI	1.71	1.73	1.74	1.75	1.76
30	TC	5.24	5.71	6.17	6.39	6.58
	SC	3.80	4.03	4.29	4.41	4.50
	PI	1.85	1.88	1.89	1.91	1.92
35	TC	4.85	5.27	5.81	6.10	6.39
	SC	3.61	3.87	4.19	4.31	4.40
	PI	1.99	2.03	2.06	2.08	2.09
40	TC	4.41	4.81	5.24	5.73	6.03
	SC	3.40	3.66	3.96	4.09	4.17
	PI	2.15	2.18	2.22	2.25	2.27
46	TC	3.83	4.19	4.60	5.09	5.48
	SC	3.13	3.36	3.61	3.74	3.82
	PI	2.35	2.38	2.44	2.47	2.50

LEGEND

- TC – Total Cooling Capacity, kW
- SC – Sensible Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor

5.3.2 Heating Mode at 7.5m Tubing Connection.

230V : Indoor Fan at High Speed.

ENTERING AIR WB OU COIL (°C)	ENTERING AIR DB ID COIL (°C)					
	15		20		25	
	TH	PI	TH	PI	TH	PI
-10	3.56	1.67	3.42	1.78	3.29	1.87
-7	3.83	1.71	3.69	1.81	3.56	1.91
-2	4.07	1.73	3.93	1.84	3.79	1.94
2	4.95	1.82	4.74	1.93	4.54	2.05
6	6.34	1.95	6.16	2.09	5.94	2.22
10	6.90	2.06	6.71	2.20	6.53	2.36
15	7.45	2.15	7.27	2.32	7.08	2.47
20	7.85	2.22	7.67	2.40	7.45	2.59

* the above chart includes the weighted deicing influence.



LEGEND

- TH – Total Heating Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor



5.4 Pressure Curves.

5.4.1 ALPHA 9

5.4.2 Cooling.

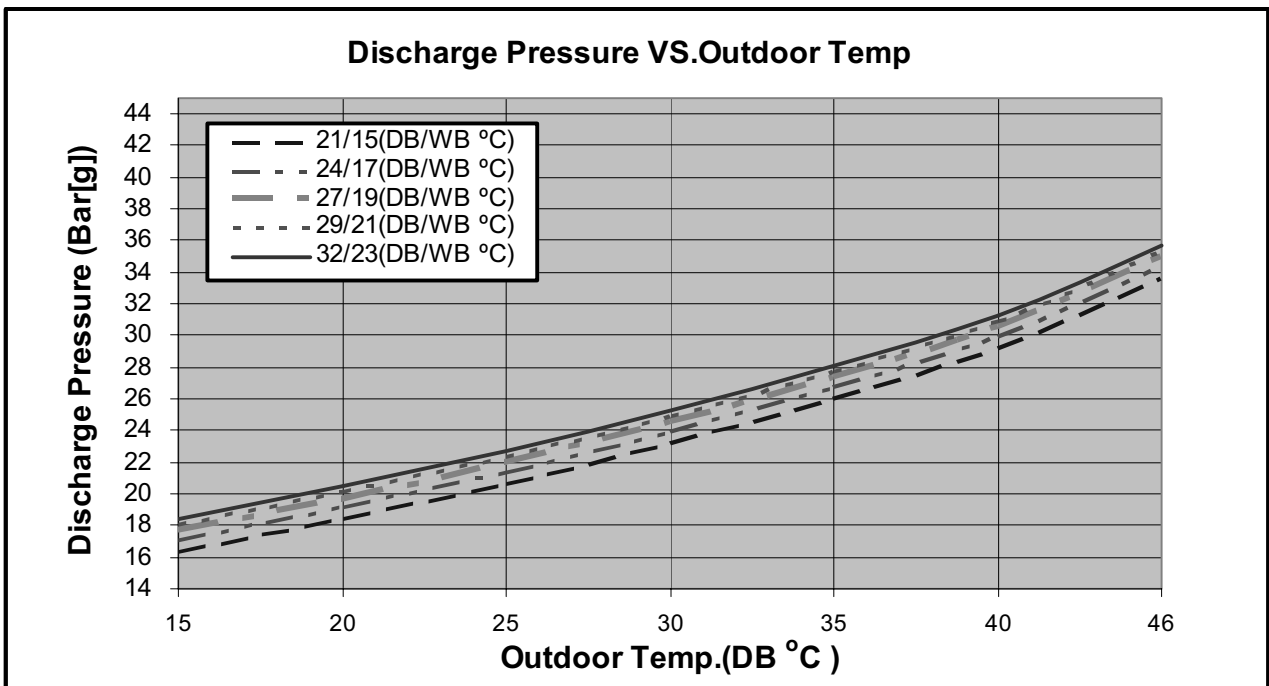
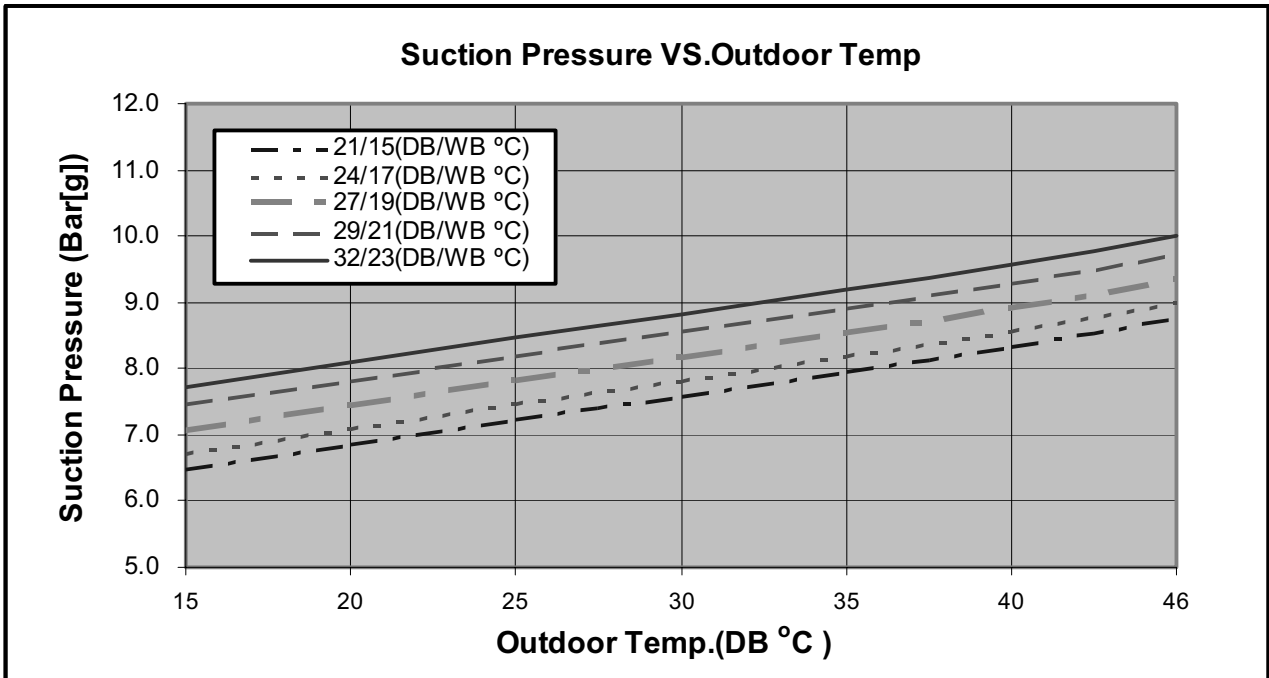


5.4.3 Heating.

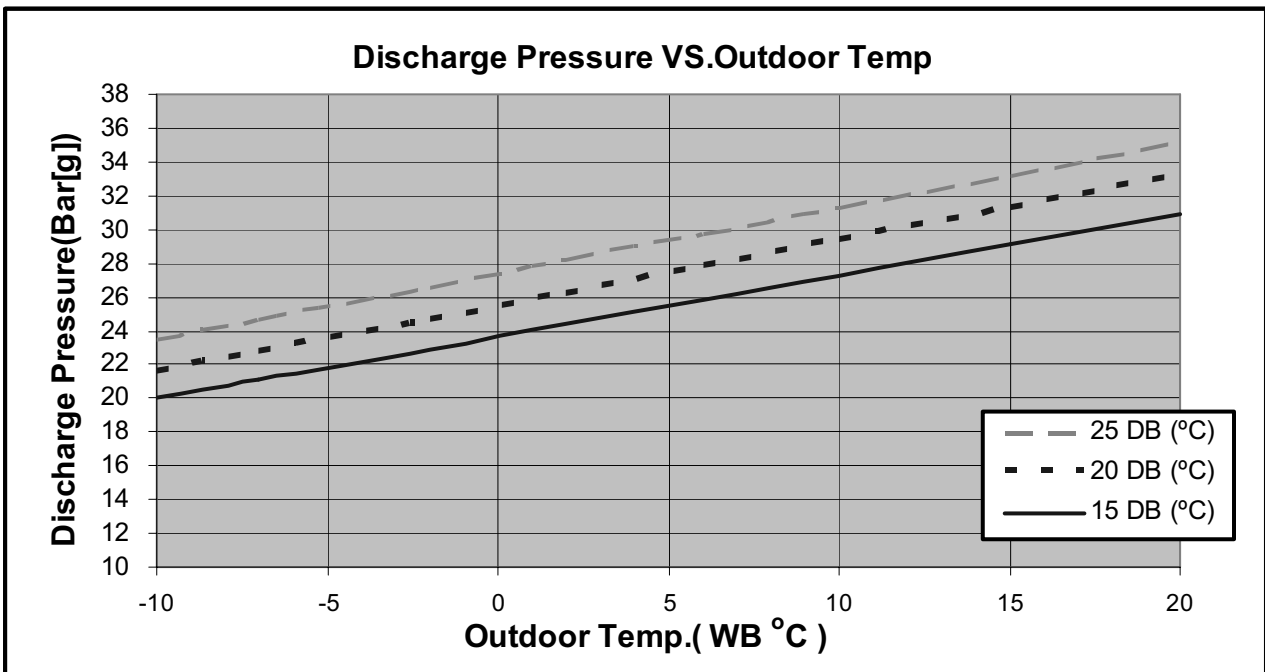
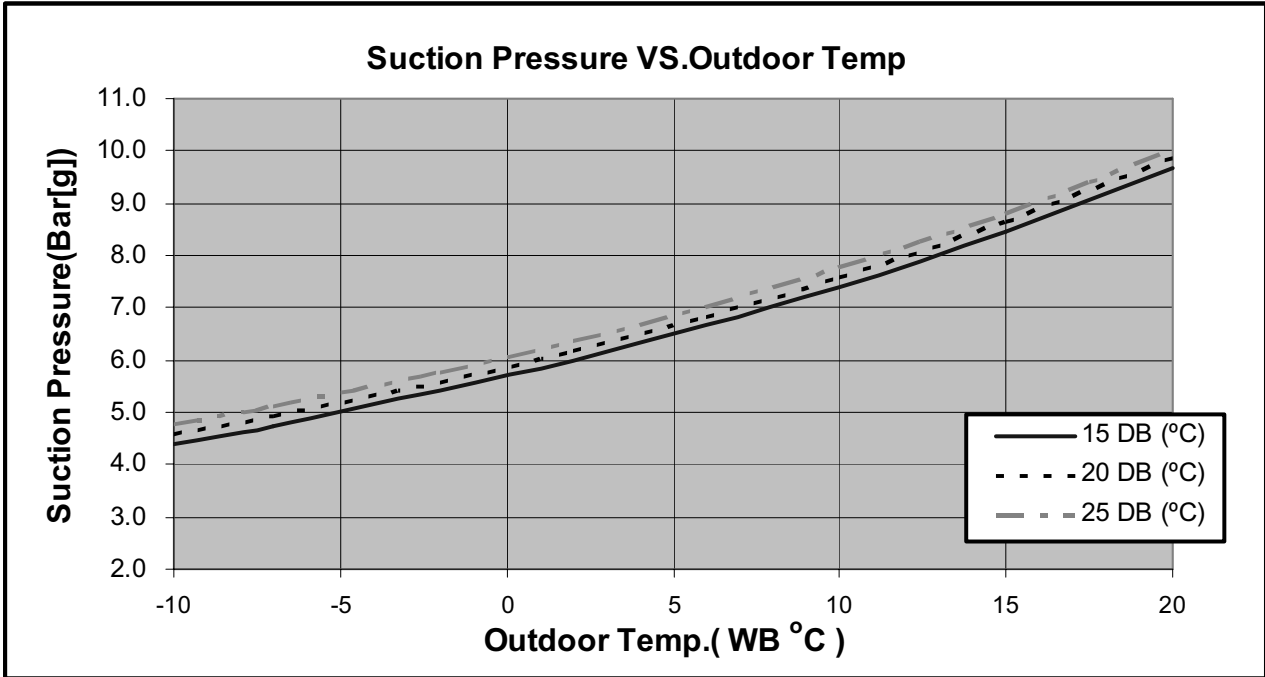


5.4.4 ALPHA 12

5.4.5 Cooling.

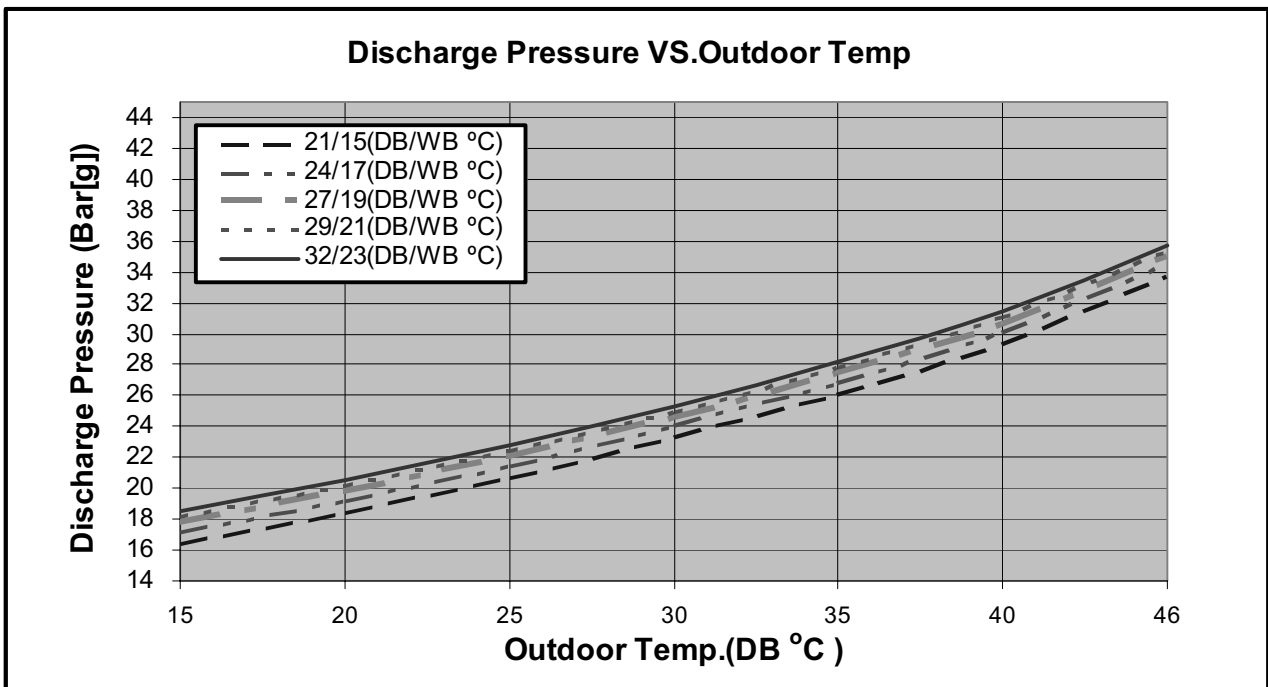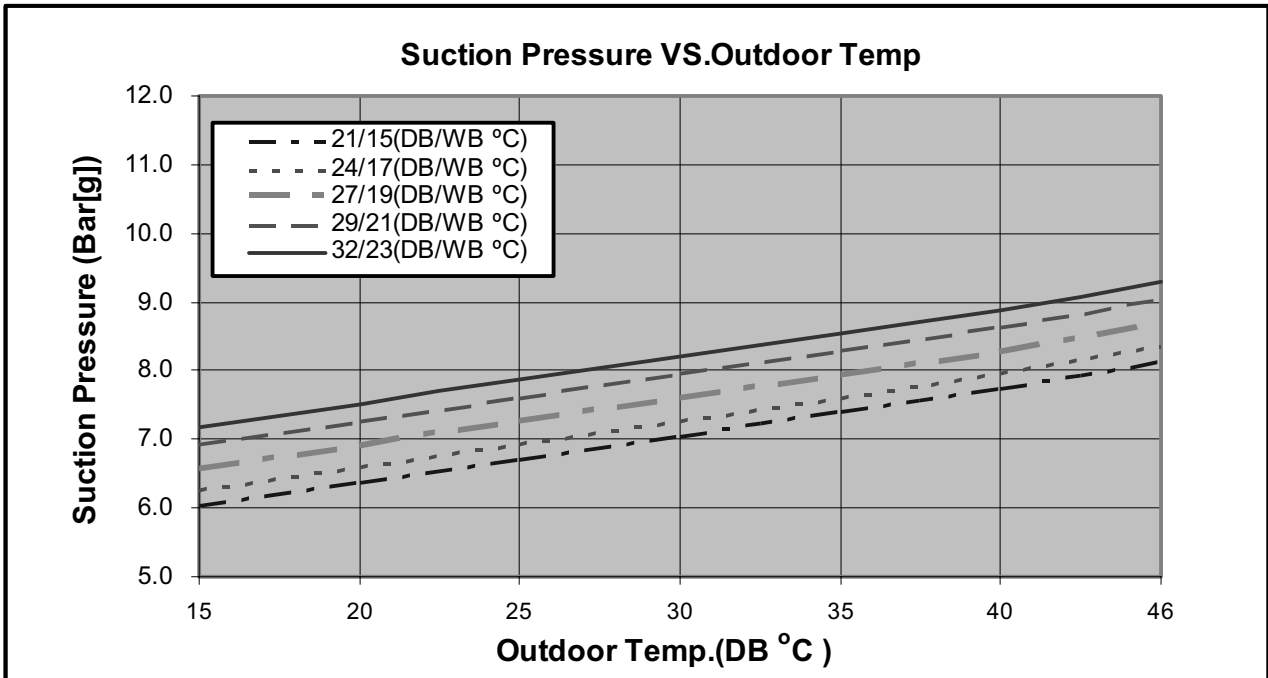

5.4.6 Heating.

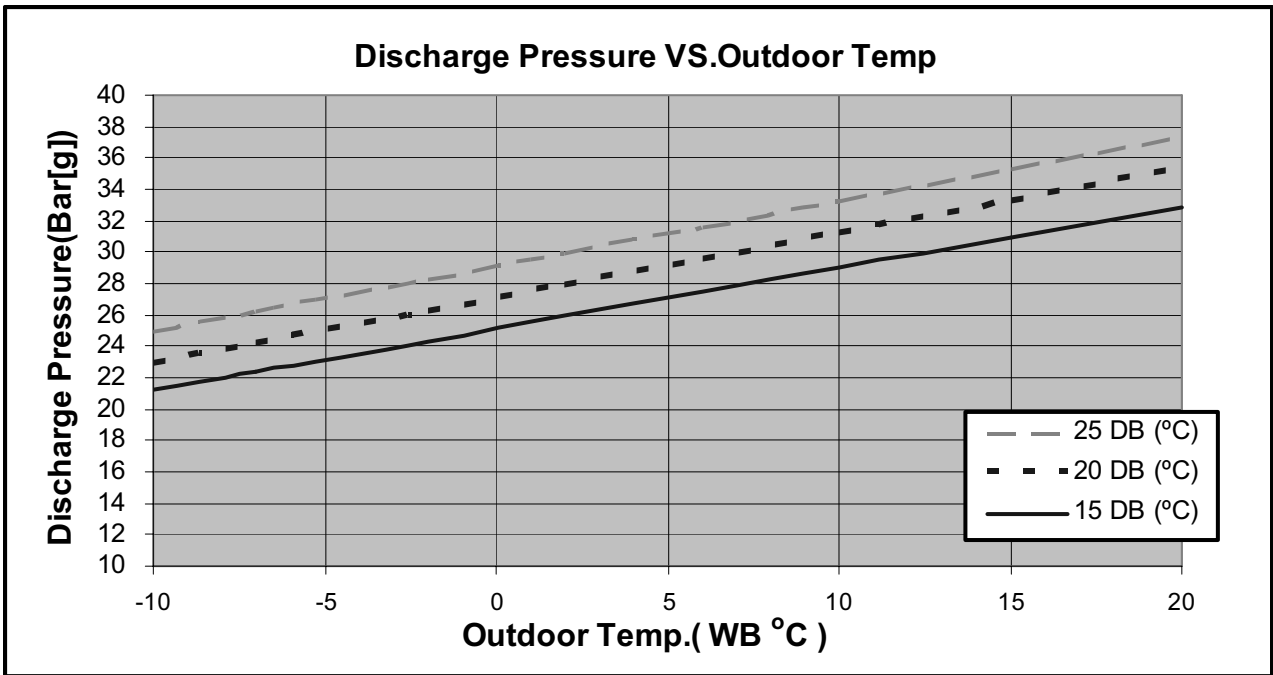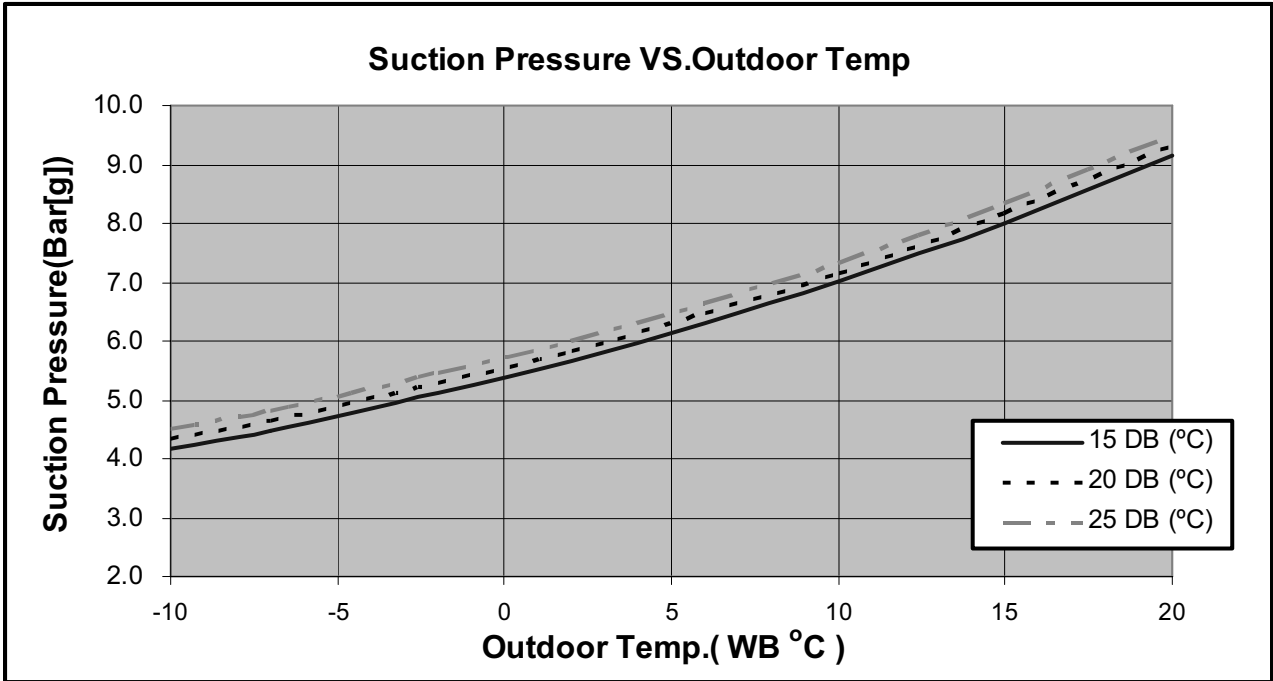

5.5 DUO WNG (9+9):Room A + Room B

5.5.1 Cooling Mode at 7.5m Tubing Connection.

230V : Indoor Fan at High Speed.

ENTERING AIR DB OU COIL (°C)	DATA	ENTERING AIR WB/DB ID COIL (°C)				
		15/21	17/24	19/27	21/29	23/32
15 ⁽¹⁾	TC	6.03	6.24	6.39	6.54	6.64
	SC	4.18	4.36	4.53	4.64	4.73
	PI	1.35	1.35	1.35	1.36	1.36
20 ⁽¹⁾	TC	5.83	6.15	6.34	6.49	6.63
	SC	4.10	4.32	4.50	4.63	4.72
	PI	1.46	1.47	1.47	1.48	1.48
25	TC	5.52	5.96	6.27	6.45	6.61
	SC	3.99	4.24	4.47	4.60	4.68
	PI	1.58	1.59	1.60	1.61	1.62
30	TC	5.16	5.62	6.07	6.29	6.47
	SC	3.87	4.11	4.37	4.50	4.58
	PI	1.70	1.73	1.74	1.76	1.77
35	TC	4.78	5.19	5.72	6.01	6.29
	SC	3.68	3.94	4.27	4.39	4.48
	PI	1.84	1.87	1.90	1.91	1.93
40	TC	4.35	4.73	5.16	5.64	5.93
	SC	3.47	3.73	4.04	4.17	4.25
	PI	1.98	2.01	2.05	2.07	2.09
46	TC	3.77	4.12	4.53	5.01	5.40
	SC	3.19	3.42	3.68	3.81	3.90
	PI	2.17	2.20	2.25	2.28	2.31

LEGEND

- TC – Total Cooling Capacity, kW
- SC – Sensible Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor

5.5.2 Heating Mode at 7.5m Tubing Connection.

230V : Indoor Fan at High Speed.

ENTERING AIR WB OU COIL (°C)	ENTERING AIR DB ID COIL (°C)					
	15		20		25	
	TH	PI	TH	PI	TH	PI
-10	3.10	1.43	2.98	1.53	2.86	1.60
-7	3.34	1.47	3.22	1.55	3.10	1.63
-2	3.54	1.49	3.43	1.58	3.31	1.66
2	4.31	1.56	4.13	1.66	3.96	1.75
6	5.53	1.67	5.37	1.79	5.18	1.90
10	6.01	1.77	5.85	1.89	5.69	2.02
15	6.50	1.84	6.34	1.99	6.18	2.11
20	6.85	1.90	6.69	2.06	6.50	2.22

* the above chart includes the weighted deicing influence.



LEGEND

- TH – Total Heating Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor



5.6 Pressure Curves.

5.6.1 WNG 9

5.6.2 Cooling.

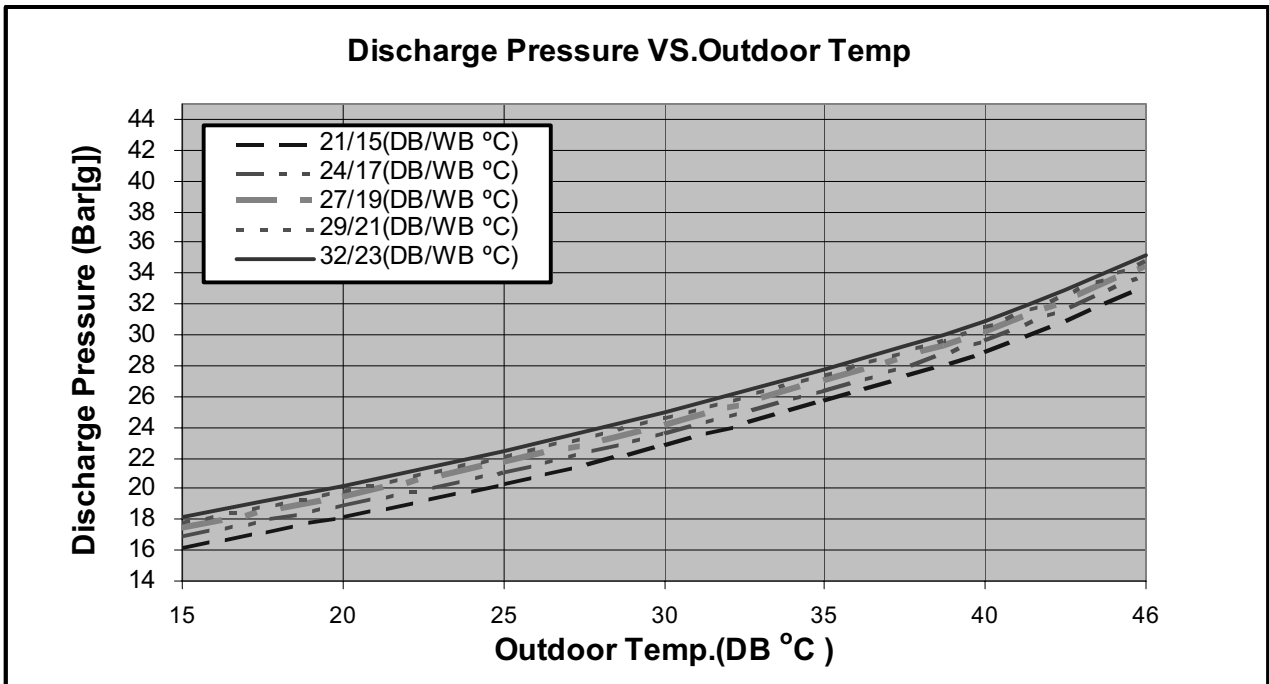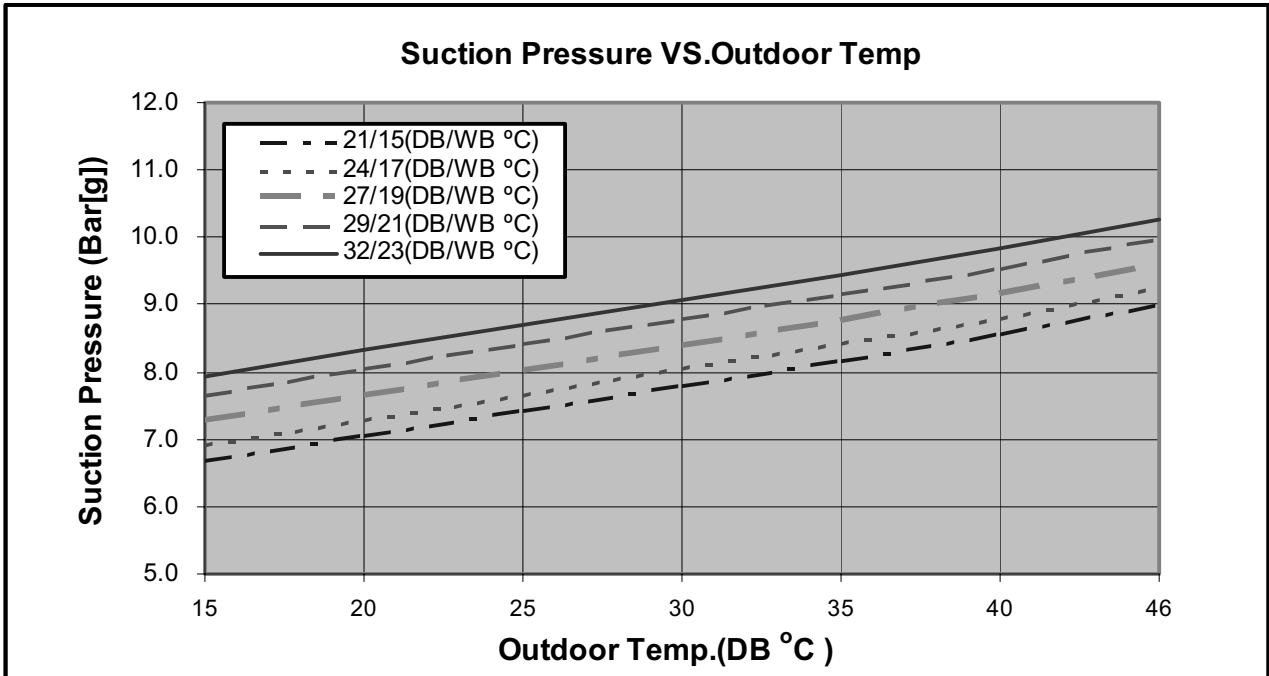

5.6.3 Heating.

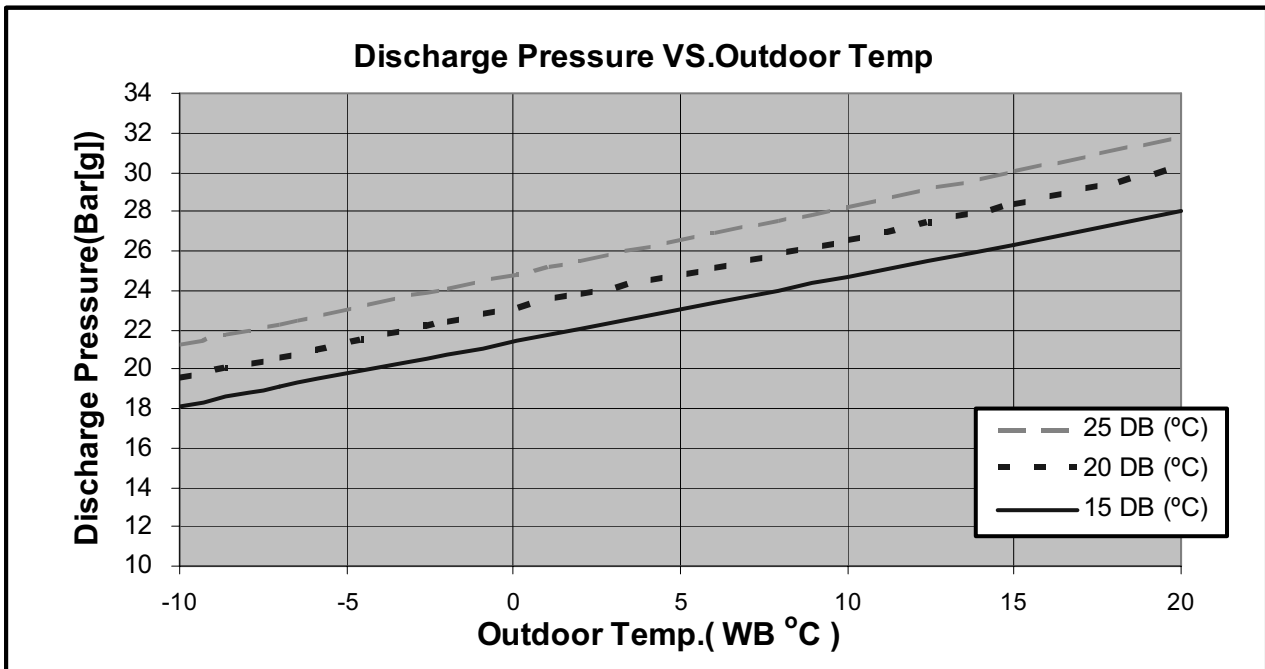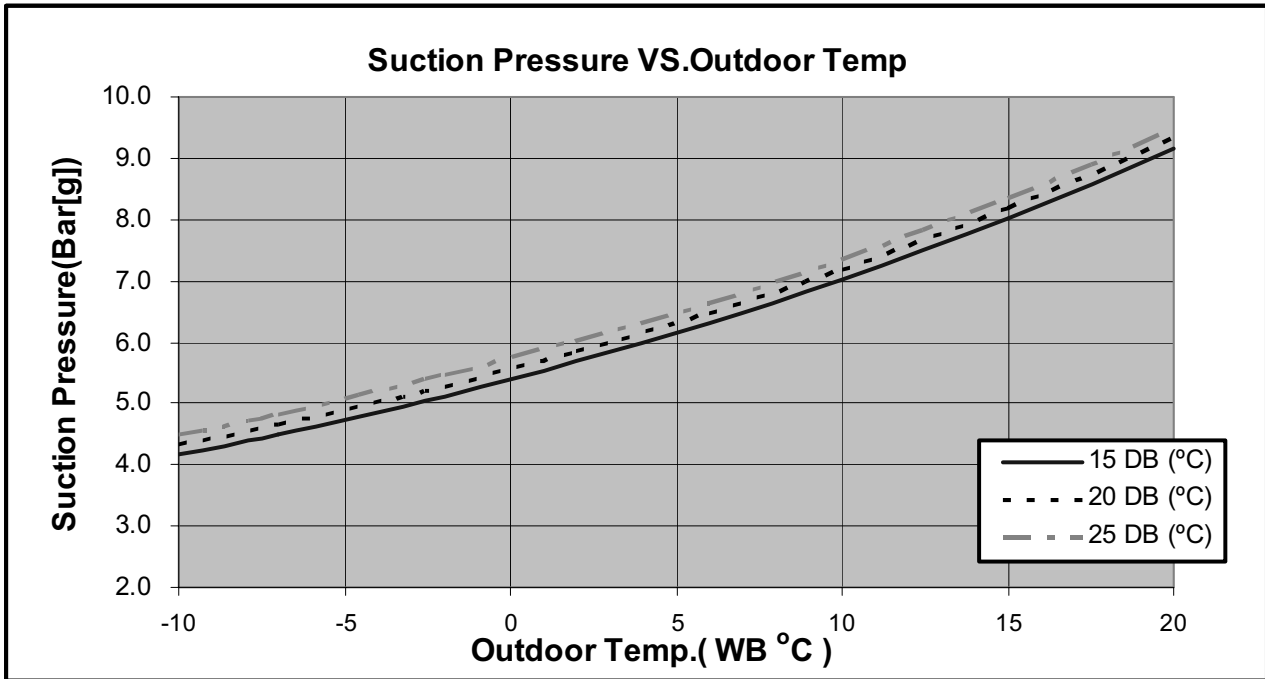

5.7 DUO WNG (9+12): Room A + Room B

5.7.1 Cooling Mode at 7.5m Tubing Connection.

230V : Indoor Fan at High Speed.

ENTERING AIR DB OU COIL (°C)	DATA	ENTERING AIR WB/DB ID COIL (°C)				
		15/21	17/24	19/27	21/29	23/32
15 ⁽¹⁾	TC	6.25	6.47	6.63	6.78	6.89
	SC	4.58	4.78	4.97	5.09	5.18
	PI	1.47	1.47	1.47	1.48	1.48
20 ⁽¹⁾	TC	6.05	6.37	6.58	6.73	6.88
	SC	4.49	4.74	4.94	5.08	5.17
	PI	1.59	1.60	1.60	1.61	1.62
25	TC	5.72	6.18	6.50	6.69	6.85
	SC	4.38	4.64	4.90	5.04	5.13
	PI	1.72	1.73	1.75	1.76	1.77
30	TC	5.35	5.83	6.29	6.52	6.71
	SC	4.24	4.51	4.79	4.93	5.02
	PI	1.86	1.88	1.90	1.92	1.93
35	TC	4.95	5.38	5.93	6.23	6.52
	SC	4.03	4.32	4.68	4.82	4.91
	PI	2.00	2.04	2.07	2.09	2.10
40	TC	4.50	4.90	5.35	5.85	6.15
	SC	3.80	4.09	4.43	4.57	4.66
	PI	2.16	2.19	2.23	2.26	2.28
46	TC	3.91	4.27	4.70	5.19	5.59
	SC	3.50	3.75	4.04	4.18	4.27
	PI	2.36	2.40	2.45	2.49	2.51

LEGEND

- TC – Total Cooling Capacity, kW
- SC – Sensible Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor

5.7.2 Heating Mode at 7.5m Tubing Connection.

230V : Indoor Fan at High Speed.

ENTERING AIR WB OU COIL (°C)	ENTERING AIR DB ID COIL (°C)					
	15		20		25	
	TH	PI	TH	PI	TH	PI
-10	3.54	1.58	3.41	1.68	3.27	1.76
-7	3.81	1.62	3.67	1.70	3.54	1.80
-2	4.05	1.64	3.91	1.73	3.78	1.83
2	4.92	1.71	4.72	1.82	4.52	1.93
6	6.31	1.84	6.13	1.97	5.92	2.09
10	6.87	1.94	6.68	2.08	6.50	2.22
15	7.42	2.03	7.23	2.19	7.05	2.32
20	7.82	2.09	7.63	2.27	7.42	2.44

* the above chart includes the weighted deicing influence.



LEGEND

- TH – Total Heating Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor



5.8 Pressure Curves.

5.8.1 WNG 9

5.8.2 Cooling.

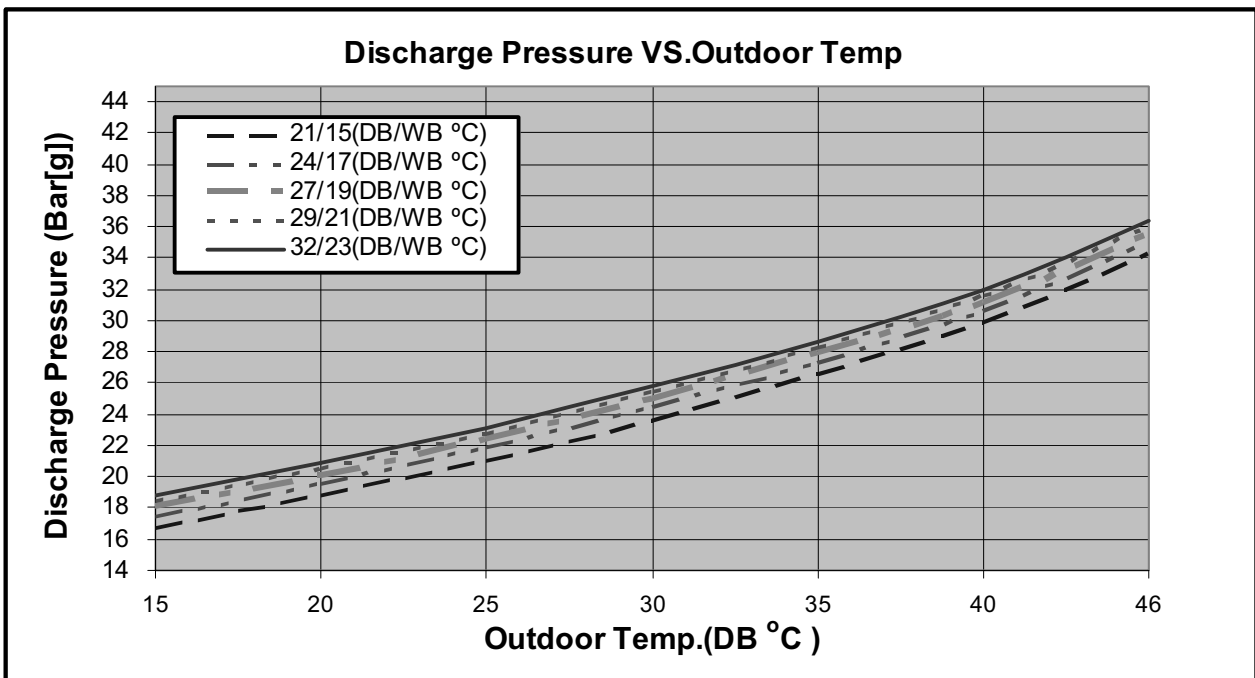
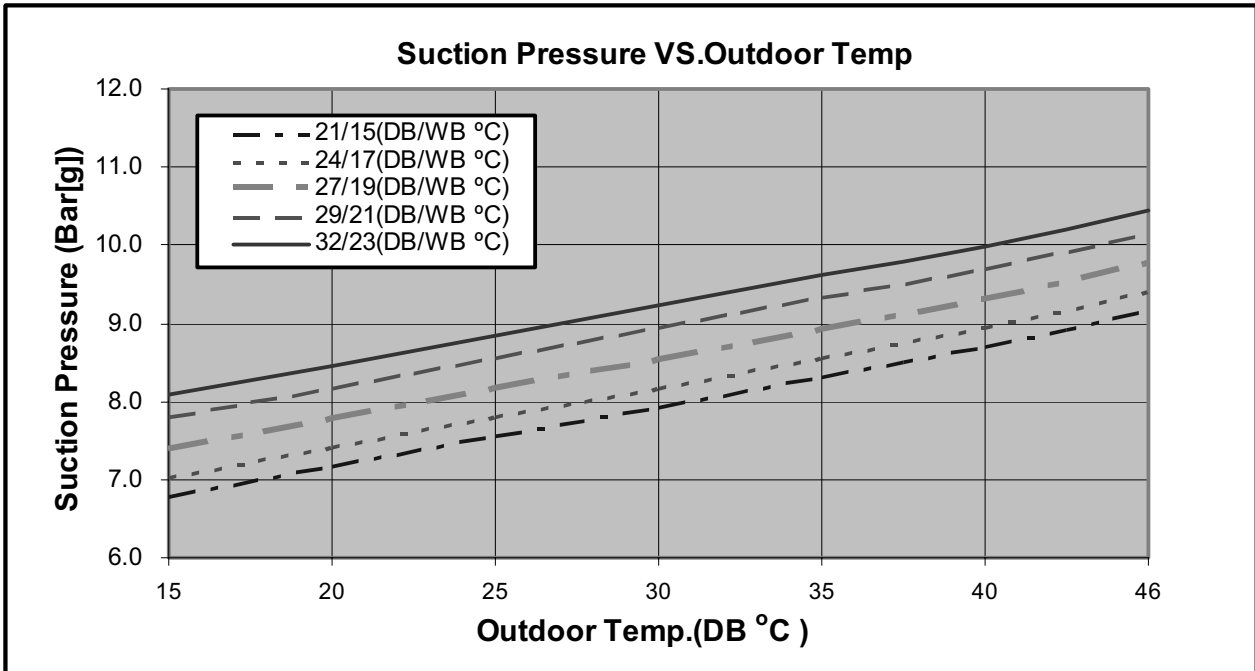


5.8.3 Heating.

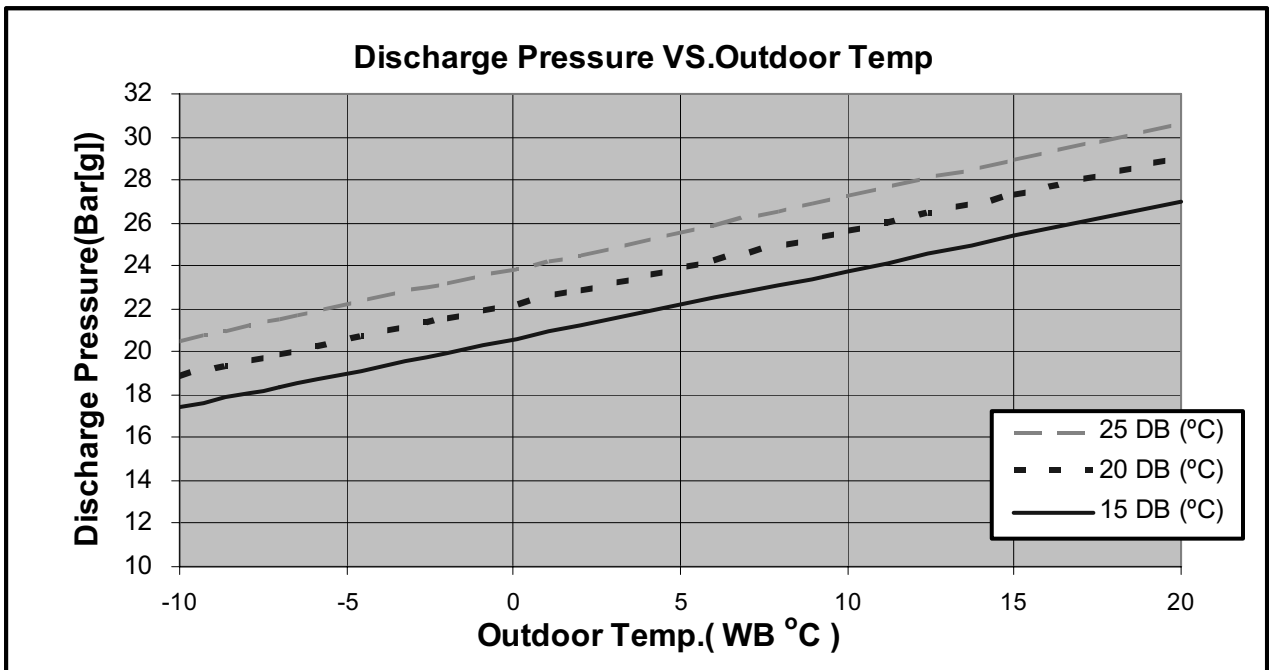
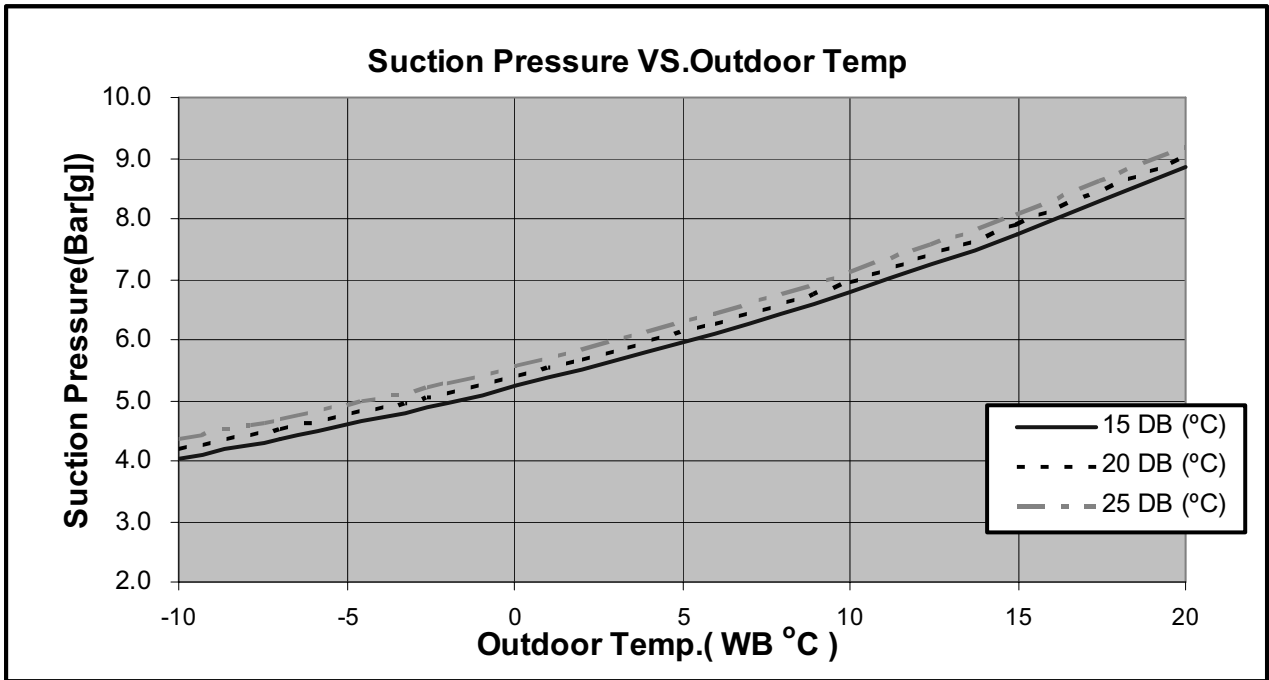


5.8.4 WNG 12

5.8.5 Cooling.

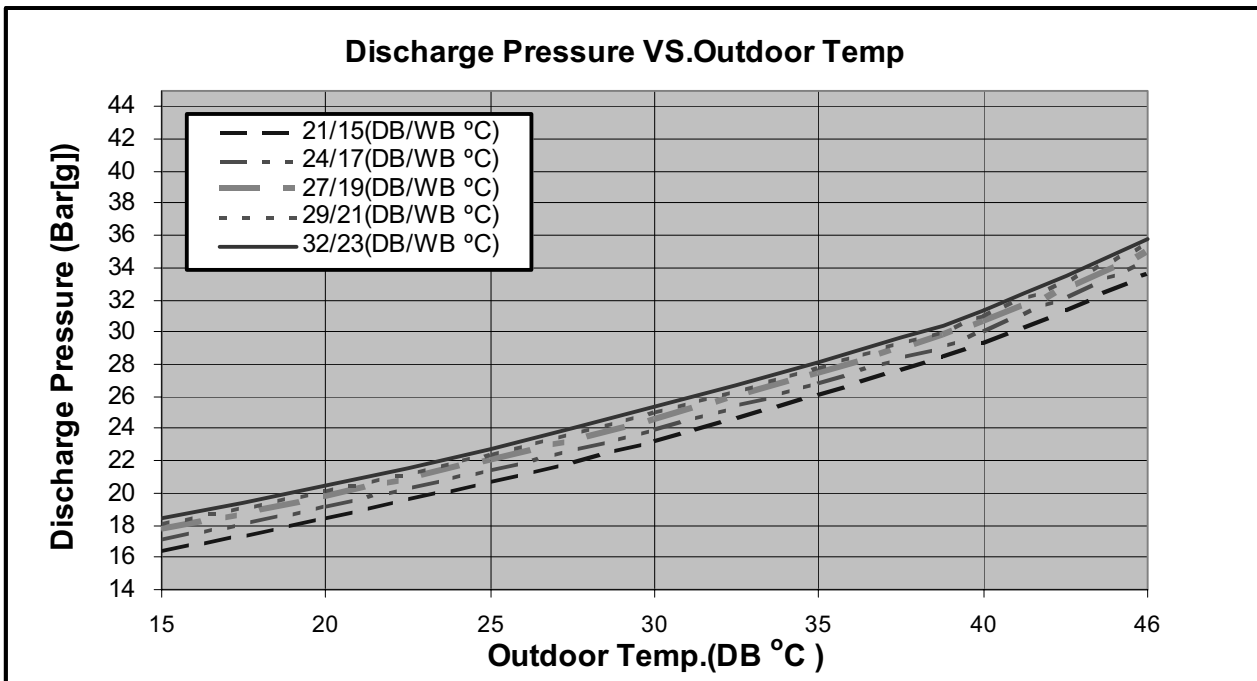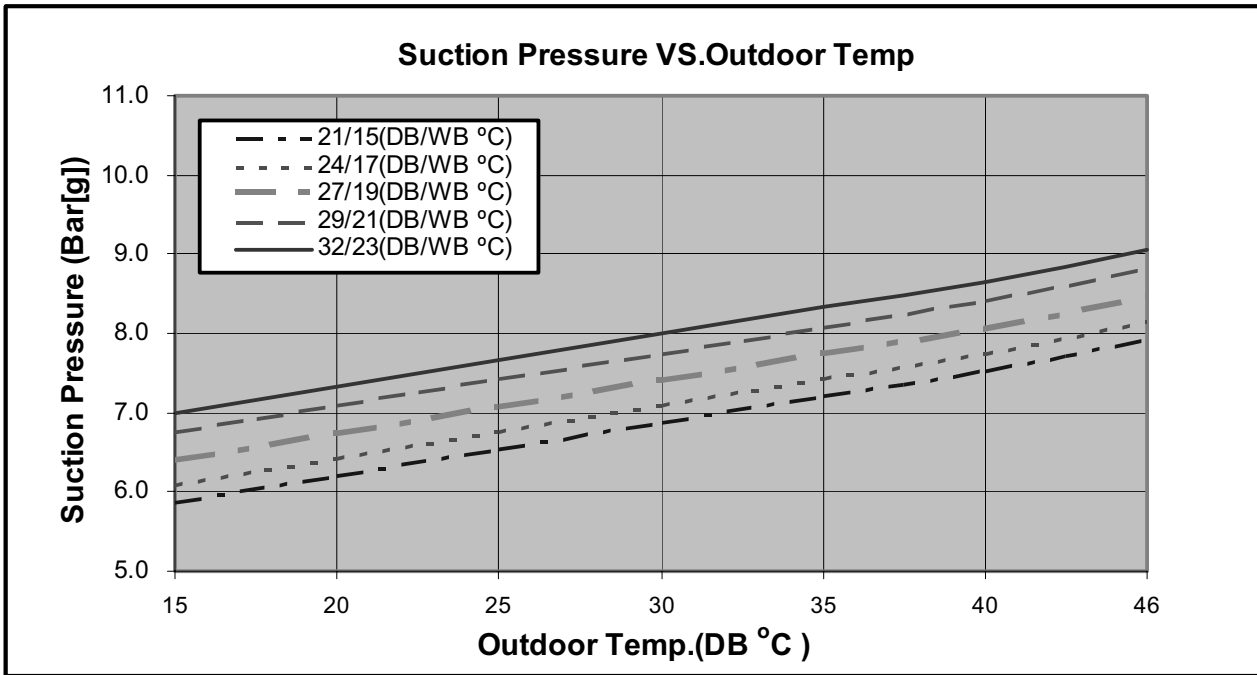

5.8.6 Heating.

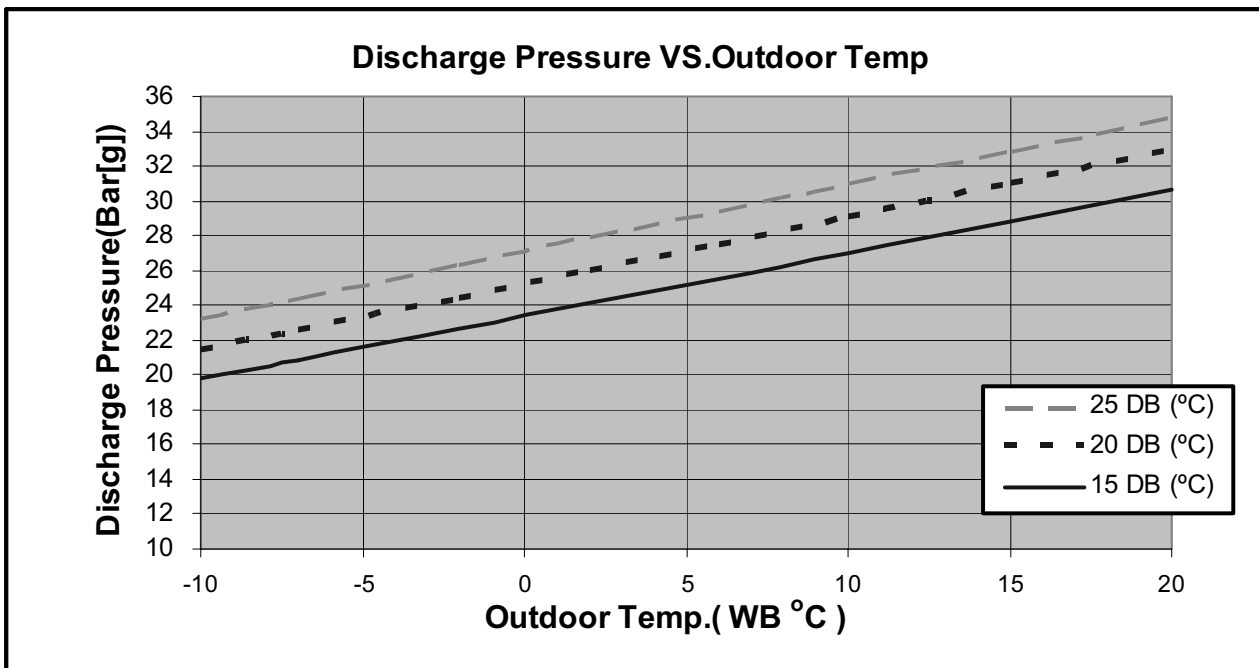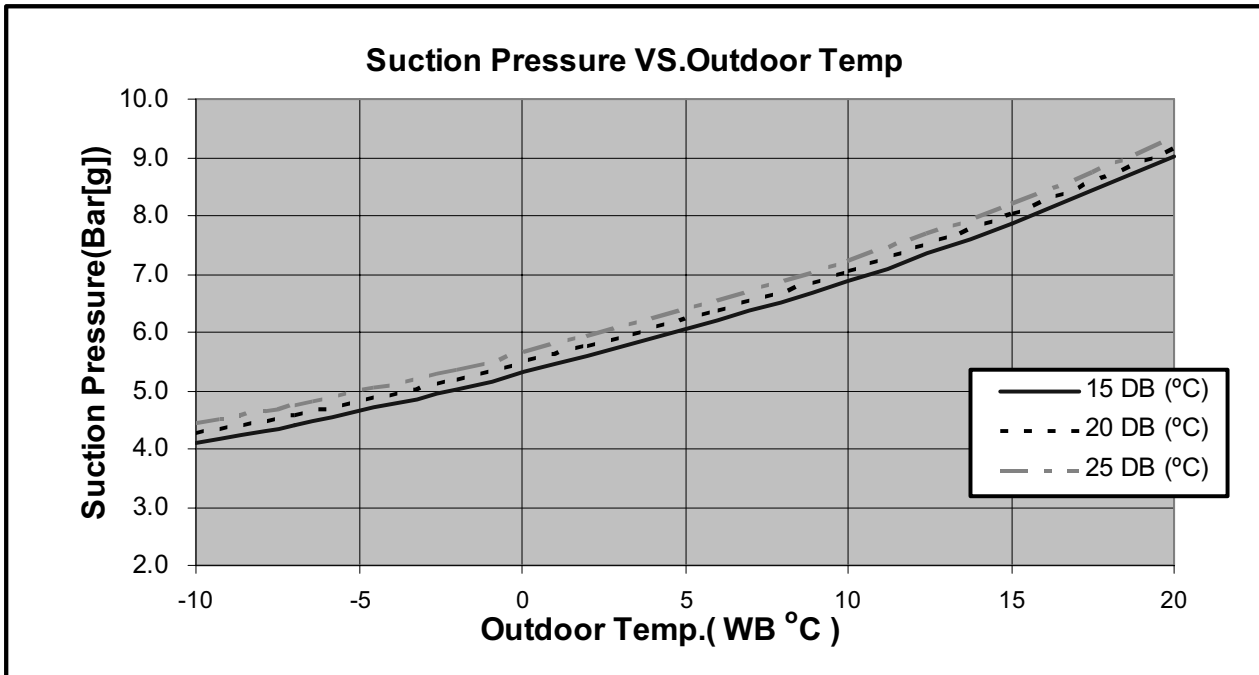

5.9 Capacity Correction Factor Due to Tubing Length

5.9.1 DUO (9+9),(9+12)

5.9.2 Cooling

TOTAL TUBING LENGTH								
3m	7.5m	10m	15m	20m	25m	30m	40m	50m
1.02	1	0.99	1	---	---	---	---	---

* Minimum recommended tubing length between indoor and outdoor units is 3m.

5.9.3 Heating

TOTAL TUBING LENGTH								
3m	7.5m	10m	15m	20m	25m	30m	40m	50m
1.02	1	0.92	0.85	---	---	---	---	---

* Minimum recommended tubing length between indoor and outdoor units is 3m.

6. SOUND LEVEL CHARACTERISTICS

6.1 Outdoor Units


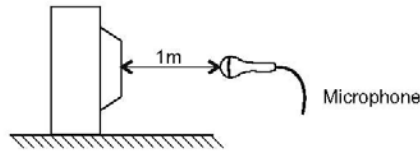



Fig.1
Microphone Distance from Unit

6.2 Sound Pressure Level Spectrum (Measured as Figure 1)


OU7- 0909 RC/ST Cooling

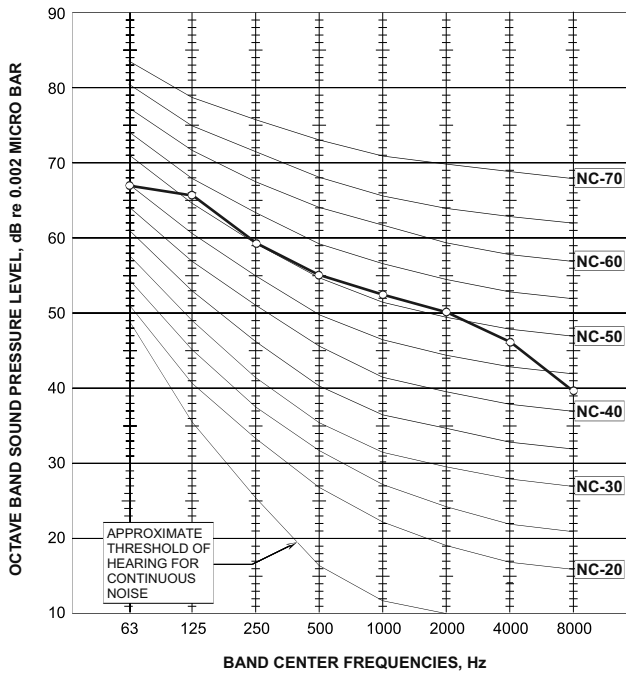


OU7-0909 RC/ST Heating

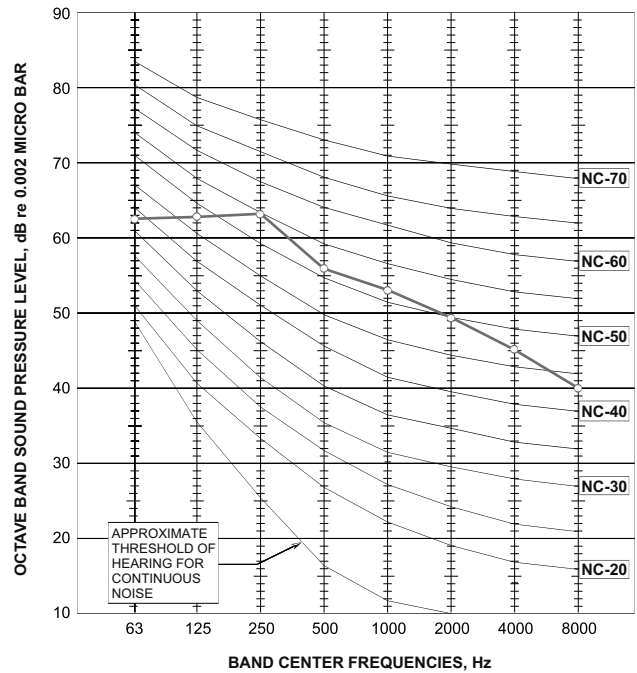

OU7-0912 RC/ST Cooling

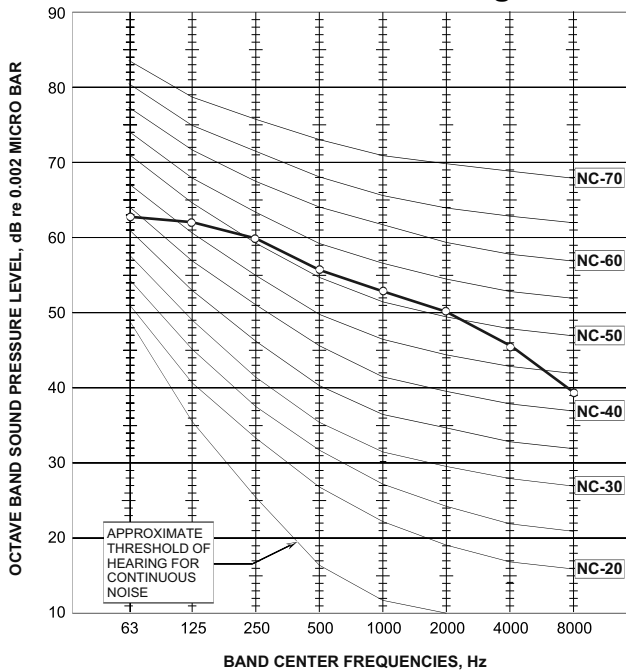

OU7-0912 RC/ST Heating

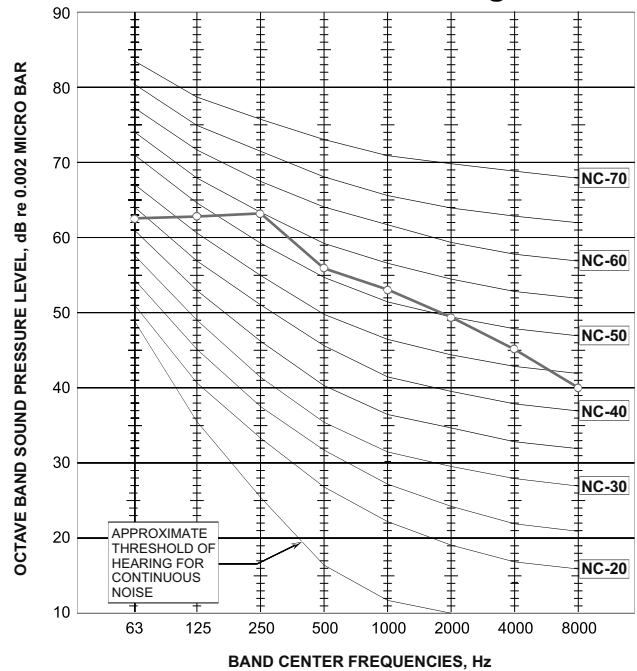

7. ELECTRICAL DATA

7.1 DUO (9+9), (9+12)


Power Supply	1 PH, 220-240 VAC, 50Hz
Connected to	Outdoor
Starting Current - 9/12	37.4/43
Circuit breaker	16 A
Power supply wiring - No. x cross section	3 X 2.5 mm ²
Interconnecting cable - No. x cross section	6 X 1.5 mm ² + 2 X 0.5 mm ² (OCT Sensor)

NOTE

Power wiring cord should comply with local laws and electrical regulations requirements.


8. WIRING DIAGRAMS

8.1 DUO (9+9), (9+12)

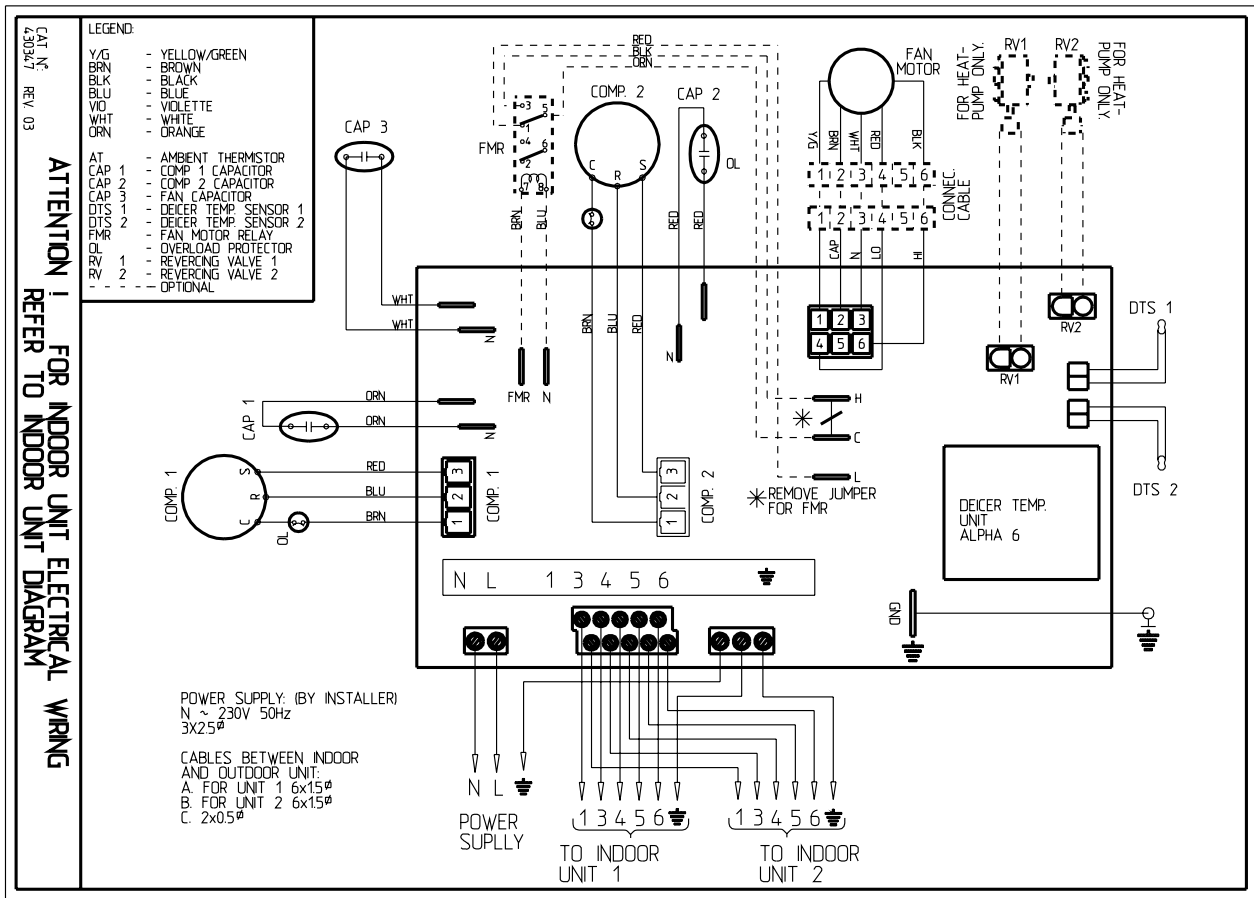

9. ELECTRICAL CONNECTIONS


9.1 DUO (9+9), (9+12)

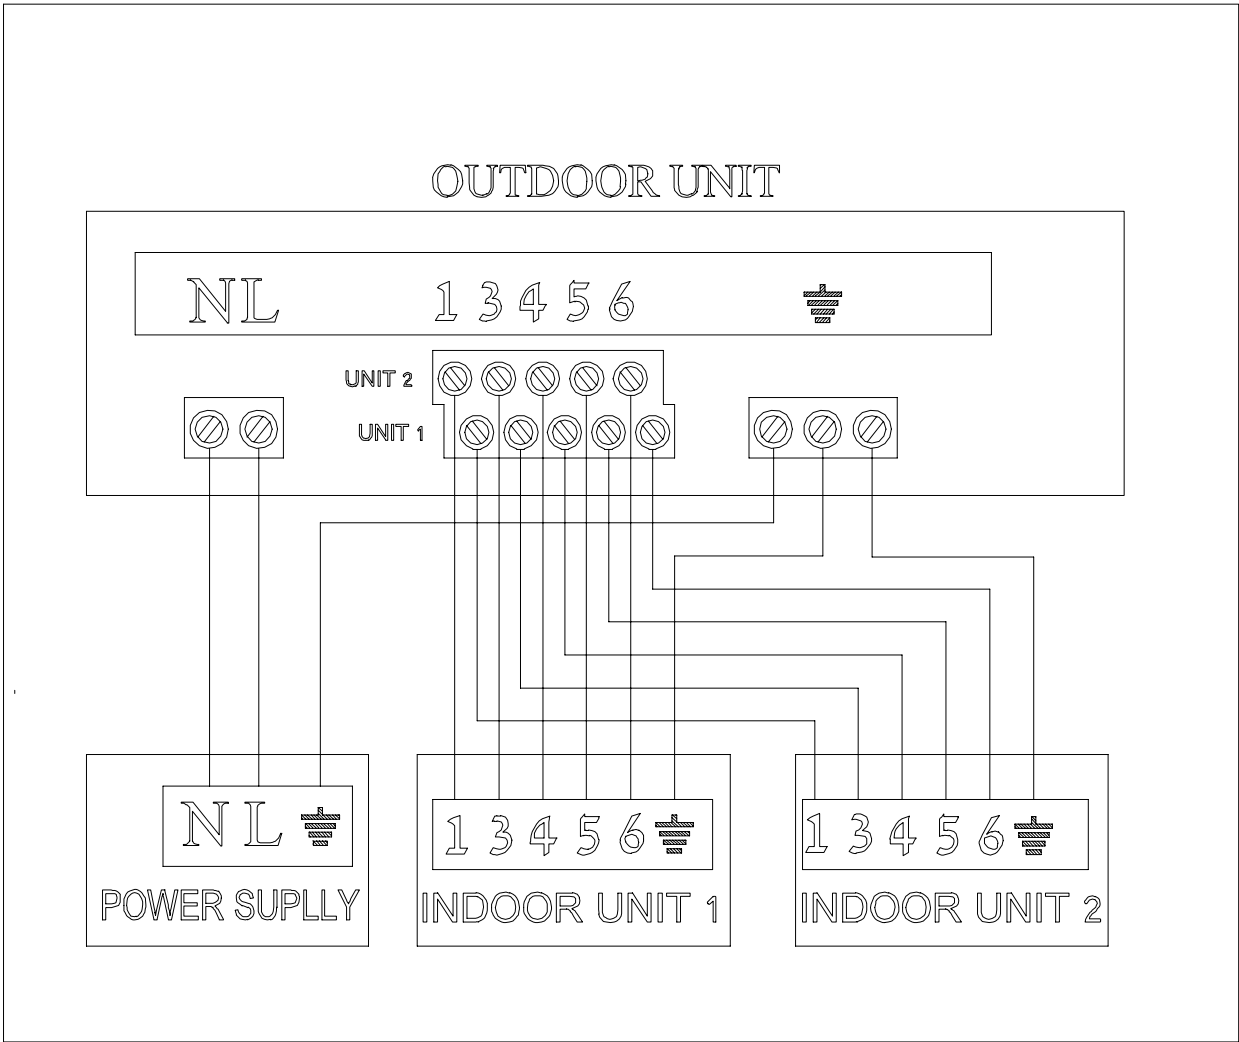


10. REFRIGERATION DIAGRAMS

10.1 DUO (9+9), (9+12)


10.1.1 Cooling Mode

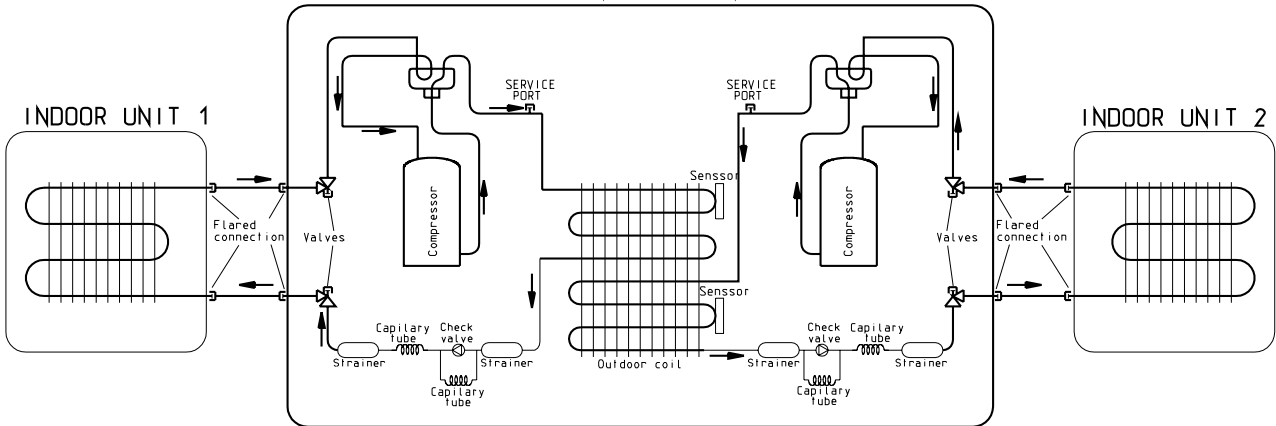



10.1.2 Heating Mode

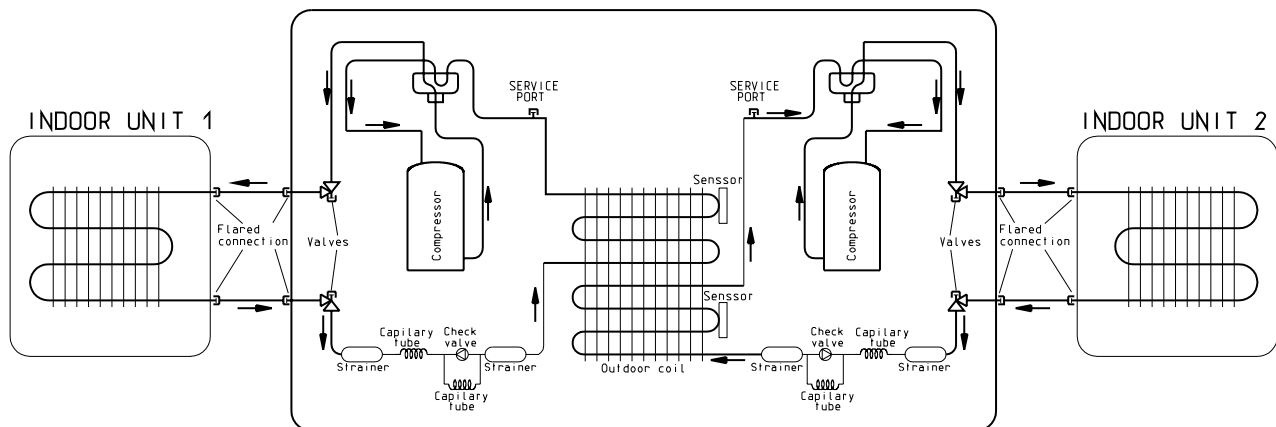

10.1.3 Cooling Only

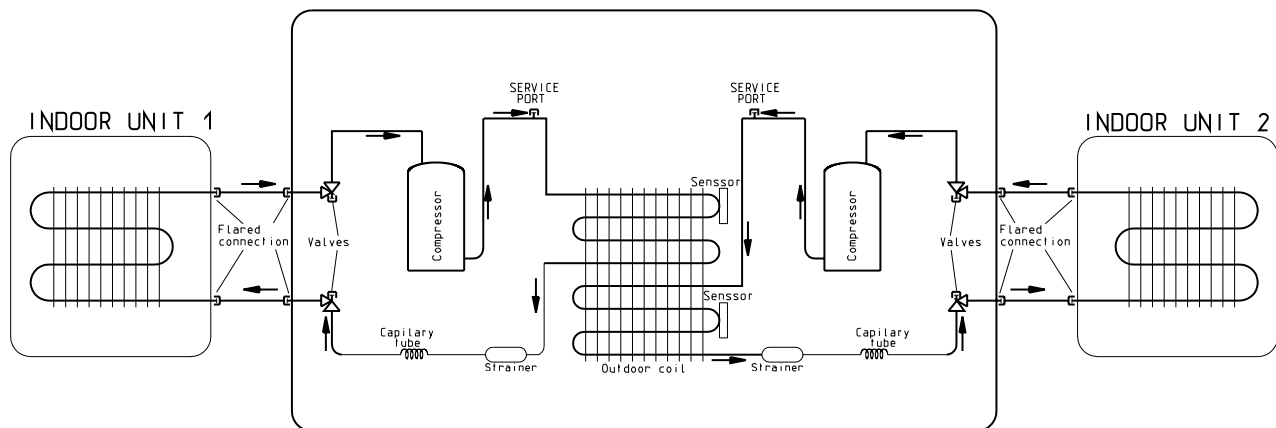


11. TUBING CONNECTIONS

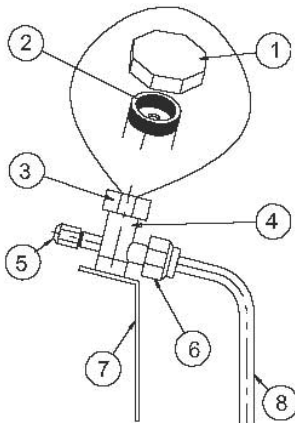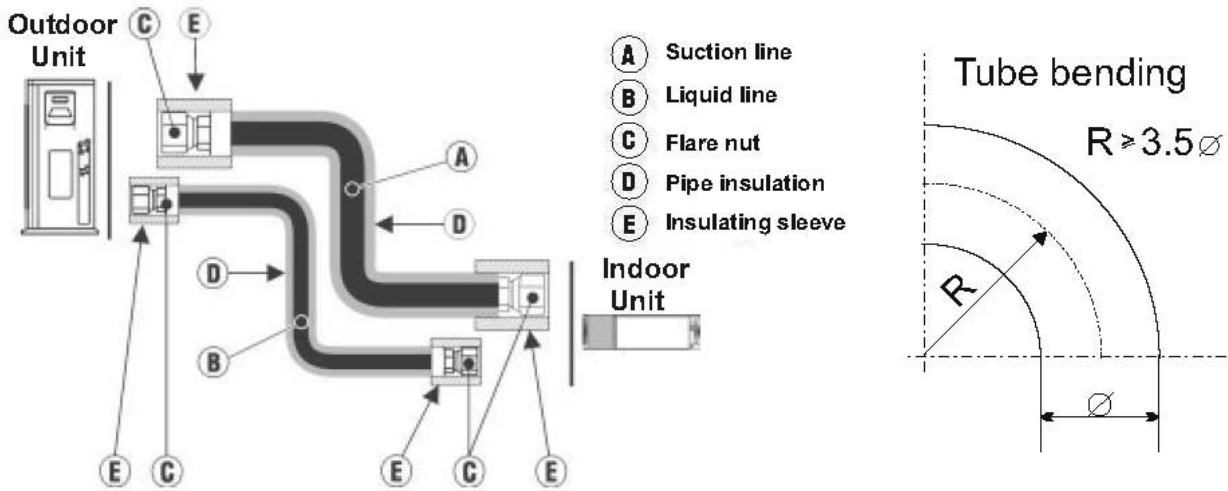

TUBE (Inch)	1/4"	3/8"	1/2"	5/8"	3/4"
TORQUE (Nm)					
Flare Nuts	11-13	40-45	60-65	70-75	80-85
Valve Cap	13-20	13-20	18-25	18-25	40-50
Service Port Cap	11-13	11-13	11-13	11-13	11-13

1. Valve Protection Cap-end
2. Refrigerant Valve Port (use Allen wrench to open/close)
3. Valve Protection Cap
4. Refrigerant Valve
5. Service Port Cap
6. Flare Nut
7. Unit Back Side
8. Copper Tube

When the outdoor unit is installed above the indoor unit an oil trap is required every 5m along the suction line at the lowest point of the riser. In case the indoor unit is installed above the outdoor, no trap is required.

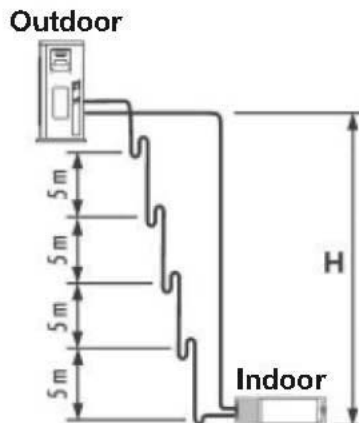

12. CONTROL SYSTEM

12.1 General

The control and logic system is managed by the indoor PCB controller with regards to all functions and protections excluding Deicing. The DUO OU7 R410A is equipped with stand -alone internal deicer integrated on the outdoor PCB (TYPHOON - 4A 6.2).


12.1.1 Deicing operation:

The outdoor coil temp ' is detected by 2 OCT sensors (outdoor coil temp') the deicing procedure will be activated if one of the sensors is sensing a temp' $\leq -6^{\circ}\text{C}$, and will stop when the outdoor coil will reach to 12°C or max 10 Min. once the deicing protection is activated it will include both units at the same time. Method of defrosting is by reversing the heat pump cycle to cooling mode, stopping the outdoor fan and keeping the comp' running, the unit will resume to its normal operation after the deicing procedure will be deactivated. Min deicing time is 2.5 Min.

12.1.2 Deicing intrval:

At first start up deicing will not be activated for the first 45 Min, and will go to STBY mode after every defrosting this timer will start a new cycle.

12.1.3 TYPHOON - 4A 6.2

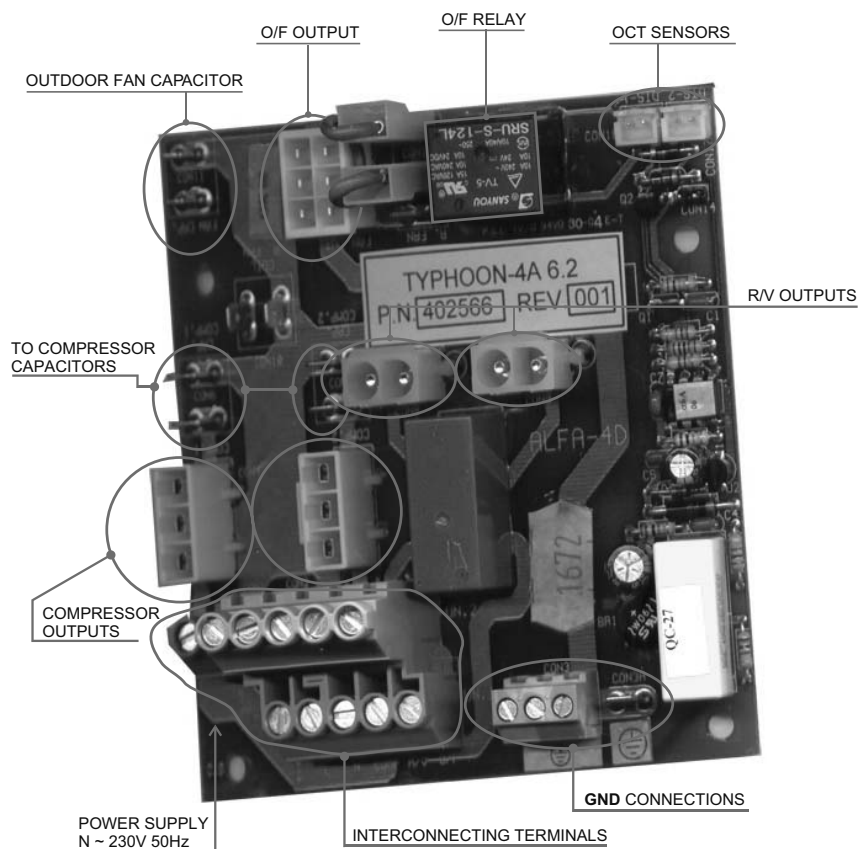

NOTE :

For further information please refer to the relevant indoor unit service manual.

13. TROUBLESHOOTING

ELECTRICAL & CONTROL TROUBLESHOOTING

ATTENTION : check for broken or loose cable lugs first.

NO	SYMPTON	PROBABLE CAUSE	CORRECTIVE ACTION
1.	The power supply indicator (red led) doesn't light up.	There is no correct voltage between the line and neutral terminals on main P.C.B.	-If the voltage is low repair power supply. -If there is no voltage repair general wiring. -If there is correct voltage replace main or display P.C.B'S
2.	The operating indicator (green led) does not light up.	The remote control batteries are discharged	-Replace batteries of the remote control
3.	The operating indicator (green led) does not light up when starting from unit..	Check main P.C.B and display P.C.B.	-Replace P.C.B if necessary.
4.	The indoor fan does not function correctly.	Check the voltage between indoor fan terminals on the main P.C.B	- If there is voltage replace capacitor or motor.
5.	The outdoor fan does not function correctly.	Check the voltage between indoor fan terminals on the main P.C.B. There is voltage between outdoor fan terminals on the outdoor unit. There is no voltage between outdoor fan terminals on the outdoor unit.	- If there is no voltage replace main P.C.B - Replace capacitor or motor. - Check and repair electrical wiring between indoor and outdoor units.
6.	The compressor does not start up.	Check voltage on compressor terminals on the outdoor unit. (with ampmeter) Check if there is correct voltage between compressor terminals on the outdoor unit.	-If no voltage replace main P.C.B. - If low voltage repair power supply. -If the voltage correct replace capacitor or compressor. -If there is no voltage repair electrical wiring between indoor and outdoor units.
7.	The refrigeration system does not function correctly.	Check for leaks or restrictions, with ampmeter, pressure guage or surface thermometer.	- Repair refrigeration system and charge refrigerant if necessary.
8.	No cooling or heating only indoor fan works.	Outdoor fan motor faulty or other fault caused, compressor overload protection cut out.	-Replace P.C.B. - Outdoor fan blocked remove obstructions.

TROUBLESHOOTING

ATTENTION : check for broken or loose cable lugs first

NO	SYMPTON	PROBABLE CAUSE	CORRECTIVE ACTION
9.	Only indoor fan and compressor working.	Outdoor fan blocked.	- Remove obstructions.
10.	Only indoor fan working.	-Run capacitor of outdoor fan motor faulty. -Windings of outdoor fan are shorted.	- Replace capacitor. -Replace motor.
11.	No cooling or heating takes place, indoor and outdoor fans working.	- Overload safety device on compressor is cut out (low voltage or high temperature) - Compressor run capacitor faulty. - Compressor windings are shorted.	- Check for proper voltage, switch off power and try again after one hour. - Replace compressor capacitor. - Replace compressor.
12.	No air supply at indoor unit, compressor operates.	-Indoor fan motor is blocked or turns slowly. -indoor fan run capacitor faulty. - motor windings are shorted.	- Check voltage,repair wiring if necessary. -Check fan wheel if it is tight enough on motor shaft,tighten if necessary. -Replace indoor fan motor.
13.	Partial, limited air supply at indoor indoor unit.	Lack of refrigerant (will accompanied by whisteling noise) cause ice formation on indoor unit coil in cooling mode.	-Charge the unit after localizing leak.
14.	Water accumulates and overflow from indoor unit section.	Drain tube or spout of drain pan clogged.	-Disassemble plastic drain tube from spout of indoor unit drain pan.
15.	Water dripping from outdoor unit base. (in heating mode)	Water drain outlet is clogged.	-Open outdoor unit cover clean out water outlet ,clean the base inside throughly.
16.	Freeze-up of outdoor coil in heating mode, poor heating effect in room, indoor fan operates.	-Faulty outdoor thermistor. -Faulty control cable. -Outdoor unit air outlet is blocked.	-Replace thermistor. -Repair control cable. -Remove obstructions.

A.C.E Marketing

FRANCE :

1 bis, Avenue du 8 Mai 1945
Saint-Quentin-en-Yvelines
78284 GUYANCOURT Cedex

Tél. 33 1 39 44 78 00

Fax 33 1 39 44 11 55

www.airwell.com

Airwell



With a concern for a constant improvement, our products can be modified without notice. Photos non contractual.

ACE

1 bis, Avenue du 8 Mai 1945
Saint-Quentin-en-Yvelines
78284 GUYANCOURT Cedex

