Airwell

Service Manual

PNX DCI Nordic

Indoor Units	Outdoor Units
PNX009 DCI	GC 9 DCI Nordic
PNX012 DCI	GC 12 DCI Nordic





REFRIGERANT

R410A

HEAT PUMP

SEPTEMBER - 2009

LIST OF EFFECTIVE PAGES

Note: Changes in the pages are indicated by a "Revision#" in the footer of each effected page (when none indicates no changes in the relevant page). All pages in the following list represent effected/ non effected pages divided by chapters.

Dates of issue for original and changed pages are:

Original 0September 2009

Total number of pages in this publication is 50 consisting of the following:

Page	Revision	Page	Revision	Page	Revision
No.	No. #	No.	No. #	No.	No. #

• Zero in this column indicates an original page.

A SM PNXDCI 1-A.1 GB

^{*}Due to constant improvements please note that the data on this service manual can be modified with out notice.

^{**}Photos are not contractual



Table of Contents

1.	INTRODUCTION	1-1
2.	PRODUCT DATA SHEET	2-1
3.	RATING CONDITIONS	3-1
4.	OUTLINE DIMENSIONS	4-1
5.	PERFORMANCE DATA & PRESSURE CURVES	5-1
6.	SOUND LEVEL CHARACTERISTICS	6-1
7.	ELECTRICAL DATA	7-1
8.	WIRING DIAGRAMS	8-1
9.	REFRIGERATION DIAGRAMS	9-1
10.	TUBING CONNECTIONS	10-1
11.	CONTROL SYSTEM	11-1
12.	TROUBLESHOOTING	12-1
13.	EXPLODED VIEWS AND SPARE PARTS LISTS	13-1
11	ΑΡΡΕΝΟΙΥ Δ	14-4

1. INTRODUCTION

1.1 General

The new **PNX DCI INVERTER** split wall mounted range has expanded, comprising the following RC (heat pump) models:

- PNX009
- PNX012

The indoor **PNX DCI** units are available as LED display types, featuring esthetic design, compact dimensions, and low noise operation.

1.2 Main Features

The **PNX DCI** series benefits from the most advanced technological innovations, namely:

- DC inverter technology.
- R410A.
- High COP.
- · Lego concept.
- Pre-Charged units up to the max' allowing tubing distance.
- · Networking system connectivity.
- A dry contact for clock or power shedding functions (configurable).
- Base heater connection.
- Cooling operation at outdoor temperature down to -10°C.
- Heating operation at outdoor temperature down to -15°C.
- Supports Indoor Air Quality features, such as Ionizer and Active Electrostatic Filter.
- Indoor large diameter cross flow fan, allowing low noise level operation.
- Bended indoor coil with treated aluminum fins and coating for improved efficiency.
- Easy access to the interconnecting tubing and wiring connections, so that removing the front grill or casing is not necessary.
- Refrigerant pipes can be connected to the indoor unit from 5 different optional directions.
- Water condensate tray is equipped with two optional drain connections
- Automatic treated air sweep.
- Low indoor and outdoor noise levels.
- Easy installation and service.

SM PNXDCI 1-A.1 GB

1.3 Indoor Unit

The indoor unit is wall mounted, and can be easily fitted to many types of residential and commercials applications.

New design is available in LED version.

Indoor Unit features:

Feature	PNX009	PNX012		
Display	LE	:D		
lonizer	YE	ES		
ESF	YE	ES .		
Fresh air	Optional			
Indoor fan motor	Variable speed (PG)			
Horizontal motorized louver	YES			
Vertical motorized louver	Optional			
Heating element	NO			
M2L Cable port	YES			
Dry contact	Presence detector or (jumpe	er selected) power shedding		

1.4 Filtration

The **PNX DCI INV** series presents several types of air filters:

- Easily accessible, and re-usable pre-filters (mesh)
- Pre-charged electrostatic filter (disposable)
- Active carbon filter (disposable)
- ESF. Active Electro Static re-usable filter (optional)

1.5 Ionizer (Optional)

A special design lonizer protected by unique patents integrated into the indoor unit, generating negative ions to the room providing comfort and upgraded indoor air quality.

1.6 Control

The microprocessor indoor controller, and an infrared remote control, supplied as standard, provides complete operating function and programming.

Remote controllers: RC-2/3/4/5/7, RC-4i-1, RCW, µBMS.

Networking system Airconet version 4.2 and up, MIU SW version H8 and up.

For further details please refer to the Operational Manual.

1-2 SM PNXDCI 1-A.1 GB

1.7 Outdoor Unit

The **PNX DCI INV** outdoor units can be installed as floor or wall mounted units by using a wall supporting bracket. The metal sheets are protected from corrosion paint work allowing long life resistance. All outdoor units are pre-charged. For further information please refer to the Product Data Sheet, Chapter 2.

- GC 9 DCI Nordic
- GC 12 DCI Nordic

Outdoor Unit Feature

Feature	GC 9 DCI Nordic GC 12 DCI Nordic			
Display	3 LED's			
Base Heater	Optional			
Outdoor Fan	Variable speed DC Inverter			
M2L cable Port	No			

1.8 Tubing Connections

Flare type interconnecting tubing to be produced on site. For further details please refer to the Installation Manual.

1.9 Accessories


Item	Description
MIU (PNX)	MODBUS interface unit
RS485 Adapter	To be used as an interface with RCW or µBMS remote controllers
M2L cable Port	

1.10 Inbox Documentation

Each unit is supplied with its own installation and operation manuals.

1.11 Matching Table

1.11.1 R410A

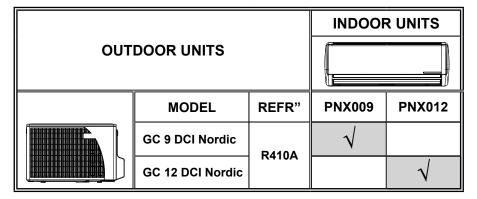

The above tables lists outdoor units and **PNX** indoor units which can be matched together. For further information please refer to the relevant Service Manual.

SM PNXDCI 1-A.1 GB



PRODUCT DATA SHEET 2.

2.1 PNX009 / GC 9 DCI Nordic

Model	:		PNX009 DCI / G	C 9 DCI Nordic		
Item				Cooling	Heating	
	Btu/hr			8530 (3750-122800)	11600 (5290-17060)	
Capacity			Kcal/hr	2150(950-3100)	2920(1330-4300)	
	·			2500 (1100-3600)	3400 (1550-5000)	
Total Innu	t (Cooling / Heating)		W	600 (350-1000)	830 (350-1500)	
	oling) / C.O.P(Heating)		W/W	4.10	4.05	
Running (Current(Cooling/Heating	1)	A	2.7	3.7	
Starting C		1/	A		.50	
	pply (ph, cy, voltage)		, ,,	-	0HZ 220-240V	
Dehumidif			L/h		.0	
	External finish		•	High	Polish	
	Ionizer				otional)	
	Electrostatic Filter dB((A)			otional)	
	Heat exchanger	· · ·			ouver fin coil	
	Fan (drive)			Crossf	low * 1	
INDOOR UNIT	Fan motor output		W	2	0	
5	Airflow (Hi-Me-Lo)		m 3/hr	530-430-330	570-460-350	
OR	Operation control type				control	
ŏ	Noise level(Lo-Hi)	Pressure ⁽⁴⁾	dB(A)	26-38	26-39	
	INDISC IEVEI(LO-I II)	Power	UD(A)	39-50	39-51	
_	Condensate drain I.D.		mm(in)	,	5/8)	
	Dimensions	W*D*H		810*202*285		
	Weight			kg 11		
	Packing dimensions	W*D*H	mm	885*285*360		
	Unit stacking		units	7		
	Refrigerant control				pansion Valve	
	Compressor type				Inverter	
	Compressor Model			Matsushita 50	CS102XDA04	
	Starter type			-		
-	Protection device			Outdoor S	SW control	
Ē	Heat exchanger Hydro	ophilic louver fin				
∩ ~	Fan (drive)* No.		1 101	Propeller * 1		
Ö	Motor output		W	50 1780		
OUTDOOR UNIT	Airflow		m3/h	17	80	
5	Defrost method Rever	Pressure ⁽⁴⁾	1	49	49	
ō	Noise level	Power	dB(A)	59	59	
	Dimensions	W*D*H	mm		90*610	
	Weight	ן עע ט וו	kg.		8	
	Packing dimensions	W*D*H	1			
	Packing dimensions W*D*H mm. Unit stacking units			945*395*655		
	Refrigerant		3 R410A			
	Charge(20m connection	on tube)		1100		
	Fresh Air	on tube)	l g	No		
ල			mm(in)		35	
Z	Tube size O.D.	suction	mm(in)		53	
TUBING		indoor & outdoor			red	
-	Connection method	height difference	m			
	between the indoor tubing length		m	Max. 10m Max. 20m		
	and outdoor unit additional charge			No need		
		I additional orlange	1101			

⁽¹⁾ Rating conditions in accordance with ISO 5151 and ISO 13253 (for ducted units) and EN 14511.(2) Airflow in ducted units; at nominal external static pressure.

SM PNXDCI 1-A.1 GB 2-1

⁽³⁾ Sound power in ducted units is measured at air discharge.(4) Sound pressure level measured at 1 meter distance from unit.

2.2 PNX012 / GC 12 DCI Nordic

Model				PNX012 DCI / G	C 12 DCI Nordic	
Item			Cooling	Heating		
Btu/hr			Btu/hr	11940(3750-14670)	14500(5290-18770)	
Capacity	Capacity			3010(950-3700)	3610(1330-4730)	
Capacity				3500 (1100-4300)	4200(1550-5500)	
Total Inpu	t (Cooling / Heating)		W	0.97 (350-1400)	1140(310-1750)	
E.E.R(Co	oling) / C.O.P(Heating)		W/W	3.60	3.65	
	Current(Cooling/Heating)	A	4.3	5.1	
Starting C	Current	/	A		.50	
Power Su	pply (ph, cy, voltage)				0HZ 220-240V	
Dehumidi	fication		L/h		.5	
	External finish		•	High	Polish	
	Ionizer			Yes(O	ptional)	
	Electrostatic Filter			Yes(O	otional)	
	Heat exchanger			Hydrophilic	ouver fin coil	
∥ .	Fan (drive)			Crossi	low * 1	
I ≡	Fan motor output		W	2	20	
5	Airflow (Hi-Me-Lo)		m3/hr	550-450-350	580-480-370	
X	Operation control type			Remote	control	
∥ ŏ	Noise level(Lo-Hi)	Pressure ⁽⁴⁾	dB(A)	26-39	26-40	
INDOOR UNIT		Power	UB(A)	39-52	39-52	
-	Condensate drain I.D.		mm(in)		5/8)	
	Dimensions	W*D*H			02*285	
	Weight			kg 11		
	Packing dimensions	W*D*H	mm	885*285*360		
	Unit stacking		units	7		
	Refrigerant control	_			xpansion Valve	
	Compressor type				C Inverter	
	Compressor Model			Matsushita 5	CS102XDA04	
	Starter type					
⊢	Protection device			Outdoor 9	SW control	
ĮΞ	Heat exchanger Hydro	philic louver fin				
∥ ⊋	Fan (drive)* No.			Propeller * 1		
l è	Motor output		W	40		
OUTDOOR UNIT	Airflow		m3/h	1780		
5	Defrost method Rever	se cycle				
∥ō	Noise level	Pressure ⁽⁴⁾	dB(A)	50	50	
	Dimensions	Power W*D*H		60	60	
	Dimensions Weight	וא ט ח	mm		90*610 88	
	Packing dimensions	W*D*H	kg.		95*655	
	Unit stacking	ווטאאן	mm. units		3	
	Refrigerant		uiiis		10A	
	Charge(20m connection	on tube)	g		00	
	Fresh Air				lo	
	- i liquid		mm(in)			
5	Tube size O.D.			6.35		
TUBING	suction		mm(in)	9.53		
∥ 2	Connection method	indoor & outdoor		Fla	red	
	between the indoor	height difference	m	Max	Max. 10m	
	and outdoor unit	tubing length				
	additonal charge		m Max. 20m			
	1 0	Additional charge	-	No i	need	

⁽¹⁾ Rating conditions in accordance with ISO 5151 and ISO 13253 (for ducted units) and EN 14511.

2-2 SM PNXDCI 1-A.1 GB

⁽²⁾ Airflow in ducted units; at nominal external static pressure.

⁽³⁾ Sound power in ducted units is measured at air discharge.

⁽⁴⁾ Sound pressure level measured at 1 meter distance from unit.



3. RATING CONDITIONS

Rating conditions in accordance with ISO 5151 and ISO 13253 (for ducted units).

Cooling:

Indoor: 27°C DB 19°C WB

Outdoor: 35 °C DB

Heating:

Indoor: 20°C DB

Outdoor: 7°C DB 6°C WB

3.1 Operating Limits


3.1.1 R410A

		Indoor	Outdoor	
Cooling	Upper limit	32°C DB 23°C WB	46°C DB	
Cooling Lower limit		21°C DB 15°C WB	-10°C DB	
Llooting	Upper limit	27°C DB	24°C DB 18°C WB	
Heating	Lower limit	10°C DB	-15°C DB -16°C WB	
Ve	oltage	198 – 264 V		


SM PNXDCI 1-A.1 GB 3-1

4. OUTLINE DIMENSIONS

4.1 Indoor Unit: PNX009 / PNX012 DCI

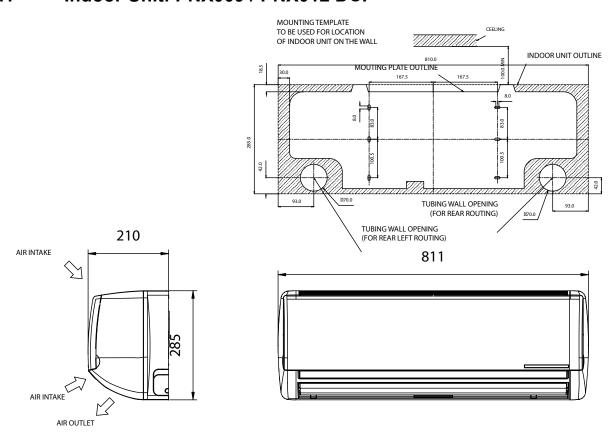

4.2 Outdoor Unit: GC 9 DCI Nordic / GC 12 DCI Nordic

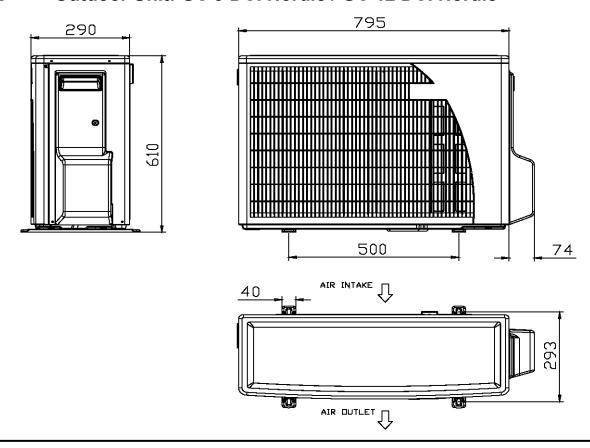

SM PNXDCI 1-A.1 GB 4-1



5. PERFORMANCE DATA

5.1 PNX009 / GC 9 DCI Nordicl

5.1.1 Cooling Capacity (kW) - Run Mode

		ID COIL ENTERING AIR DB/WB TEMPERATURE [°C]				
OD COIL ENTERING AIR DB TEMPERATURE [°C]	DATA	22/15	24/17	27/19	29/21	32/23
-10 - 20	TC		80 -	110 % of nor	ninal	
(protection range)	SC		80 -	105 % of nor	minal	
(protection range)	PI		25 -	50 % of nom	ninal	
	TC	2.46	2.61	2.75	2.90	3.04
25	SC	1.71	1.74	1.76	1.79	1.81
	PI	0.47	0.48	0.49	0.50	0.51
	TC	2.34	2.48	2.63	2.77	2.92
30	SC	1.65	1.67	1.70	1072	1.75
	PI	0.53	0.54	0.55	0.57	0.58
	TC	2.21	2.36	2.50	2.65	2.79
35	SC	1.58	1.60	1.63	1.66	1.68
	PI	0.60	0.61	0.62	0.63	0.64
	TC	2.08	2.23	2.37	2.52	2.66
40	SC	1.51	1.54	1.56	1.59	1.61
	PI	0.66	0.67	0.69	0.70	0.71
46	TC	1.93	2.08	2.22	2.37	2.51
	SC	1.43	1.46	1.48	1.51	1.53
	PI	0.74	0.75	0.76	0.77	0.78

LEGEND

TC - Total Cooling Capacity, kW

SC - Sensible Capacity, kW


PI - Power Input, kW

WB - Wet Bulb Temp., (°C)

DB - Dry Bulb Temp., (°C)

ID – Indoor OD – Outdoor

5.1.2 Capacity Correction Factors

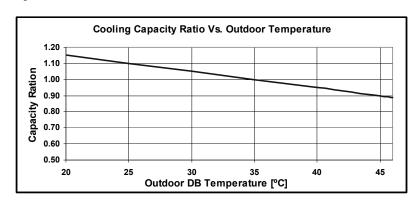

SM PNXDCI 1-A.1 GB 5-1



5.1.3 Heating Capacity (kW) - Run Mode)

		ID COIL ENTERING AIR DB TEMPERATURE [°C]			
OD COIL ENTERING AIR DB/WB TEMPERATURE [°C]	DATA	15	20	25	
-15/-16	TC	1.55	1.32	1.10	
-15/-16	PI	0.58	0.62	0.66	
-10/-12	TC	2.04	1.82	1.60	
-10/-12	PI	0.66	0.70	0.74	
-7/-8	TC	2.41	2.19	1.97	
-11-0	PI	0.71	0.75	0.80	
-1/-2	TC	2.60	2.38	2.15	
- 1/-2	PI	0.74	0.78	0.82	
2/1	TC	2.72	2.50	2.28	
2/1	PI	0.76	0.80	0.84	
7/0	TC	3.62	3.40	3.18	
7/6	PI	0.79	0.83	0.87	
40/0	TC	3.81	3.59	3.36	
10/9	PI	0.80	0.86	0.89	
45/40	TC	4.00	3.78	3.55	
15/12	PI	0.82	0.86	0.90	
15-24	TC	85 - 105 % of nominal			
(Protection Range)	PI	80 - 120 % of nominal			

LEGEND

TC - Total Heating Capacity, kW


PI – Power Input, kW

WB - Wet Bulb Temp., (°C)

DB - Dry Bulb Temp., (°C)

ID – Indoor OD – Outdoor


5.1.4 Capacity Correction Factors

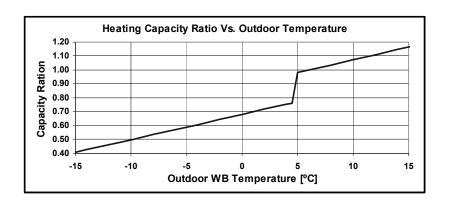


5-2 SM PNXDCI 1-A.1 GB

5.2 Capacity Correction Factor Due to Tubing Length

5.2.1 Cooling

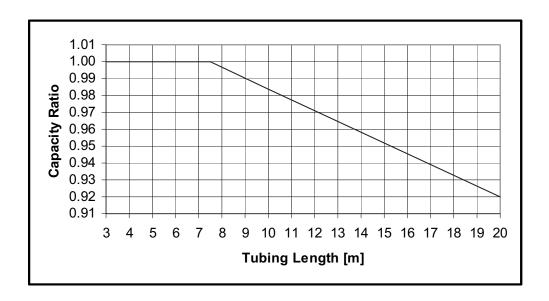

5.2.2 Heating

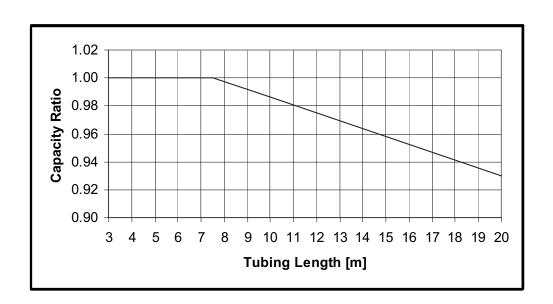

SM PNXDCI 1-A.1 GB 5-3



5.3 PNX012 / GC 12 DCI Nordic

5.3.1 Cooling Capacity (kW) - Run Mode

		ID COIL ENTERING AIR DB/WB TEMPERATURE [°C]				
OD COIL ENTERING AIR DB TEMPERATURE [°C]	DATA	22/15	24/17	27/19	29/21	32/23
-10 - 20	TC		80 -	110 % of nor	minal	
(protection range)	SC		80 -	105 % of nor	minal	
(protection range)	PI		25 -	50 % of nom	ninal	
	TC	3.45	3.65	3.85	4.06	4.26
25	SC	2.50	2.54	2.58	2.61	2.65
	PI	0.79	0.80	0.82	0.84	0.66
	TC	3.27	3.47	3.68	3.88	4.08
30	SC	2.40	2.44	2.48	2.51	2.55
	PI	0.90	0.91	0.93	0.95	0.97
	TC	3.09	3.30	3.50	3.70	3.91
35	SC	2.31	2.34	2.38	2.42	2.45
	PI	1.00	1.02	1.04	1.06	1.08
	TC	2.92	3.12	3.32	3.53	3.73
40	SC	2.21	2.25	2.28	2.32	2.36
	PI	1.11	1.13	1.15	1.17	1.18
	TC	2.71	2.91	3.11	3.31	3.52
46	SC	2.09	2.13	2.17	2.20	2.24
	PI	1.24	1.26	1.28	1.30	1.32

LEGEND

TC - Total Cooling Capacity, kW

SC - Sensible Capacity, kW


PI - Power Input, kW

WB - Wet Bulb Temp., (°C)

DB - Dry Bulb Temp., (°C)

ID – Indoor OD – Outdoor

5.3.2 Capacity Correction Factors

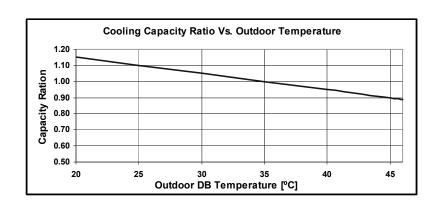

5-4 SM PNXDCI 1-A.1 GB



5.3.3 Heating Capacity (kW) - Run Mode

		ID COIL ENTERING AIR DB TEMPERATURE [°C]			
OD COIL ENTERING AIR DB/WB TEMPERATURE [°C]	DATA	15	20	25	
-15/-16	TC	1.91	1.64	1.36	
-13/-10	PI	0.80	0.85	0.91	
-10/-12	TC	2.52	2.25	1.974	
-10/-12	PI	0.90	0.96	1.02	
-7/-8	TC	2.98	2.71	2.43	
-11-0	PI	0.98	1.04	1.09	
-1/-2	TC	3.21	2.94	2.66	
-1/-2	PI	1.02	1.08	1.13	
2/4	TC	3.36	3.09	2.81	
2/1	PI	1.04	1.10	1.16	
7/6	TC	4.48	4.20	3.92	
7/6	PI	1.08	1.14	1.20	
40/0	TC	4.71	4.43	4.16	
10/9	PI	1.10	1.16	1.22	
45/40	TC	4.94	4.66	4.39	
15/12	PI	1.12	1.18	1.24	
15-24	TC	8	35 - 105 % of nomina	al	
(Protection Range)	PI	80 - 120 % of nominal			

LEGEND

TC - Total Cooling Capacity, kW

SC - Sensible Capacity, kW


PI – Power Input, kW

WB - Wet Bulb Temp., (°C)

DB - Dry Bulb Temp., (°C)

ID – Indoor OD – Outdoor

5.3.4 Capacity Correction Factors

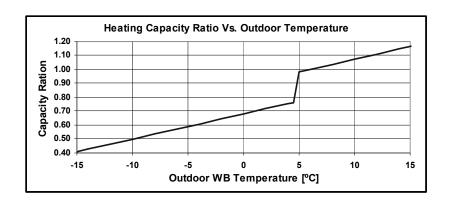


SM PNXDCI 1-A.1 GB 5-5




5.4 Capacity Correction Factor Due to TUbing Length

5.4.1 Cooling

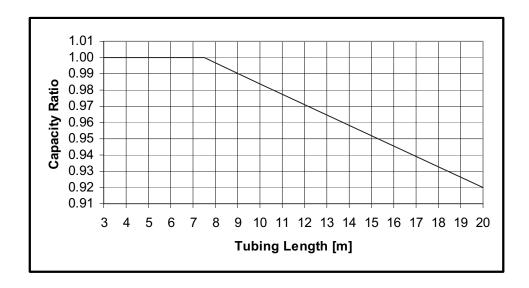

5.4.2 Heating

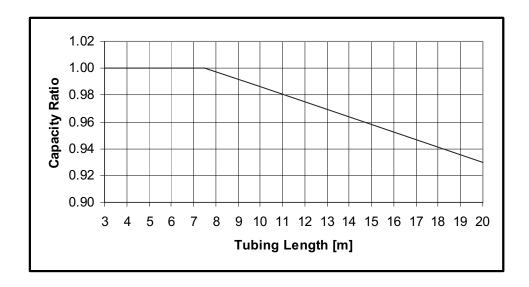


5-6 SM PNXDCI 1-A.1 GB




5.5 Pressure Curves

5.5.1. Model: PNX009 / GC 9 DCI Nordic

Cooling - Test Mode

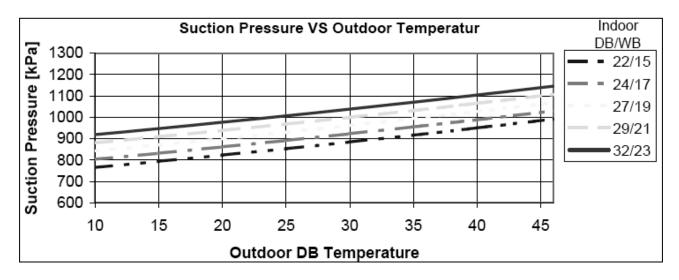


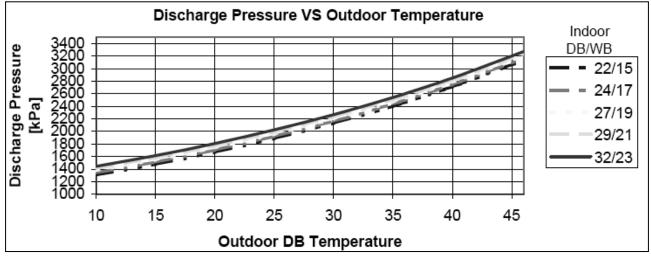


SM PNXDCI 1-A.1 GB 5-7



5.5.2 Cooling - Test Mode

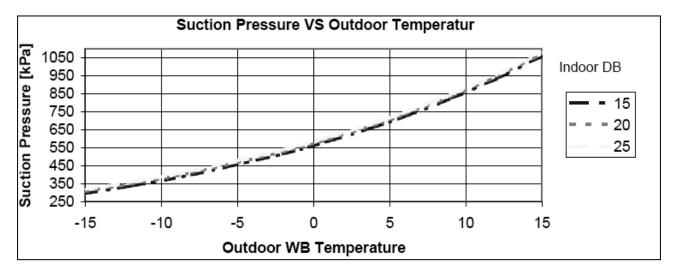

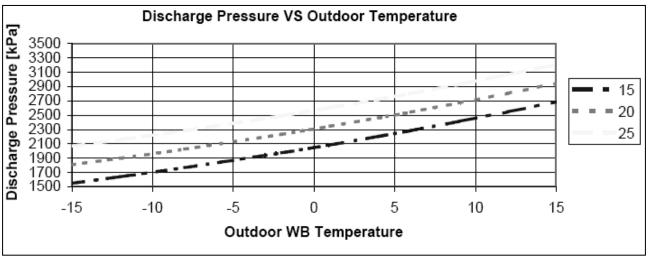


5-8 SM PNXDCI 1-A.1 GB




5.6 Pressure Curves

5.6.1. Model: PNX012 / GC 12 DCI Nordic

Cooling - Test Mode

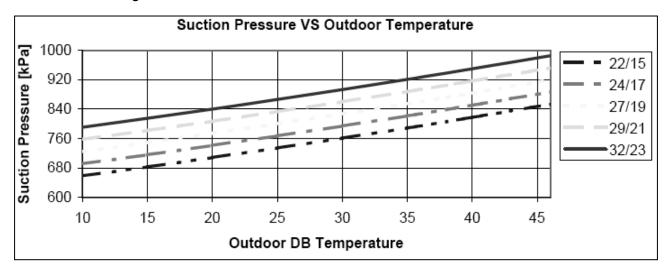


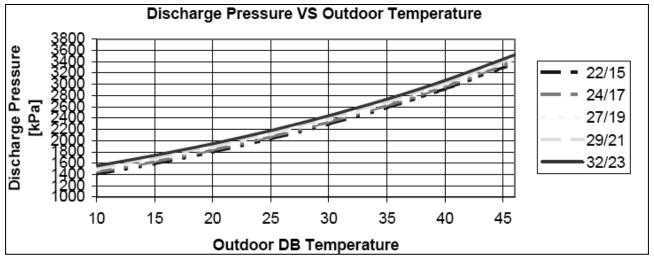


SM PNXDCI 1-A.1 GB 5-9



5.6.2 Heating - Test Mode

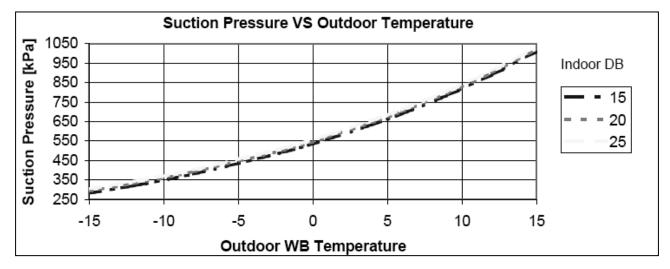

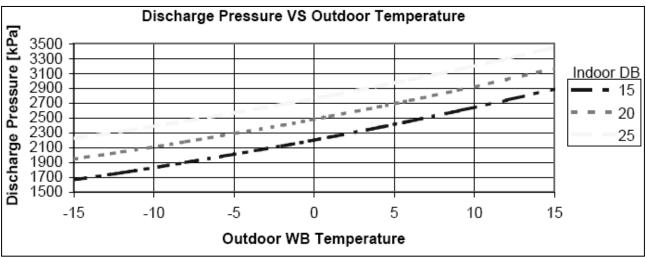

5-10 SM PNXDCI 1-A.1 GB

6. SOUND LEVEL CHARACTERISTICS

6.1 Sound Pressure Level





Figure 1


6.2 Sound Pressure Level Spectrum (Measured as Figure 1)

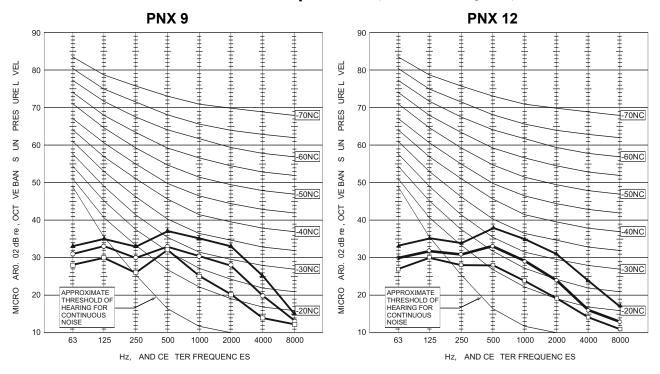


FAN SPEED	LINE
HI	
ME	\rightarrow
LO	

SM PNXDCI 1-A.1 GB 6-1

6.3 Outdoor units



6.4 Sound Pressure Level Spectrum (Measured as Figure 2)

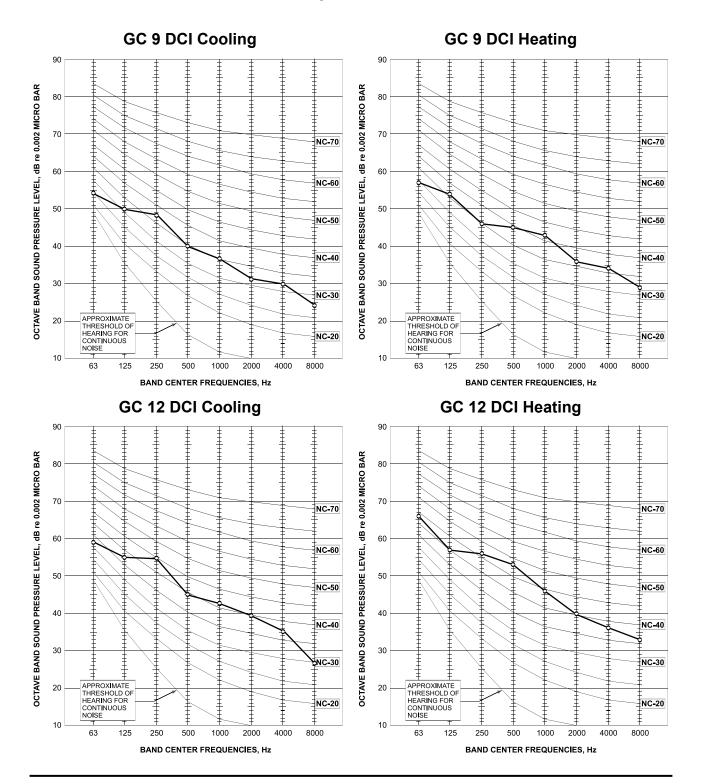

6-2 SM PNXDCI 1-A.1 GB



7. ELECTRICAL DATA

7.1 Single Phase Unit

Model	PNX009 DCI	PNX012 DCI	
Power Supply	1 PH ,220-240VAC ,50HZ		
Connected to	To in	door	
Maximum Current 10A)A	
Inrush Current \(^{(a)}	35A		
Starting Current\(^(b))	10A		
Circuit Breaker	16	6A	
Power Supply wiring no. x cross section	3 X 1.5 mm²		
Interconnecting cable no. x cross section	4 X 1.	5 mm²	

⁽a) Inrush current is the current when power is up (charging the DC capacitors at outdoor unit controller).

NOTE


Power wiring cord should comply with local lows and electrical regulations requirements.

SM PNXDCI 1-A.1 GB 7-1

⁽b) Starting current is the current at compressor start up.

8. WIRING DIAGRAMS

8.1 Indoor & Outdoor Units: PNX009, PNX012 / GC 9 DCI Nordic, GC 12 DCI Nordic

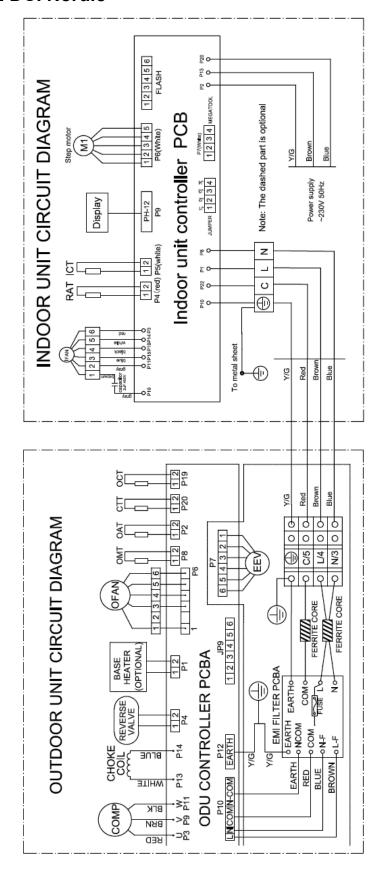


SM PNXDCI 1-A.1 GB 8-1


9. REFRIGERATION DIAGRAMS

9.1 Heat Pump Models

9.1.1 PNX009 / GC 9 DCI Nordic, PNX012 / GC 12 DCI Nordic => Cooling Mode

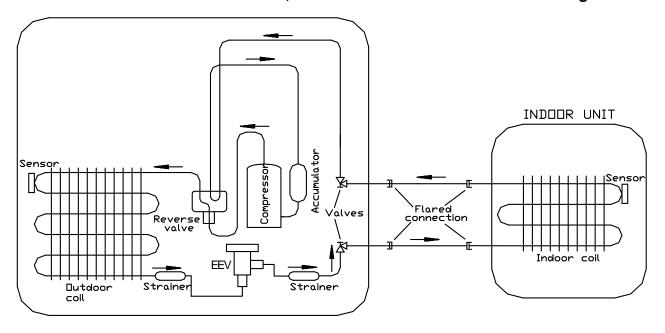



9.1.2 PNX009 / GC 9 DCI Nordic, PNX012 / GC 12 DCI Nordic => Heating Mode

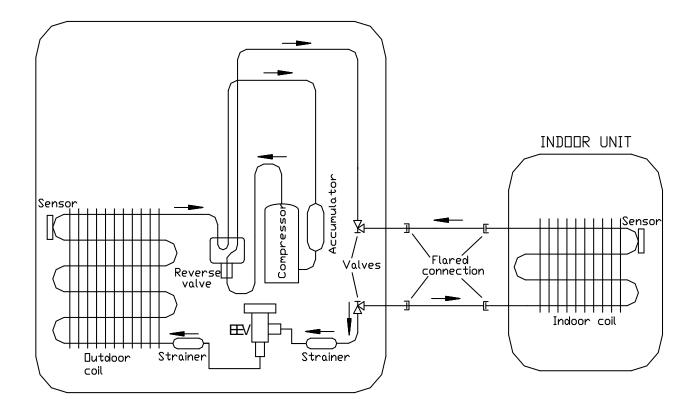

SM PNXDCI 1-A.1 GB 9-1

10. TUBING CONNECTIONS

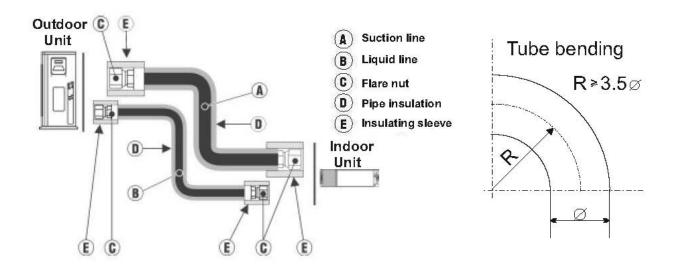



TUBE (Inch) TORQUE (Nm)	1/4"	3/8"	1/2"	5/8"	3/4"
Flare Nuts	11-13	40-45	60-65	70-75	80-85
Valve Cap	13-20	13-20	18-25	18-25	40-50
Service Port Cap	11-13	11-13	11-13	11-13	11-13

- 1. Valve Protection Cap-end
- 2. Refrigerant Valve Port (use Allen wrench to open/close)
- 3. Valve Protection Cap
- 4. Refrigerant Valve
- 5. Service Port Cap
- 6. Flare Nut
- 7. Unit Back Side
- 8. Copper Tube

When the outdoor unit is installed above the indoor unit an oil trap is required every 5m along the suction line at the lowest point of the riser. Incase the indoor unit is installed above the outdoor, no trap is required.

SM PNXDCI 1-A.1 GB 10-1



11. CONTROL SYSTEM

11.1 General Functions and Operating Rules

The DCI software is fully parametric.

All the model dependent parameters are shown in Italic style [parameter].

The parameters values are given in the last section of this control logic chapter of the service manual.

11.1.1 System Operation Concept

The control function is divided between indoor and outdoor unit controllers. Indoor unit is the System 'Master', requesting the outdoor unit for cooling/heating capacity supply. The outdoor unit is the system 'Slave' and it must supply the required capacity nless it enters into a protection mode avoiding it from supplying the requested capacity.

The capacity request is transferred via indoor to outdoor communication, and is represented by a parameter called 'NLOAD'. NLOAD is an integer number with values between 0 and 127, and it represents the heat or cool load felt by the indoor unit.

11.1.2 Compressor Frequency Control

11.1.2.1 NLOAD setting

The NLOAD setting is done by the indoor unit controller, based on a PI control scheme. The actual NLOAD to be sent to the outdoor unit controller is based on the preliminary LOAD calculation, the indoor fan speed, and the power shedding function.

NLOAD limits as a function of indoor fan speed:

Indoor Fan Speed	Maximum NLOAD Cooling	Maximum NLOAD Heating
Low	Max NLOADIF1C	127
Medium	Max NLOADIF2C	127
High	Max NLOADIF3C	127
Turbo	Max NLOADIF4C	127
Auto	Max NLOADIF5C	127

NLOAD limits as a function of power shedding:

Mode	Power Shedding OFF	Power Shedding ON
Cool	No limit	Nominal Cooling
Heat	No limit	Nominal Heating

NLOAD limits as a function of indoor fan speed:

NLOAD	Target Frequency [Hz]
0	0
0 <nload≤minfreq< td=""><td>MiniFreq</td></nload≤minfreq<>	MiniFreq
>MinFreq	MaxFreq — MinFreq 127 — MinFreq

Target frequency limits as a function of outdoor air temperature (OAT):

OAT Range	Cool mode limits Heat mode limits			
OAT<6		No limit		
6 <oat<15< td=""><td>MaxFreqAsOATC</td><td>MaxFreqAsOATIH</td></oat<15<>	MaxFreqAsOATC	MaxFreqAsOATIH		
15 < OAT < 24		MayEragAsQAT2U		
24 < OAT	No limit	- MaxFreqAsOAT2H		


SM PNXDCI 1-A.1 GB



11.1.4 Frequency Changes Control

.Frequency change rate is 1 Hz/sec

11.1.5 Compressor Starting Control

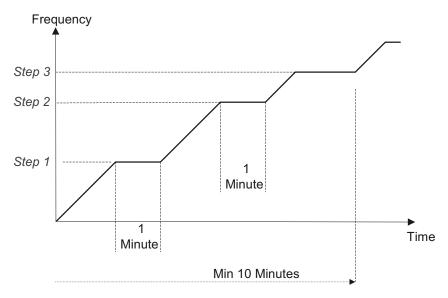

11.1.6 Minimum On and Off Time

3 minutes.

11.1.7 Indoor Fan Control

10 Indoor fan speeds are determined for each model. 5 speeds for cool/dry/fan modes and 5 speeds for heat mode. When user sets the indoor fan speed to a fixed speed (Low/ Medium/ High), unit will operate constantly at set speed.

When Auto Fan is selected, indoor unit controller can operate in all speeds. The actual speed is set according to the cool/heat load.

11.1.7.1 Turbo Speed

The Turbo speed is activated during the first 30 minutes of unit operation when auto fan speed is selected and under the following conditions:

Difference between set point and actual room temperature is bigger then 3 degrees.

Room temperature > 22 for cooling, or < 25 for heating.

11.1.8 Heating Element Control

Heating element can be started if LOAD > 0.8* MaximumNLOAD AND Indoor Coil temperature <45. The heating element will be stopped when LOAD < 0.5* MaximumNLOAD OR if Indoor Coil Temperature > 50.

11.1.9 Outdoor Fan Control

In cooling mode:

The OFAN speed is controlled according to the following objectives:

Mode	Ofan Target	Implementation
Cool Mode	Keep the condensation temperature to the minimum possibly value	Keep OMT as low as possible down to 27°C

The target OFAN speed is the sum of open loop value (OLs) and a result of the accumulative correction values (CV). $OFAN_{Taroet} = OFAN_{OL} + \sum OFAN_{CV}$

	During 2 minutes after the compressor start up	After 2 minutes
OFAN Open Loop	Yes, Continuously according to the software timer	No
OFAN Corrections	No	Yes, every 40 seconds

When OMT or OCT is faulty there will be no OFAN connections, and the OFAN will operate according to the open loop table.



The following table describes the open loop of outdoor fan speed, at cool mode, related to outdoor air temperature and the frequency (ROM table):

Freq		Outdoor air temperature (OAT)					
rieq	~ - 10	0	10	20	30 or fauly	40	50~
0	0	0	0	0	0	0	0
20	80	120	220	460	600	730	780
40	130	210	330	730	730	780	780
60	250	310	550	730	730	780	780
80	300	400	730	730	730	780	780
100~	350	490	730	730	730	780	780

Notes

- 1. Linear interpolation will be used for values in between the outdoor temperature and the compressor frequencies.
- 2. The speed values, of the above table, are of 10 RPM resolution.
- OFAN speeds are less than OFMinRPM, OFMinRPM will be used, and the OFMinRPM can't be set less than 10rpm at lest.

11.1.10 EEV (electronic Expansion valve) Control

EEV opening determination in normal run mode

The Target EEV value is the sum of open loop value (OL) and a result of the accumulative collection values (CV). The EEV collections are calculated every 30 seconds.

EEV = EEV_{OL} + 2 EEV_{CP}

EEV open loop setting [EEV₀Lpart)

The **EEV** initial value (open loop) is determined according to the operation mode, the actual frequency and ODU model. The values are determined according to the "EEV_{ol} Parameters Table"

EEV correction setting (EEVcvpart)

EEV value, it's calculated as follows:

- EEV_{cv} = 0 during the first 1 minutes after the compressor starts.
- After 1 minutes are over, the EEV_{cv} is updated and calculated every 30 seconds.

The EEV_{cv} is based only on discharge super heat correction:

EEV_{SH Discharge} is function of *SH_{Discharge}* and Der SH_{Dischaige}, where:

For COoling. $SH_{DischargeC} = CTT-OMT$

For Heating. $SH_{Discharge} = CTT-ICT$

Der SH_{Discharge}: SH_{Discharge}(current) - SH_{Discharge}(previous)

11.1.11 Reversing Valve (RV) Control

Reversing valve is on in heat mode.

Switching of RV state is done only after compressor is off for over 3 minutes.

11.1.12 Ionizer Control

Ioniser is on when unit is on AND indoor fan is on AND Ionizer power switch (on Ionizer) is on.

11.1.13 Electro Static Filter)ESF(Control

ESF is on when ESF switch is on, Safety switch is pressed, unit is on, AND indoor fan is on.

11.1.14 Base Heater Control

When OAT is connected, Base Heater will be on when unit is in heating and OAT<2^OC. When OAT is disconnected, Base Heater will be on when unit is in heating.

11.2 Fan Mode

In high/ medium/ low indoor fan user setting, unit will operate fan in selected speed. In AutoFan user setting, fan speed will be adjusting automatically according to the difference between actual room temperature and user set point temperature.

SM PNXDCI 1-A.1 GB



11.3 Cool Mode

NLOAD is calculated according to the difference between actual room temperature and user set point temperature by PI

In high / medium / low indoor fan user setting, unit will operate fan in selected speed.

In AutoFan user setting, fan speed will be ad8usted automatically according to the calculated NLOAD.

11.4 Heat Mode

NLOAD is calculated according to the difference between actual room temperature and user set point temperature by PI control.

In high / medium / low indoor fan user setting, unit will operate fan in selected speed.

In AutoFan user setting, fan speed will be adng to the calculated NLOAD.


11.4.1 Temperature Compensation

In wall mounted models, 3 degrees are reduced from room temperature reading (except when in I-Feel mode), to compensate for temperature difference between high and low areas in the heated room, and for coil heat radiation on room thermistor. The temperature compensation can be enabled/disabled by shortening of J2 on the indoor unit controller.

Model	J2 Shorted	J2 Opened
Wall Mounted (PNX)	Compensation Disable	Compensational Enabled

11.4.2 Indoor Fan Control in Heat Mode

Indoor fan speed depends on the indoor coil temperature:

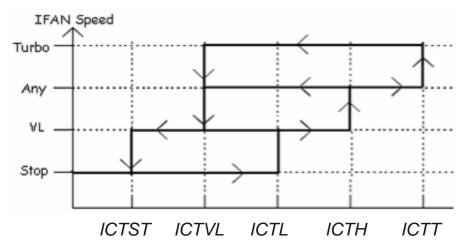

11.5 Auto Cool/Heat Mode

When in auto cool heat mode unit will automatically select between cool and heat mode according to the difference between actual room temperature and user set point temperature (ΔT).

Unit will switch from cool to heat when compressor is off for 3 minutes, and $\Delta T < -3$.

Unit will switch from heat to cool when compressor is off for 5 minutes, and $\Delta T < -3$.

11.6 Dry Mode

As long as room temperature is higher then the set point, indoor fan will work in low speed and compressor will work between 0 and MaxNLOADIF1C Hz.

When the room temperature is lower than the set point, compressor will be switched OFF and indoor fan will cycle 3 minutes OFF. 1 minute ON.

11.7 Protections

There are 5 protection codes.

Normal (Norm) - unit operate normally.

Stop Rise (SR) – compressor frequency can not be raised but does not have to be decreased.

HzDown1 (D1) – Compressor frequency is reduced by 2 to 5 Hz per minute.

HzDown2 (D2) - Compressor frequency is reduced by 5 to 10 Hz per minute.

Stop Compressor (SC) – Compressor is stopped.



11.7.1 Indoor Coil Defrost Protection


	ICT Trend				
ICT	Fast Increasing	Increasing	No change	Decreasing	Fast Decreasing
ICT < -2	SC	SC	SC	SC	SC
-2 ≤ ICT < 0	D1	D1	D2	D2	D2
0 ≤ ICT < 2	SR	SR	D1	D2	D2
2 ≤ ICT < 4	SR	SR	SR	D1	D2
4 ≤ ICT < 6	Norm	Norm	SR	SR	D1
6 ≤ ICT < 8	Norm	Norm	Norm	SR	SR
8 ≤ ICT	Normal				

1.7.2 Indoor Coil over Heating Protection

	ICT Trend				
ICT	Fast Decreasing	Decreasing	No Change	Increasing	Fast Increasing
ICT > 55	SC	SC	SC	SC	SC
53 < ICT ≤ 55	D1	D1	D2	D2	D2
49 < ICT ≤ 53	SR	SR	D1	D2	D2
47 < ICT ≤ 49	SR	SR	SR	D1	D2
45 < ICT ≤ 47	Norm	Norm	SR	SR	D1
43 < ICT ≤ 45	Norm	Norm	Norm	SR	SR
ICT ≤ 43	Normal				

11.7.3 Compressor over Heating Protection

Compressor temperature can be in one of 5 control zones (4 in protection, and 1 normal), according to the following chart.

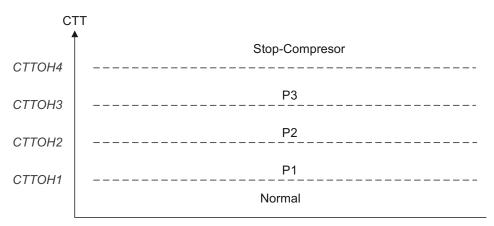


Control Status	Compressor Temperature Increases	Else
P1	Norm	SR
P2	D1	SR
P3	D2	D1
Stop Compressor	SC	

SM PNXDCI 1-A.1 GB



11.7.4 Compressor over Current Protection

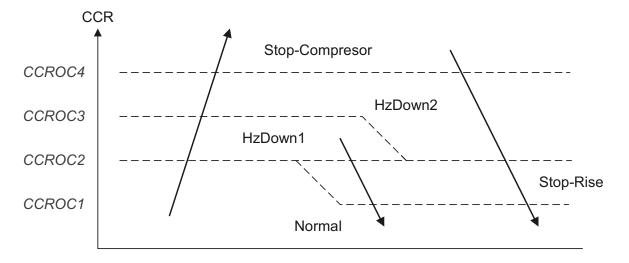

11.7.5 Heat Sink Over Heating Protection (NA for DCI 25 and 35)

HST	HST Trend			
ПОТ	Decreasing	No Change	Increasing	
HST > 90	SC	SC	SC	
85 < HST ≤ 90	D1	D2	D2	
82 < HST ≤ 85	SR	D1	D2	
80 < HST ≤ 82	SR	SR	D1	
78 < HST ≤ 80	Norm	Norm	SR	
HST ≤ 78	Normal			

11.7.6 Outdoor Coil Deicing Protection

11.7.6.1 Deicing Starting Conditions

Deicing operation will start when either one of the following conditions exist:

- Case 1: OCT < DST AND TLD > DI
- Case 2: OCT < OAT 12 AND TLD > 30 minutes.
- Case 3: OCT < AND TLD > 75 minutes
- OCT is Invalid AND OCT < 0
- Compressor ON Time > 15 minutes

OCT - Outdoor Coil Temperature

 ${\sf OAT-Outdoor\,Air\,Temperature}$

TLD - Time from Last Deicing

DI – Deicing Interval (Time Interval Between Two Deicing)

DST – Deicing static threshold (Temperature)


Where DST is defined as:

When OAT > 0 or OAT is invalid, then DST = 8

When OAT \leq 0 then DST = round down (- 0.7*OAT)+8



11.7.6.2 Deicing Protection Procedure

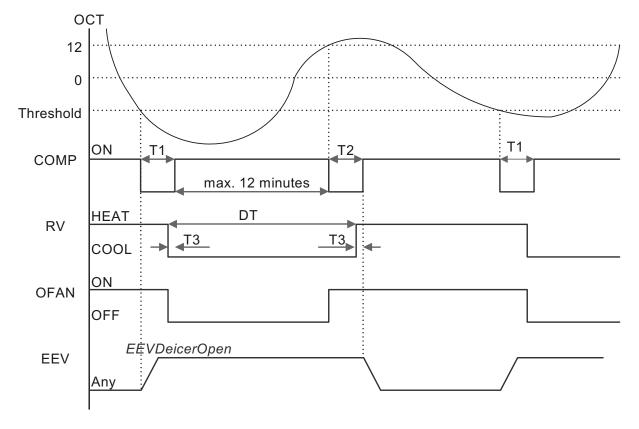

T1 =60 seconds, T2 = 36 seconds, T3 = 6 seconds

11.8 Condensate Water Over Flow Protection



Each of the pins P1, P2, P3 can have two options:

1 - When it is shorted with P4


0 - When it is not shorted to P4

11.8.1 3 Levels Logic (used in floor/ceiling models)

P2	P3	Level
0	0	L0
1	0	L1
1	1	L2&3
0	1	L4


SM PNXDCI 1-A.1 GB



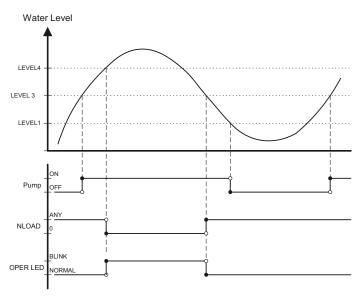

11.8.2 1Level Logic (used in all models except for floor / ceiling models)

P2	P3	Level
Don't care	1	Normal
Don't care	0	Overflow

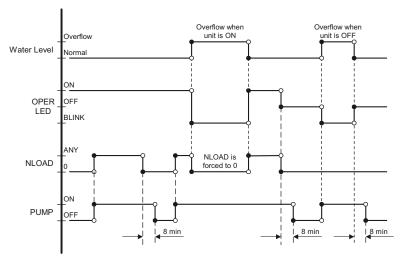

11.9 Indoor Unit Dry Contact

Indoor unit Dry contact has two alternative functions that are selected by J8.

	Function	Contact = Open	Contact = Short
J8 = Open	Presence Detector Connection	No Limit	Forced to STBY
J8 = Open	Power Shedding Function	No Limit	Limit NLOAD

11.10 Operating the Unit from the Mode Button

Forced operation allows to start, stop and operate in Cooling or Heating, in pre-set temperature according to the following table:

Forced operation Mode	Pre-set Temperature
Cooling	20°C
Heating	28°C



11.11 On Unit Controls and Indicators

11.11.1 Indoor Unit Controller Controls and Indicators.

STAND BY INDICATOR	Lights up when the Air Conditioner is connected to power and ready toreceive the R/C commands
OPERATION INDICATOR	Lights up during operation. Blinks for 300 msec., to announce that a R/C infrared signal has been received and stored. Blinks continuously during protections (according to the relevant spec section).
TIMER INDICATOR	Lights up during Timer and Sleep operation.
FILTER INDICATOR	Lights up when Air Filter needs to be cleaned.
COOLING INDICATOR	Lights up when system is switched to Cool Mode by using the Mode Switch on the unit.
HEATING INDICATOR	Lights up when system is switched Heat Mode by using the Mode Switch on the unit.
Mode SWITCH (COOL/HEAT/OFF)	Every short pressing , the next operation mode is selected, in this order: $SB \to Cool \ Mode \to Heat \ Mode \to SB \to In \ long \ pressing \ system \ enters \ diagnostic \ mode.$
RESET / FILTER SWITCH	For short pressing: When Filter LED is on - turn off the FILTER INDICATOR after a clean filter has been reinstalled. When Filter LED is off able/disable the buzzer announcer, if selected.

11.11.2 Outdoor Unit Controller Indicators

Unit has three LED

SB LED is ON when power is ON (230 VAC, even when no communication).

STATUS LED is ON when COMP is ON, and Blinks according to diagnostics mode definitions when either fault or protection occurs.

FAULT LED Blinks according to diagnostics mode definitions when either fault or protection occurs.

11.12 Jumper Settings

11.12.1 Indoor Unit Controller

0 = Open Jumper (disconnect jumper).

1 = Close Jumper (connect jumper).

Self test Jumper - J1

OPERATION	J1
SELF-TEST	1
NORMAL	0

Compensation Jumper -J2

Model	J2 (Default)	Compensation
Wall Mounted (PNX)	0	Activated

Family selection Jumper - J3, J4 and J5

Family	J5	J4	J3
Reserved	0	0	0
Reserved	0	0	1
Reserved	0	1	1
Wall Mounted (PNX)	0	1	1

SM PNXDCI 1-A.1 GB



IDU Model	Jumper Setting					
IDO Wiodei	J8	J7	J6	J5	J4	J3
PNX009	0	0	0	0	1	1
PNX012	0	1	0	0	1	1

For wall mounted units Jumper J7, J8 can be configured by service. All other Jumpers on the above table and factory default (cannot be changed by service.

Model selection Jumper - J7, J8

Model	J7	J8
Α	0	0
В	0	1
С	1	0
D	1	1

<u>J9 – Presence Detector / Power Shedding</u>

OPERATION	J9	
Presence Detector	0	
Power Shedding	1	

Jumper – J10


OPERATION	J1	
PNX	1	

11.12.2 Outdoor Unit Controller

J9 - Jumper Layout

Reserved (PIN 9)	ODU3 (PIN 7)	ODU2 (PIN 5)	ODU1 (PIN 3)	ODU0 (PIN 1)
GND (PIN 10)	GND (PIN 8)	GND (PIN 6)	GND (PIN 4)	GND (PIN 2)

ODU Model Selection

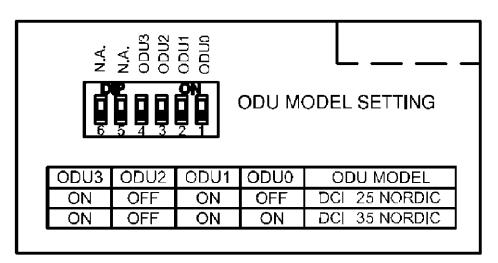



11.13 Test Mode

11.13.1 Entering Test Mode

System can enter Test mode in two ways:

Automatically when the following conditions exists for 30 minutes continuously:

Mode = Cool, Set point =16, Room temperature = 27 ± 1 , Outdoor temperature = 35 ± 1 Or

Mode = Heat, Set point = 30, Room temperature = 20±1, Outdoor temperature = 7±1

Manually when entering diagnostics with the following settings:

Mode = Cool, Set point = 16

Mode = Heat, Set point = 30

11.13.2 Unit Operation in Test Mode

In test mode, the unit will operate in fixed settings according to the indoor fan speed setting:

Indoor Fan Speed Setting	Unit Setting
Low	Minimum Capacity Setting
High	Nominal Capacity Setting
Auto	Maximum Capacity Setting

11.14 SW Parameters

11.14.1 Indoor Units SW Parameters

General Parameters for All Models:

Parameters defining the indoor fan speed as a function of Indoor Coil temperature in heat mode (ICT):

ICTST Speed	ICT to stop indoor fan	25
ICTVLSpeed	ICT to go down to very low speed	28
ICTLSpeed	ICT to start in very low speed	30
ICTHSpeed	ICT to start in increase speed from very low	32
ICTTSpeed	ICT to enable Turbo fan speed	40

Model Depended Parameters:

Parameter name	Wall Mounted Models					
Parameter name	PNX009	PNX012				
NLOAD limits as a fur	NLOAD limits as a function of selected indoor fan speed					
MaxNLOADIF1C	40	40				
MaxNLOADIF2C	53	53				
MaxNLOADIF3C	120	120				
MaxNLOADIF4C	127	127				
MaxNLOADIF5C	127	127				
Inde	oor Fan speeds					
IFVLOWC	700	700				
IFLOWC	800	850				
IFMEDC	900	950				
IFHIGHC	1050	1100				
IFTURBOC	1150	1200				
IFVLOWH	700	700				
IFLOWH	800	850				
IFMEDH	950	1000				
IFHIGHH	1100	1150				
IFTURBOH	H 1200 1300					
Nominal C	ompressor Frequ	uency				
NomLoadC	40	62				
NomLoadH	55	67				

SM PNXDCI 1-A.1 GB 11-11



11.14.2 Outdoor Units SW Parameters

Parameter Name	GC 9 DCI Nordic	GC 12 DCI Nordic			
Compressor Parameters					
MinFreqC	20	20			
MaxFreqC	60	80			
MinFreqH	30	30			
MaxFreqH	78	88			
Step1Freq	35	35			
Step2Freq	50	55			
Step3Freq	90	90			
Frequency limits a	s a function of outdoo	r air temperature			
MaxFreqAsOATC	40	50			
MaxFreqAsOAT1H	65	75			
MaxFreqAsOAT2H	50	60			
Compres	ssor Over Heating Prot	tection			
CTTOH1	90	90			
CTTOH2	95	95			
СТТОНЗ	100	100			
СТТОН4	105	105			
Compress	or Over Current Prote	ction [A]			
CCR01	7.1	7.1			
CCR02	7.5	7.5			
CCR03	7.9	7.9			
CCR04	8.3	8.3			

11-12 SM PNXDCI 1-A.1 GB

12. TROUBLESHOOTING

12.1 Troubleshooting GC 9 DCI Nordic, GC 12 DCI Nordic

WARNING!!!

When Power Up – the whole outdoor unit controller, including the wiring, is under HIGH VOLTAGE!!!

Never open the Outdoor unit before turning off the Power!!!

When turned off, the system is still charged (400V)!!!

It takes about 3 Min. to discharge the system.

Touching the controller before discharging may cause an electrical shock!!!

12.1.1 Single Split System failures and Corrective Actions

No	Symptom	Probable Cause	Corrective Action
1	Power supply indicator (Red LED) does not light up.	No power supply	Check power supply. If power supply is OK, check display and display wiring. if OK, replace controller.
2	Unit does not respond to remote control message	Remote control message not reached the indoor unit	Check remote control batteries, if batteries are OK, check display and display wiring, if OK, replace display PCB. If still not OK replace controller.
3	Unit responds to remote control message but Operate indicator (Green LED) does not light up	Problem with display PCB	Replace display PCB. If still not OK replace controller.
		Unit in heat mode and coil is still not warm.	Change to cool mode and check.
4	Indoor fan does not start (louvers are opened and Green LED does light up)	Problem with PCB or capacitor	Change to high speed and Check power supply to motor is higher than 130VAC (for triack controlled motor) or higher than 220VAC for fixed speed motors, if OK replace capacitor, if not OK replace controller.
5	Indoor fan works when unit is OFF, and indoor fan speed is not changed by remote control command.	PCB problem	Replace controller
6	Compressor does not start	Electronics control problem or protection	Perform diagnostics and follow the actions described.
7	Compressor stops during operation and Green LED remains on	Electronic control or power supply problem	Perform diagnostics and follow the actions described.
8	Compressor is on but outdoor fan does not work	Problem with outdoor electronics or outdoor fan	Check outdoor fan motor according to the procedure below, if not OK replace controller.

No	Symptom	Probable Cause	Corrective Action
9	Unit works in wrong mode (cool instead of heat or heat instead of cool)	Electronics or power connection to RV	Check RV power connections, if OK, check RV operation with direct 230VAC power supply, if OK, replace outdoor controller.
10	All components are operating properly but no cooling or no heating	Refrigerant leak	Check refrigeration system.
11	Compressor is over heated and unit does not generate capacity	EEV problem	Check EEV.
12	Units goes into protections and compressor is stopped with no clear reason	Control problem or refrigeration system problem	Perform diagnostics , and follow the actions described.
13	Compressor motor is generating noise and no suction occurs	Phase order to compressor is wrong	Check compressor phase order.
14	Water leakage from indoor unit	Indoor unit drainage tube is blocked	Check and open drainage tube.
15	Freezing of outdoor unit in heat mode and outdoor unit base is blocked with ice		Connect base heater.
16	Unit operates with wrong fan speeds or wrong frequency	Wrong jumper settings	Perform diagnostics, and check if units is operating by EEPROM parameters.

12.2 Checking the refrigeration system

Checking system pressures and other thermodynamic measures should be done when system is in Test Mode (in Test mode, system operates in fixed settings). The performance curves given in this manual are given for unit performance in test mode when high indoor fan speed is selected. Entering test mode:

Set unit to Cool/16 degrees/High indoor fan speed, or Heat/30 degrees/High indoor fan speed, and enter diagnostics.

12.3 Judgment by Indoor/Outdoor Unit Diagnostics

Enter diagnostics mode - press for five seconds Mode button in any operation mode. Acknowledgment is by 3 short beeps and lights of COOL and HEAT LED's. Then, every short pressing of Mode button will scroll between Indoor and Outdoor unit diagnostic modes by the acknowledgment of 3 short beeps and lighting of COOL and HEAT LED's.

During the Outdoor unit diagnostics all four Indoor LED's (STBY, Operate, Filter and Timer) are blinking. When Indoor diagnostics is displayed, all four LED's (STBY, Operate, Filter and Timer) are ON.

When system enters diagnostics mode, only one fault code is shown. Order of priority is from the lower to the higher number. Diagnostics is continuously ON as long as power is ON. The current system operation mode will not be changed.

If no fault occurred in the system, no fault code will be displayed during normal operation mode. The last fault code will be displayed even if the system has recovered from that fault. The last fault will be deleted from the EEPROM after the system has exit diagnostics mode.

In diagnostics mode, system fault / status will be indicated by blinking of Heat & Cool LEDs. The coding method will be as follows:

Heat LED will blink 5 times in 5 seconds, and then will be shut off for the next 5 seconds. Cool LED will blink during the same 5 seconds according to the following Indoor / Outdoor unit tables: Note: 0 – OFF. 1-ON

12.3.1 Indoor Unit Diagnostics

No	Problem	5	4	3	2	1
1	RT-1 is disconnected	0	0	0	0	1
2	RT-1 is shorted	0	0	0	1	0
3	RT-2 is disconnected	0	0	0	1	1
4	RT-2 is shorted	0	0	1	0	0
5	Reserved	0	0	1	0	1
7	Communication mismatch	0	0	1	1	1
8	No Communication	0	1	0	0	0
9	No Encoder	0	1	0	0	1
10	Reserved	0	1	0	1	0
11	Outdoor Unit Fault	0	1	0	1	1
	Reserved					
17	Defrost protection	1	0	0	0	1
18	Deicing Protection	1	0	0	1	0
19	Outdoor Unit Protection	1	0	0	1	1
20	Indoor Coil HP Protection	1	0	1	0	0
21	Overflow Protection	1	0	1	0	1
22	Reserved					
24	EEPROM Not Updated	1	1	0	0	0
25	Bad EEPROM	1	1	0	0	1
26	Bad Communication	1	1	0	1	0
27	Using EEPROM data	1	1	0	1	1
28	Model A	1	1	1	0	0
29	Model B	1	1	1	0	1
30	Model C	1	1	1	1	0
31	Model D	1	1	1	1	1



12.3.2 Indoor Unit Diagnostics and Corrective Actions

No.	Fault	Probable Cause	Corrective Action
1	Sensor failures of all types		Check sensor connections or replace sensor
2	Communication mismatch	Indoor and Outdoor controllers are with different versions	Replace Indoor controller
3	No Communication	Communication or grounding wiring is not good.	Check Indoor to Outdoor wiring and grounding
4	No Encoder	Indoor electronics or motor	Check motor wiring, if ok, replace motor, if still not ok, replace Indoor controller.
5	Outdoor Unit Fault	Outdoor controller problem	Switch to Outdoor diagnostics.
6	EEPROM Not Updated	System is using ROM parameters and not EEPROM parameters	No action, unless special parameters are required for unit operation.
7	Bad EEPROM		No action, unless special parameters are required for unit operation.
8	Bad Communication	Communication quality is low reliability	Check Indoor to Outdoor wiring and grounding
9	Using EEPROM data	No problem. System is using EEPRRRROM parameters	



12.3.3 Outdoor Unit Diagnosits

No	Problem	5	4	3	2	1
1	OCT is disconnected	0	0	0	0	1
2	OCT is shorted		0	0	1	0
3	CTT is disconnected	0	0	0	1	1
4	CTT is shorted	0	0	1	0	0
5	HST is disconnected (when enabled)	0	0	1	0	1
6	HST is shorted (when enabled)	0	0	1	1	0
7	OAT is disconnected (when enabled)	0	0	1	1	1
8	OAT is shorted (when enabled)	0	1	0	0	0
9	TSUC is disconnected (when enabled)	0	1	0	0	1
10	TSUC is shorted (when enabled)	0	1	0	1	0
11	IPM Fault	0	1	0	1	1
12	Bad EEPROM	0	1	1	0	0
13	DC under voltage	0	1	1	0	1
14	DC over voltage	0	1	1	1	0
15	AC under voltage		1	1	1	1
16	Indoor / Outdoor unit Communication mismatch		0	0	0	0
17	No Communication		0	0	0	1
18	Reserved	1	0	0	1	0
20	Heat sink Over Heating	1	0	1	0	0
21	Deicing	1	0	1	0	1
22	Compressor Over Heating	1	0	1	1	0
23	Compressor Over Current	1	0	1	1	1
24	No OFAN Feedback	1	1	0	0	0
25	OFAN locked	1	1	0	0	1
26	Compressor Lock	1	1	0	1	0
27	Bad Communication		1	0	1	1
30	Outdoor Coil Overheating	1	1	1	1	0
31	Operation Condition Is Exceeded	1	1	1	1	1

1 - ON

0 - OFF

Only one code is shown. Order of priority is 1-31. Diagnostics is continuously ON as long power is on.

12.3.4 Outdoor Unit Diagnostics and Corrective Actions

No	Fault	Probable Cause	Corrective Action
1	Sensors failures of all types		Check sensors connections or replace sensors.
2	IPM Fault	Electronics HW problem	Check all wiring and jumper settings, if OK, replace electronics.
3	Bad EEPROM		No action, unless special parameters are required for unit operation.

No	Fault	Probable Cause	Corrective Action
4	DC under/over Voltage	Electronics HW problem	Check outdoor unit pow- er supply voltage
5	AC under Voltage		Check outdoor unit pow- er supply voltage
6	Indoor / Outdoor unit Communication mis- match	Indoor and Outdoor controllers are with different versions	Replace Indoor controller
7	No Communication	Communication or grounding wiring is not good.	Check Indoor to Outdoor wiring and grounding
8	Compressor Lock		Switch unit to STBY and restart
9	Bad Communication	Communication quality is low reliability	Check Indoor to Outdoor wiring and grounding

12.4 Judgment by MegaTool

MegaTool is a special tool to monitor the system states.

Using MegaTool requires:

- · A computer with RS232C port.
- · A connection wire for MegaTool.
- A special MegaTool software.
- Use MegaTool according to following procedure:
- Setup MegaTool software: copy the software to the computer.
- Connect RS232C port in computer with MegaTool port in Indoor/Outdoor unit controller by the connection wire.
- Run the software and choose the COM port, you can monitor the A/C system state
- In monitor tab

12.5 Simple procedures for checking the Main Parts

12.5.1 Checking Mains Voltage.

Confirm that the Mains voltage is between 198 and 264 VAC. If Mains voltage is out of this range, abnormal operation of the system is expected. If in range check the Power (Circuit) Breaker and look for broken or loosed cable lugs or wiring mistake(s).

12.5.2 Checking Power Input.

If Indoor unit power LED is unlighted, power down the system and check the fuse of the Indoor unit. If the fuse is OK replace the Indoor unit controller. If the fuse has blown, replace the fuse and power up again.

Checking Power Input procedure for the Outdoor unit is the same as with the Indoor unit.

12.5.3 Checking the Outdoor Fan Motor.

Enter Test Mode (where the OFAN speed is high)

Check the voltage between lead wires according to the normal value as following:

Between red wire and black wire: 310VDC +/- 20V Between orange wire and black wire: 15VDC +/- 1V

Between yellow wire and black wire: 2-6VDC



12.5.4 Checking the Compressor.

The compressor is brushless permanence magnetic DC motor. Three coil resistance is same. Check the resistance between three poles. The normal value should be below 0.5 ohm (TBD).

12.5.5 Checking the Reverse Valve (RV).

Running in heating mode, check the voltage between two pins of reverse valve connector, normal voltage is 220VAC.

12.5.6 Checking the electrical expansion valve (EEV).

The EEV has two parts, drive part and valve. The drive part is a step motor; it is ringed on the valve. Check the drive voltage (12VDC). When Outdoor unit is power on, EEV shall run and have click and vibration.

12.6 Precaution, Advise and Notice Items

12.6.1 High voltage in Outdoor unit controller.

Whole controller, including the wires that are connected to the Outdoor unit controller may have the potential hazard voltage when power is on. Touching the Outdoor unit controller may cause an electrical shock.

Advise: Don't touch the naked lead wire and don't insert finger, conductor or anything else into the controller when power is on.

12.6.2 Charged Capacitors

Three large-capacity electrolytic capacitors are used in the Outdoor unit controller. Therefore, charging voltage (380VDC) remains after power down. Discharging takes about four minutes after power is off. Touching the Outdoor unit controller before discharging may cause an electrical shock.

12.6.3 Additional advises

When disassemble the controller or the front panel, turn off the power supply.


When connecting or disconnecting the connectors on the PCB, hold the whole housing, don't pull the wire.

There are sharp fringes and sting on shell. Use gloves when disassemble the A/C units.

SM PNXDCI 1-A.1 GB 12-7

13. EXPLODED VIEWS AND SPARE PARTS LISTS

13.1 Indoor Unit: PNX009, PNX012 DCI

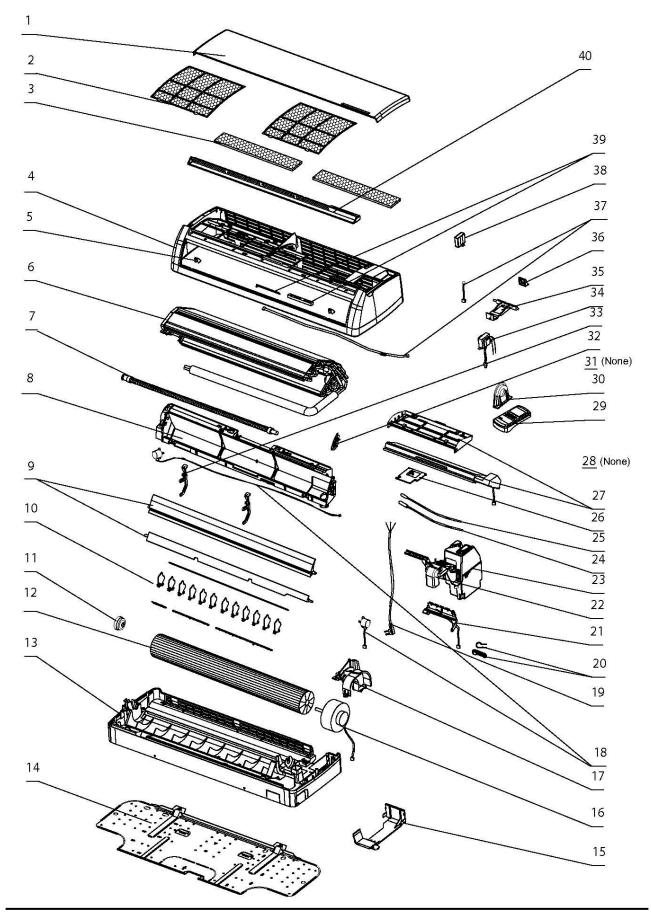


SM PNXDCI 1-A.1 GB 13-1

13.2 Indoor Unit: PNX009 DCI, PNX012 DCI

No.	PN	Description	Qty
1	465800009	Grill A Assy./ LEX7/9/12/14 for Airwell	1
	465800016	Grill A Assy./ LEX7/9/12/14 for Electra	1
2	4518655	Air Filter	2
3	4519132	Active Carbon Static Fiber filter	1
	4519744	Low Temperature Catalyst Fiber Filter	1
4	465720059	Front Frame Assy./ LEX7/9/12/14	1
5	4526952	Screw Cover	2
6	4526389	R410A EVAPORATOR ASSY HPI DC WNG9/12	1
7	4518664	Draining Hose(ordinary)	1 1
	4522754	Draining Hose(For Aust.)	1 1
8	4527434	Air Outlet Assy	1
9	4518638	Upper Louver	1 1
9	4526953	Lower Louver	1
10	4518640	Vert. Louver A	2
10	4518641	Vert. Louver B	10
11	4518662	Bearing assy fan	1
12	+	Fan assy plastic D91	1
13	4518661		+
	465700000	Rear panel assy	1
14	4518670	WNG INSTALLATION PLATE	1
15	4518654	Tube Bracket	1
16	4519864R	Motor (LEX DCI25/35 and LEX7/9/12/14 with new function)	1
17	4518650	Motor Cover	1
18	452969400	Step Motor A	1
	452969500	Step Motor B	1
19	4521158R	Power cord cable (Euro.)	1
	4520061R	Power cord cable(Israel)	1 1
	4520278R	Power cord cable(Without plug)	1
20	4519147	Power Cord Clip	1
	465320006	Wire Fixing Block	1
21	467300079R	Display Board Assy./ LEX25/35DCI With new function	1
22	4518666	Sensor Braket	1
23	467300067R	LEX DCI Indoor Controller With Vertical Louver EHK: 916A512-03	1
24	438082	Thermistor Indoor coil BLACK	1
25	4519813	Thermistor room	1
26	465340012	Terminal Cover	1
27	4518663	ELECTROSTATIC FLITER WNG-1	1
	4519338	FILTER FRAME(Optional)	1
28	none	none	0
29	453042500	Remote controller/RC4-I-1 EHK P/N 974-710-00	1
30	4518651	Cover Side Motor	1
31	none	none	0
32	4518682	Gear BOX ASSY	1
33	4518646	Louver Support	1
34	452867800R	Transformer For LEX DCI25/35 (Optional)	1
35	4518657	Tube Lock	1
36	4518656	Mounting Hook	2
37	4519900	IONIZER CABLE A (Optional)	1
38	467430000	Power Supply Unit /Ionizer(Optional)	1
39	467480001	Ionizer/WNG NWNG SERIES(Optional)	1
	4526951	Ionizer Cover (Optional)	1
40	465800018	Air Inlet Frame A Assy.	1

13.4 Outdoor Unit: GC 9 DCI Nordic, GC 12 DCI Nordic

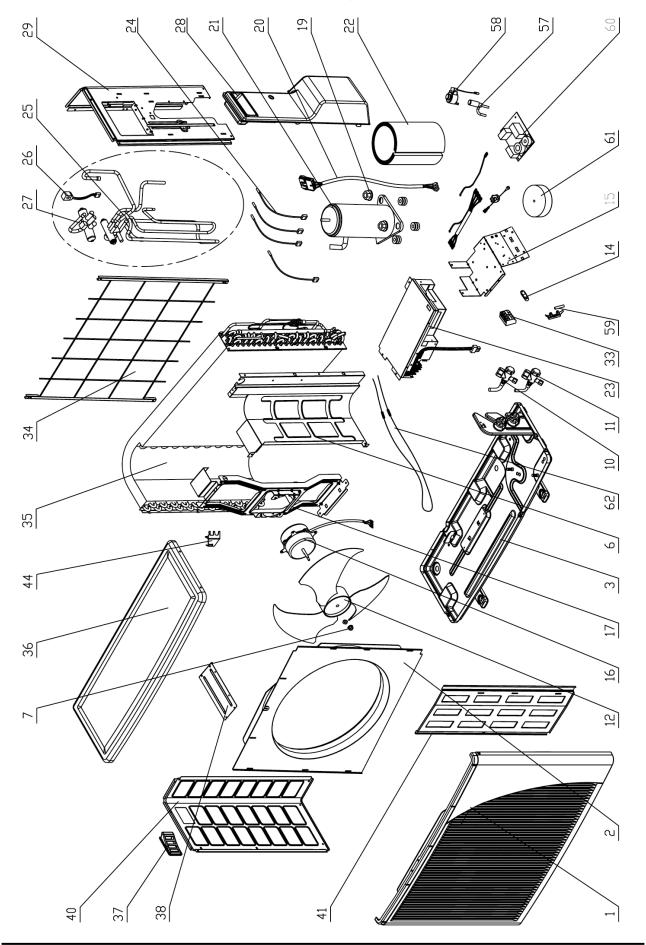

SM PNXDCI 1-A.1 GB 13-3



13.5 Outdoor Unit: GC 9 DCI Nordic, GC 12 DCI Nordic

No.	P/N	Description	Qty.
1	433218	Front panel A	1
2	4526340	Air inlet ring-420	1
3	464600009	Base Painting Assy.	1
6	4526299	Partition Plate	1
7	4519300	Nut for Fan Motor	1
10	4524177	Gas Valve	1
11	4526301	Liqiud Valve	1
14	204107	Cable clip Nylon	1
15	452808700	Therminal Plate Assy.	1
16	452889600R	Fan Motor	1
17	433215	Motor support	1
19	4510677	Nut With Flange M8 -D=24 GB6137-S6	1
20	4526221	Compressor Wire Assy	1
21	460150007R	Compressor Assy.	1
22	469100006	Compressor Jacket	1
22	469120009	Compressor Jacket	1
22	469100005	Compressor Jacket	1
22	469100007	Compressor Jacket	1
23	467300194R	Controller	1
24	467400027	Outside air thermistor(OAT)	1
24	4526775	Compressor top thermistor(CTT)	1
24	467400030	Outside coil thermistor(OCT)	1
24	467400031	Outside middle coil thermistor(OIVIT)	1
25	461600048	4-Way Valve Soldering Assy	1
26	4522509	4-W Valve coil(RC)	1
27	4518951	4-W Valve(RC)	1
28	433229	Valve Cover	1
29	4519606	Right side panel (painting plate)	1
33	4519188	4 poles terminal block	1
34	464800002	Guard Net Painting Assy.	1
35	462300055	Condenser Soldering Assy.	1
36	4519614	Cover panel Painting Assy	1
36	4524510	TOP PANEL INSULATION 335*270*10	1
37	433225	Handle	1
38	4526298	Bridge	1
40	4519607	LeftSide Panel Painting Plate	1
41	433223	Painting Insulation Plate	1
44	453225500	Support/OAT Φ7	1
57	461040000	Electronic Expansion Valve(DPF151-01 R410A)	1
58	461050000	Electronic Expansion Valve Coil(XQ05-211	1
60	467300024R	Filter Board/901 A108-00	1
61	4526396	Chock Assy. 167-021-01	1

APPENDIX A

INSTALLATION AND OPERATION MANUALS

- ► INSTALLATION MANUAL PNX009 / PNX012 DCI
- **▶** OPERATING MANUAL PNX009, PNX012 DCI