

Airwell

Service Manual

HGF / HHF Series

Indoor Units		Outdoor Units
	AWSI-HHF007-N11	AWAU-YGF007-H11
AWSI-HGF009-N11	AWSI-HHF009-N11	AWAU-YGF009-H11
AWSI-HGF012-N11	AWSI-HHF012-N11	AWAU-YGF012-H11
AWSI-HGF018-N11	AWSI-HHF018-N11	AWAU-YGF018-H11
AWSI-HGF024-N11	AWSI-HHF024-N11	AWAU-YGF024-H11



REFRIGERANT

R410A

HEAT PUMP

SM HGFHHF 1-A.1 GB

Sep- 2014

Version:3

LIST OF EFFECTIVE PAGES

Note: Changes in the pages are indicated by a “Revision#” in the footer of each effected page (when none indicates no changes in the relevant page). All pages in the following list represent effected/ non effected pages divided by chapters.

Dates of issue for original and changed pages are:

Original 01 27 Dec, 10
 Updated..... 02 04 Mar, 11
 Updated..... 03 01 Sep, 14

Total number of pages in this publication is **77** consisting of the following:

Page No.	Revision No. #	Page No.	Revision No. #	Page No.	Revision No. #
Title.....	1				
A	1				
i.....	1				
1-1 - 1-4.....	1				
2-1 - 2-5.....	1				
3-1.....	1				
4-1 - 4-2.....	1				
5-1 - 5-10.....	1				
6-1 - 6-4.....	1				
7-1 - 7-1.....	1				
8-1 - 8-4.....	1				
9-1.....	1				
10-1.....	1				
11-1 - 11-8.....	1				
12-1 - 12-2.....	1				
13-1 - 13-15.....	1				
14-1.....	1				

* Zero in this column indicates an original page.

Table of Contents

1.	INTRODUCTION	1-1
2.	PRODUCT DATA SHEET	2-1
3.	RATING CONDITIONS	3-1
4.	OUTLINE DIMENSION	4-1
5.	PERFORMANCE DATA	5-1
6.	SOUND LEVEL CHARACTERISTICS	6-1
7.	ELECTRICAL DATA	7-1
8.	WIRING DIAGRAM	8-1
9.	REFRIGERATION DIAGRAMS	9-1
10.	TUBING CONNECTIONS	10-1
11.	CONTROL SYSTEM	11-1
12.	TROUBLESHOOTING	12-1
13.	EXPLODED VIEW & SPARE PART LIST	13-1
14.	APPEDDIX	14-1

1. INTRODUCTION

1.1 General

HGF/HHF//YGF series is monosplit fixed speed air conditioner designed for residential buildings. The IDU HGF/HHF is a high-wall mounted type indoor with modern appearance. Following models are included:

- AWSI-HHF007-N11 // AWAU-YGF007-H11
- AWSI-HGF009-N11 / AWSI-HHF009-N11 // AWAU-YGF009-H11
- AWSI-HGF012-N11 / AWSI-HHF012-N11 // AWAU-YGF012-H11
- AWSI-HGF018-N11 / AWSI-HHF018-N11 // AWAU-YGF018-H11
- AWSI-HGF024-N11 / AWSI-HHF024-N11 // AWAU-YGF024-H11

Different appearance styles are used in HGF and HHF indoors.

1.2 Main Features

The unit benefits from the most advanced technological innovations, namely:

- R410A models
- Microprocessor control and indoor LED display
- Energy efficiency class A in cooling mode for all models
- Max allowing tubing distance of 25m.(For model HGF/HHF018-024)
- Up to 10 m vertical high between indoor and outdoor units
- Cooling operation at outdoor temperature up to 46°C.
- Easy installation and service.
- Sleep mode from remote control to save energy
- ON/OFF timer and clock display
- Vertical auto swing with motorized flap (any position stop)
- Intelligent Deicing
- Memory from power failure
- Rapid cooling/heating
- I-Feel function
- Cold air prevention in heating
- Clean function (Blow dry)
- Self diagnostic (Error indications) for ease of maintenance

1.3 Indoor Unit

The indoor unit is wall mounted, and can be easily fitted to many types of residential locations. It includes:

- LED display
- Variable speed with PG motor
- Motorized flap
- High efficiency filtration to ensure a best Air Quality : Advanced filtering combine mechanical, Photo-catalytic + Bi-anti bacterial and observe bad gaseous and smokes.

1.4 Control

The microprocessor indoor controller, and an infrared remote control, supplied as standard, provide complete operating function and programming.

Remote control RC 8:

Compact and economically design, it offers excellent user comfort. Combining modern design with high technology, the RC8 remote control offers powerful functions of real considering of user comfort and energy saving of air-conditioner .

For detail of functions, please refer to Appendix 1

1.5 Outdoor Unit

The outdoor units can be installed as floor or wall mounted units by using a wall supporting bracket. The metal sheets are protected by anti- corrosion paint work allowing long life resistance. All outdoor units are pre-charged. For further information please refer to the Product Data Sheet, Chapter 2.

It includes :

- Compressor mounted in a soundproofed compartment :
- Axial fan.
- Outdoor coil with hydrophilic louver fins for RC units.
- Outlet air fan grill.
- Interconnecting wiring terminal block.






1.6 Tubing Connections

Flare type interconnecting tubing to be produced on site.
For further details please refer to the Installation Manual.

1.7 Inbox Documentation

Each unit is supplied with its own installation, operation and remote control manuals.

1.8 Matching Table

OUTDOOR UNITS	INDOOR UNITS				
		AWSI-HGF009-N11	AWSI-HGF012-N11	AWSI-HGF018-N11	AWSI-HGF024-N11
	AWSI-HHF007-N11	AWSI-HHF009-N11	AWSI-HHF012-N11	AWSI-HHF018-N11	AWSI-HHF024-N11
 AWAU-YGF009-H11	√				
 AWAU-YGF009-H11		√			
 AWAU-YGF012-H11			√		
 AWAU-YGF018-H11				√	
 AWAU-YGF022-H11					√

2. PRODUCT DATA SHEET

2.1 HHF007 // YGF007

Model Indoor Unit				HHF007		
Model Outdoor Unit				YGF007		
Installation Method of Pipe				Flared		
Characteristics			Units	Cooling	Heating	
Capacity (4)			kW	2.20	2.38	
Power input (4)			kW	0.685	0.66	
EER (Cooling) or COP(Heating) (4)			W/W	3.21	3.61	
Energy efficiency class				A	A	
Power supply			V	220-240		
			Ph	1		
			Hz	50		
Rated current			A	3.2	3.1	
Power factor				0.92	0.92	
Prated (IDU+ODU)			W	1060		
Circuit breaker rating			A	10A		
INDOOR	Fan type & quantity			Crossflow x 1		
	Fan speeds		Cooling	SH/H/M/L	RPM	1350/1220/1100/1000
			Heating	SH/H/M/L	RPM	1320/1220/1120/980
	Air flow (1)		SH/H/M/L	M3/hr	400/370/340/310	
	External static pressure		Min	Pa	0	
	Sound power level (2)		SH/H/M/L	dB(A)	50/47/45/42	
	Sound pressure level(3)		SH/H/M/L	dB(A)	40/37/35/32	
	Moisture removal			l/hr	0.8	
	Condensate drain tube I.D			mm	16	
	Dimensions		WxHxD	mm	730x255x174	
	Net Weight			kg	8	
	Package dimensions		WxHxD	mm	790x325x245	
	Packaged weight			kg	10.5	
	OUTDOOR	Refrigerant control			Capillary	
Compressor type, model			Rotary, Qinan- YZG-A082Y2			
Fan type & quantity			Propeller(direct) x 1			
Fan speeds		H	RPM	950		
Air flow		H	M3/hr	1500		
Sound power level		H	dB(A)	60		
Sound pressure level(3)		H	dB(A)	50		
Dimensions		WxHxD	mm	730x428x310		
Net Weight			kg	23.5		
Package dimensions		WxHxD	mm	765x475x 350		
Packaged weight			kg	26		
Refrigerant type			R410A			
Standard charge			kg(4m)	0.76		
Additional charge			g/m	30g/m(4m<L<10m)		
Connections between units		Liquid line	In.(mm)	1/4"(6.35)		
		Suction line	In.(mm)	3/8"(9.53)		
		Max.tubing length	m.	Max. 10		
		Max.height difference	m.	Max. 5		
Operation control type				Remote control		

- (1)Airflow in ducted units; at nominal external static pressure.
- (2)Sound power in ducted units is measured at air discharge.
- (3)Sound pressure level measured at 1-meter distance from unit.
- (4)Rating conditions in accordance to ISO 5151 and ISO 13253 (for ducted units).

2.2 HGF009 / HHF009 // YGF009

Model Indoor Unit				HGF009/HHF009		
Model Outdoor Unit				YGF009		
Installation Method of Pipe				Flared		
Characteristics			Units	Cooling	Heating	
Capacity (4)			kW	2.64	2.81	
Power input (4)			kW	0.82	0.78	
EER (Cooling) or COP(Heating) (4)			W/W	3.21	3.61	
Energy efficiency class				A	A	
Power supply			V	220-240		
			Ph	1		
			Hz	50		
Rated current			A	3.8	3.6	
Power factor				0.92	0.92	
Prated (IDU+ODU)			W	1120		
Circuit breaker rating			A	10A		
INDOOR	Fan type & quantity				Crossflow x 1	
	Fan speeds		Cooling	SH/H/M/L	RPM	1390/1280/1180/1080
			Heating	SH/H/M/L	RPM	1350/1250/1140/1040
	Air flow (1)		SH/H/M/L	M3/hr	400/370/340/310	
	External static pressure		Min	Pa	0	
	Sound power level (2)		SH/H/M/L	dB(A)	50/47/45/42	
	Sound pressure level(3)		SH/H/M/L	dB(A)	40/37/35/32	
	Moisture removal			l/hr	1.0	
	Condensate drain tube I.D			mm	16	
	Dimensions		WxHxD	mm	730x255x174	
	Net Weight			kg	8	
	Package dimensions		WxHxD	mm	790x325x245	
	Packaged weight			kg	10.5	
OUTDOOR	Refrigerant control				Capillary	
	Compressor type, model				Rotary, LANDA- QXA-B102C150	
	Fan type & quantity				Propeller(direct) x 1	
	Fan speeds		H	RPM	830	
	Air flow		H	M3/hr	1500	
	Sound power level		H	dB(A)	60	
	Sound pressure level(3)		H	dB(A)	50	
	Dimensions		WxHxD	mm	785x540x320	
	Net Weight			kg	31	
	Package dimensions		WxHxD	mm	820x580x355	
	Packaged weight			kg	34	
	Refrigerant type				R410A	
	Standard charge			kg(4m)	0.66	
Additional charge			g/m	30g/m(4m<L<15m)		
Connections between units		Liquid line	In.(mm)	1/4"(6.35)		
		Suction line	In.(mm)	3/8"(9.53)		
		Max.tubing length	m.	Max. 15		
		Max.height difference	m.	Max. 10		
Operation control type				Remote control		

- (1)Airflow in ducted units; at nominal external static pressure.
- (2)Sound power in ducted units is measured at air discharge.
- (3)Sound pressure level measured at 1-meter distance from unit.
- (4)Rating conditions in accordance to ISO 5151 and ISO 13253 (for ducted units).

2.3 HGF012 / HHF012 // YGF012

Model Indoor Unit				HGF012/HHF012		
Model Outdoor Unit				YGF012		
Installation Method of Pipe				Flared		
Characteristics			Units	Cooling	Heating	
Capacity (4)			kW	3.22	3.52	
Power input (4)			kW	1.00	0.97	
EER (Cooling) or COP(Heating) (4)			W/W	3.21	3.61	
Energy efficiency class				A	A	
Power supply			V	220-240		
			Ph	1		
			Hz	50		
Rated current			A	4.7	4.6	
Power factor				0.92	0.92	
Prated (IDU+ODU)			W	1450		
Circuit breaker rating			A	16A		
INDOOR	Fan type & quantity			Crossflow x 1		
	Fan speeds	Cooling	SH/H/M/L	RPM	1350/1250/1100/950	
		Heating	SH/H/M/L	RPM	1350/1250/1100/950	
	Air flow (1)		SH/H/M/L	m3/hr	550/500/420/350	
	External static pressure		Min	Pa	0	
	Sound power level (2)		SH/H/M/L	dB(A)	50/48/45/42	
	Sound pressure level(3)		SH/H/M/L	dB(A)	40/38/35/32	
	Moisture removal			l/hr	1.0	
	Condensate drain tube I.D			mm	16	
	Dimensions		WxHxD	mm	790x265x177	
	Net Weight			kg	9	
	Package dimensions		WxHxD	mm	870x355x248	
	Packaged weight			kg	12	
OUTDOOR	Refrigerant control			Capillary		
	Compressor type, model			Rotary, LANDA- QXA-B120C150		
	Fan type & quantity			Propeller(direct) x 1		
	Fan speeds		H	RPM	850	
	Air flow		H	m3/hr	1800	
	Sound power level		H	dB(A)	62	
	Sound pressure level(3)		H	dB(A)	52	
	Dimensions		WxHxD	mm	798x540x320	
	Net Weight			kg	35	
	Package dimensions		WxHxD	mm	825x580x355	
	Packaged weight			kg	40	
	Refrigerant type			R410A		
	Standard charge			kg(4m)	0.76	
	Additional charge			g/m	30g/m(4m<L<20m)	
	Connections between units	Liquid line		In.(mm)	1/4"(6.35)	
Suction line		In.(mm)	3/8"(9.52)			
Max.tubing length		m.	Max. 20			
Max.height difference		m.	Max. 10			
Operation control type				Remote control		

- (1)Airflow in ducted units; at nominal external static pressure.
- (2)Sound power in ducted units is measured at air discharge.
- (3)Sound pressure level measured at 1-meter distance from unit.
- (4)Rating conditions in accordance to ISO 5151 and ISO 13253 (for ducted units).

2.4 HGF018 / HHF018 // YGF018

Model Indoor Unit				HGF018/HHF018		
Model Outdoor Unit				YGF018		
Installation Method of Pipe				Flared		
Characteristics			Units	Cooling	Heating	
Capacity (4)			kW	5.30	5.85	
Power input (4)			kW	1.58	1.62	
EER (Cooling) or COP(Heating) (4)			W/W	3.35	3.61	
Energy efficiency class				A	A	
Power supply			V	220-240		
			Ph	1		
			Hz	50		
Rated current			A	7.23	7.41	
Power factor				0.95	0.95	
Prated (IDU+ODU)			W	2400		
Circuit breaker rating			A	25A		
INDOOR	Fan type & quantity			Crossflow x 1		
	Fan speeds		Cooling	SH/H/M/L	RPM	1350/1200/1050/900
			Heating	SH/H/M/L	RPM	1420/1250/1150/1050
	Air flow (1)			SH/H/M/L	m3/hr	850/780/650/550
	External static pressure			Min	Pa	0
	Sound power level (2)			SH/H/M/L	dB(A)	55/52/49/45
	Sound pressure level(3)			SH/H/M/L	dB(A)	45/42/39/35
	Moisture removal				l/hr	1.8
	Condensate drain tube I.D				mm	16
	Dimensions		WxHxD	mm	940x298x200	
	Net Weight				kg	13
	Package dimensions		WxHxD	mm	1010x380x285	
Packaged weight				kg	17	
OUTDOOR	Refrigerant control			Capillary		
	Compressor type, model			Rotary, LANDA-QXA-D20E090		
	Fan type & quantity			Propeller(direct) x 1		
	Fan speeds		H	RPM	780	
	Air flow		H	m3/hr	2800	
	Sound power level		H	dB(A)	66	
	Sound pressure level(3)		H	dB(A)	56	
	Dimensions		WxHxD	mm	913x680x378	
	Net Weight				kg	46
	Package dimensions		WxHxD	mm	994x725x428	
	Packaged weight				kg	50
	Refrigerant type			R410A		
	Standard charge			kg(4m)	1.4	
	Additional charge			g/m	50g/m(4m<L<25m)	
Connections between units		Liquid line	In.(mm)	1/4"(6.35)		
		Suction line	In.(mm)	1/2"(12.7)		
		Max.tubing length		m.	Max. 25	
		Max.height difference		m.	Max. 10	
Operation control type				Remote control		

- (1)Airflow in ducted units; at nominal external static pressure.
- (2)Sound power in ducted units is measured at air discharge.
- (3)Sound pressure level measured at 1-meter distance from unit.
- (4)Rating conditions in accordance to ISO 5151 and ISO 13253 (for ducted units).

2.5 HGF024/ HHF024 // YGF024

Model Indoor Unit				HGF024/HHF024		
Model Outdoor Unit				YGF024		
Installation Method of Pipe				Flared		
Characteristics			Units	Cooling	Heating	
Capacity (4)			kW	6.16	6.50	
Power input (4)			kW	1.90	1.90	
EER (Cooling) or COP(Heating) (4)			W/W	3.24	3.42	
Energy efficiency class				A	B	
Power supply			V	220-240		
			Ph	1		
			Hz	50		
Rated current			A	8.9	8.9	
Power factor				0.92	0.92	
Prated (IDU+ODU)			W	2700		
Circuit breaker rating			A	25A		
INDOOR	Fan type & quantity				Crossflow x 1	
	Fan speeds	Cooling	SH/H/M/L	RPM	1350/1200/1050/900	
		Heating	SH/H/M/L	RPM	1350/1200/1050/900	
	Air flow (1)		SH/H/M/L	m3/hr	850/780/650/550	
	External static pressure		Min	Pa	0	
	Sound power level (2)		SH/H/M/L	dB(A)	57/54/51/48	
	Sound pressure level(3)		SH/H/M/L	dB(A)	47/44/41/38	
	Moisture removal			l/hr	3.0	
	Condensate drain tube I.D			mm	16	
	Dimensions		WxHxD	mm	940x298x200	
	Net Weight			kg	13	
	Package dimensions		WxHxD	mm	1010x380x285	
	Packaged weight			kg	17	
OUTDOOR	Refrigerant control				Capillary	
	Compressor type, model				Rotary, HITACHI - ASH232SV-C8LU	
	Fan type & quantity				Propeller(direct) x 1	
	Fan speeds		H	RPM	780	
	Air flow		H	m3/hr	2790	
	Sound power level		H	dB(A)	64	
	Sound pressure level(3)		H	dB(A)	54	
	Dimensions		WxHxD	mm	913x680x378	
	Net Weight			kg	46	
	Package dimensions		WxHxD	mm	994x725x428	
	Packaged weight			kg	50	
	Refrigerant type				R410A	
	Standard charge			kg(4m)	1.45	
	Additional charge			g/m	30g/m(4m<L<25m)	
	Connections between units	Liquid line		In.(mm)	1/4"(6.35)	
Suction line		In.(mm)	1/2"(12.7)			
Max.tubing length		m.	Max. 25			
Max.height difference		m.	Max. 10			
Operation control type				Remote control		

- (1)Airflow in ducted units; at nominal external static pressure.
- (2)Sound power in ducted units is measured at air discharge.
- (3)Sound pressure level measured at 1-meter distance from unit.
- (4)Rating conditions in accordance to ISO 5151 and ISO 13253 (for ducted units).

3. RATING CONDITIONS

Rating conditions in accordance with ISO 5151 and ISO 13253 (for ducted units).

Cooling:

Indoor: 27°C DB 19°C WB

Outdoor: 35°C DB

Heating:

Indoor: 20°C DB

Outdoor: 7°C DB 6°C WB


3.1 Operating Limits

R410A


		Indoor	Outdoor
Cooling	Upper limit	32°C DB 23°C WB	46°C DB
	Lower limit	21°C DB 15°C WB	21°C DB
Heating	Upper limit	27°C DB	24°C DB 18°C WB
	Lower limit	10°C DB	-9°C DB 80%RH
Voltage		1-PH 50Hz 198 – 264 V	

4. OUTLINE DIMENSION


4.1 Indoor: HGF/HHF007-009-012-018-024

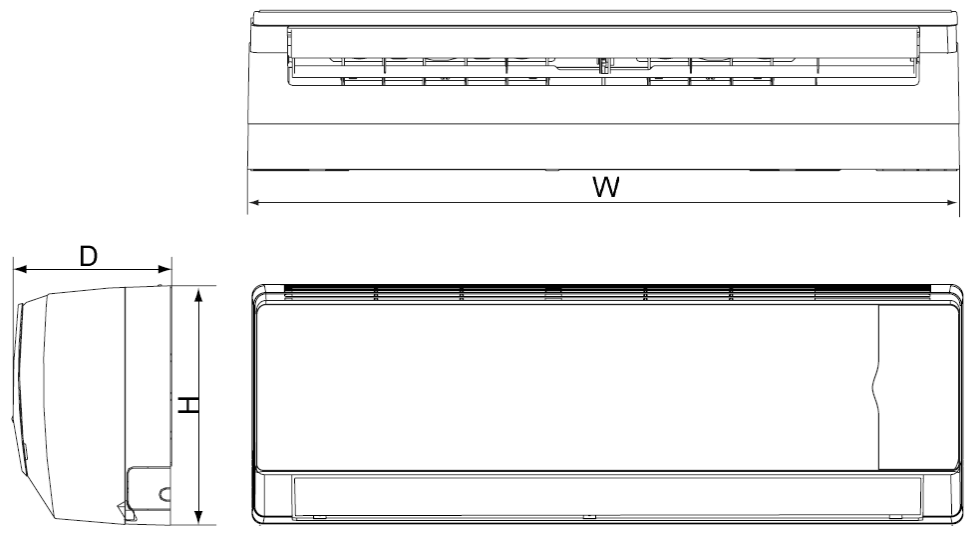

09K 12K

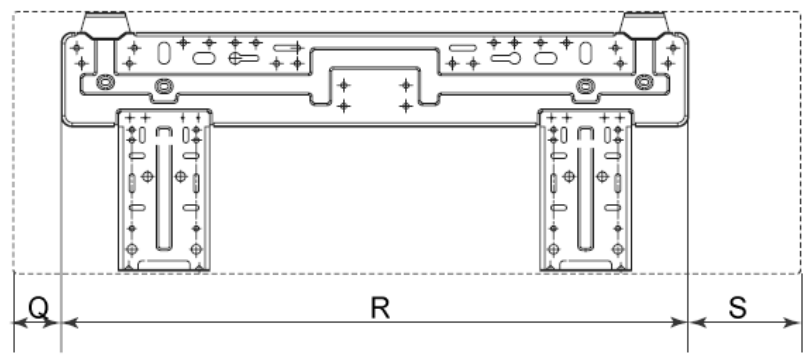

18K 22K

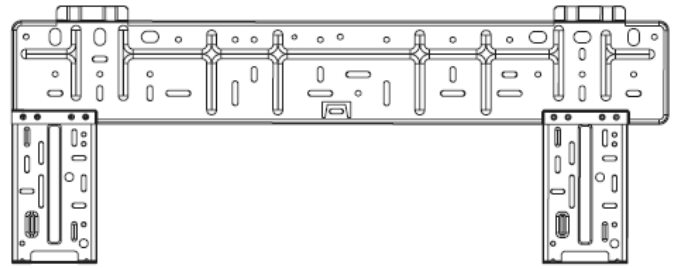


Unit: mm


Model	W	H	D	Q	R	S
07/09K	730	255	174	27	562	141
12K	790	265	177	35	605	150
18-24K	940	298	200	52	694	194

4.2 Outdoor: YGF007-009-012-018-024

Model 07/09/12

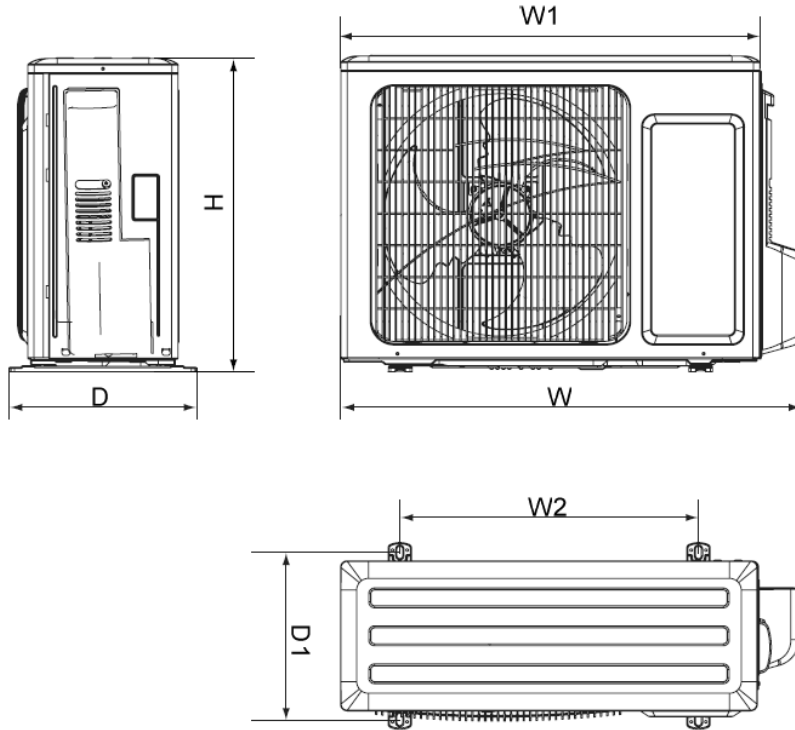

Model 18/24

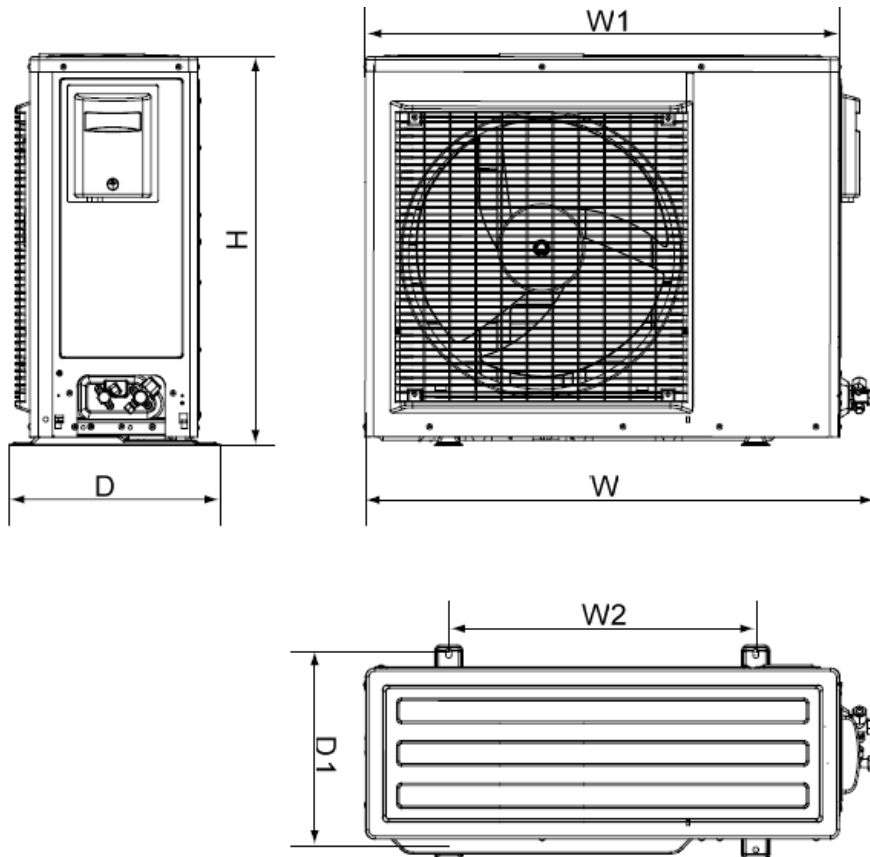

OUTLINE DIMENSION*Airwell*

Unit: mm

Model	W	H	D	W1	W2	D1
07K						
09-12K	776	549	320	714	510	286
18-24K	913	680	378	847	549	342

5. PERFORMANCE DATA

5.1 HGF009 / HHF009 // YGF009

5.1.1 Cooling Capacity (kW)

Entering Air DB OD Coil(°C)	Data	Entering Air WB/DB ID Coil(°C)				
		15/21	17/24	19/27	21/29	23/32
20	TC	2.69	2.84	2.92	2.99	3.06
	SC	1.77	1.87	1.95	2.00	2.04
	PI	0.63	0.63	0.64	0.64	0.64
25	TC	2.55	2.75	2.89	2.98	3.05
	SC	1.73	1.83	1.93	1.99	2.02
	PI	0.68	0.69	0.69	0.70	0.70
30	TC	2.38	2.59	2.80	2.90	2.99
	SC	1.67	1.78	1.89	1.95	1.98
	PI	0.74	0.75	0.75	0.76	0.77
35	TC	2.20	2.39	2.64	2.77	2.90
	SC	1.59	1.70	1.85	1.90	1.94
	PI	0.79	0.81	0.82	0.83	0.83
40	TC	2.00	2.18	2.38	2.60	2.74
	SC	1.50	1.61	1.75	1.80	1.84
	PI	0.86	0.87	0.89	0.90	0.90
46	TC	1.74	1.90	2.09	2.31	2.49
	SC	1.38	1.48	1.59	1.65	1.69
	PI	0.94	0.95	0.97	0.99	1.00

LEGEND

- TC – Total Cooling Capacity, kW
- SC – Sensible Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor

5.1.3 Heating Capacity (kW)


ENTERING WB OD COIL(°C)	ENTERING AIR DB ID COIL(°C)					
	15		20		25	
	TH	PI	TH	PI	TH	PI
-10	1.48	0.62	1.42	0.66	1.36	0.70
-7	1.59	0.64	1.53	0.67	1.48	0.71
-2	1.69	0.65	1.63	0.69	1.58	0.72
2	2.05	0.68	1.97	0.72	1.89	0.76
6	2.90	0.73	2.81	0.78	2.72	0.83
10	3.15	0.77	3.07	0.82	2.98	0.88
15	3.40	0.80	3.32	0.86	3.24	0.92
20	3.59	0.83	3.50	0.90	3.40	0.97

LEGEND


- TH – Total Heating Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor

5.1.4 Curves

5.1.4.1 Cooling

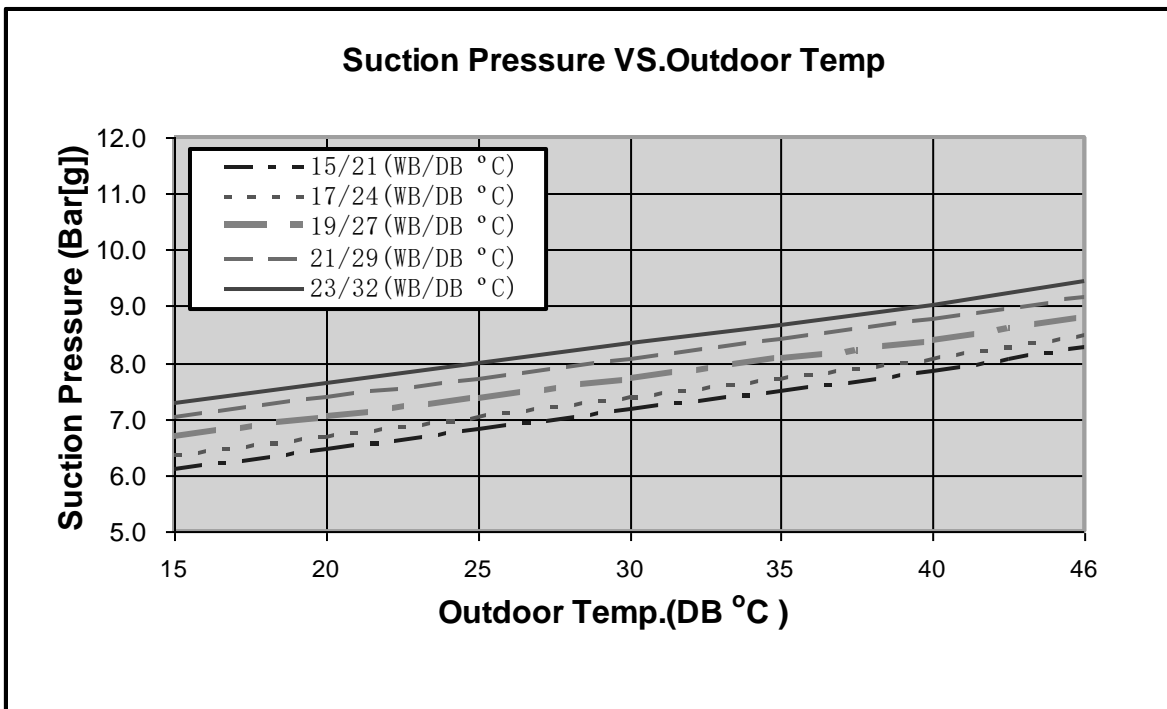

5.1.4.2 Heating

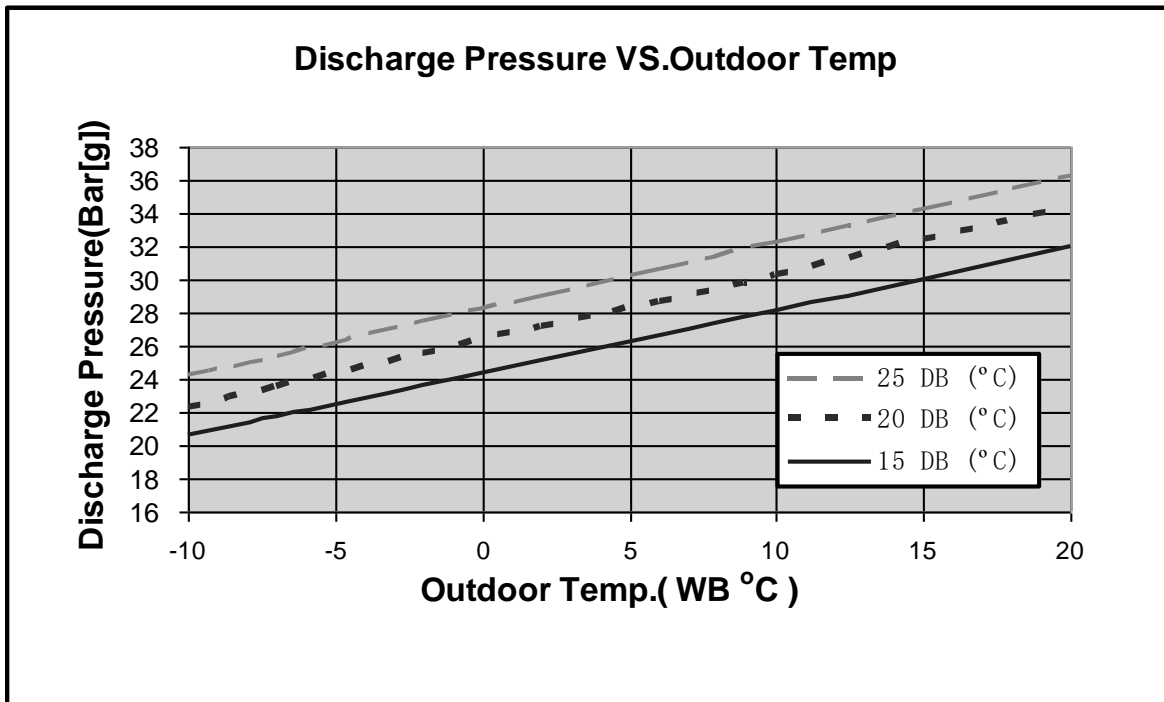

5.2 HGF012 / HHF012 // YGF012

5.2.1 Cooling Capacity (kW)

Entering Air DB OD Coil(°C)	Data	Entering Air WB/DB ID Coil(°C)				
		15/21	17/24	19/27	21/29	23/32
20	TC	3.29	3.46	3.57	3.66	3.74
	SC	2.17	2.28	2.38	2.45	2.49
	PI	0.77	0.78	0.78	0.78	0.78
25	TC	3.11	3.36	3.53	3.64	3.73
	SC	2.11	2.24	2.36	2.43	2.47
	PI	0.84	0.84	0.85	0.85	0.86
30	TC	2.91	3.17	3.42	3.54	3.65
	SC	2.04	2.17	2.31	2.38	2.42
	PI	0.90	0.91	0.92	0.93	0.94
35	TC	2.69	2.92	3.22	3.38	3.54
	SC	1.94	2.08	2.26	2.32	2.37
	PI	0.97	0.99	1.00	1.01	1.02
40	TC	2.45	2.67	2.91	3.18	3.34
	SC	1.83	1.97	2.13	2.20	2.25
	PI	1.05	1.06	1.08	1.10	1.11
46	TC	2.12	2.32	2.55	2.82	3.04
	SC	1.69	1.81	1.95	2.01	2.06
	PI	1.15	1.16	1.19	1.21	1.22

LEGEND

- TC – Total Cooling Capacity, kW
- SC – Sensible Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor


5.2.2 Heating Capacity (kW)

ENTERING WB OD COIL(°C)	ENTERING AIR DB ID COIL(°C)					
	15		20		25	
	TH	PI	TH	PI	TH	PI
-10	1.85	0.78	1.78	0.83	1.71	0.87
-7	1.99	0.80	1.92	0.84	1.85	0.89
-2	2.11	0.81	2.04	0.86	1.97	0.90
2	2.57	0.85	2.46	0.90	2.36	0.95
6	3.62	0.91	3.52	0.97	3.39	1.03
10	3.94	0.96	3.83	1.03	3.73	1.10
15	4.25	1.00	4.15	1.08	4.04	1.15
20	4.48	1.03	4.38	1.12	4.25	1.21


LEGEND

- TH – Total Heating Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor

5.1.5 Curves
5.1.5.1 Cooling

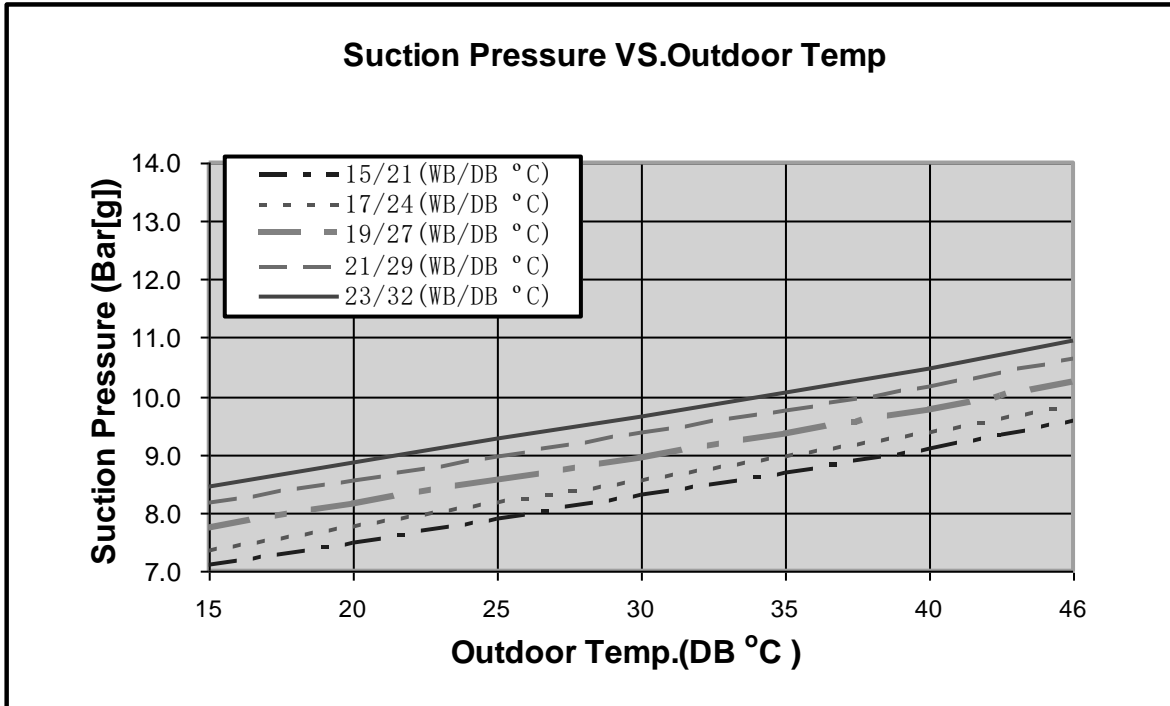

5.1.5.2 Heating

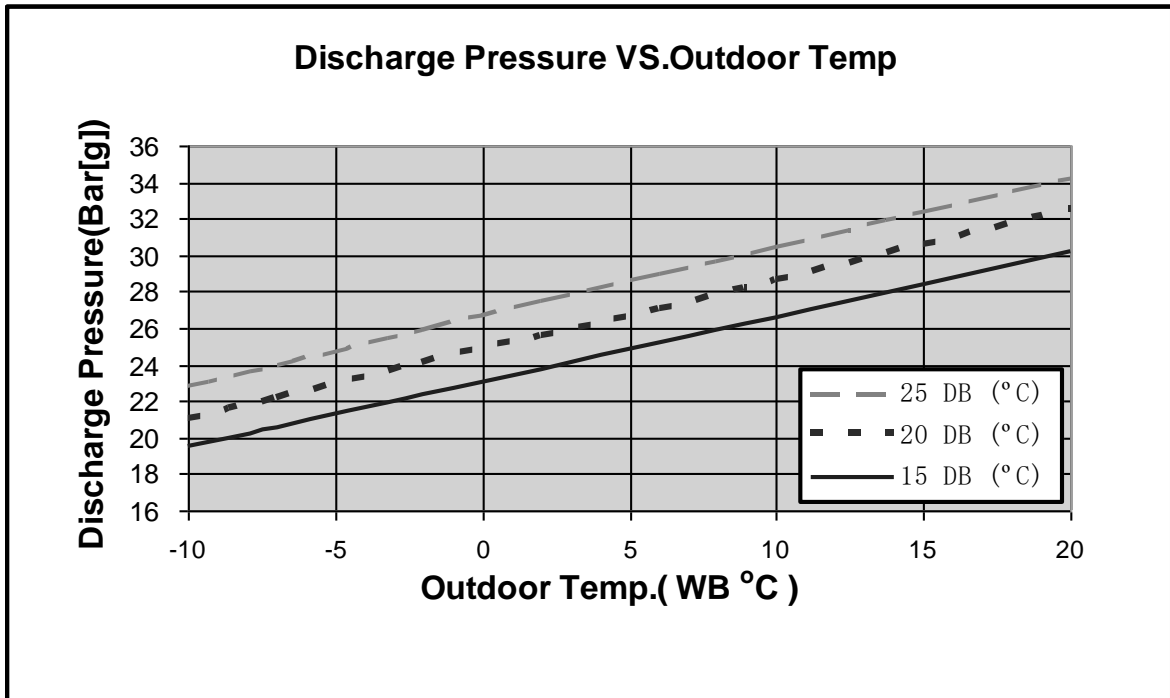

5.3 HGF018 / HHF018 // YGF018

5.3.1 Cooling Capacity (kW)

Entering Air DB OD Coil(°C)	Data	Entering Air WB/DB ID Coil(°C)				
		15/21	17/24	19/27	21/29	23/32
20	TC	5.40	5.70	5.88	6.02	6.14
	SC	3.56	3.75	3.91	4.02	4.10
	PI	1.26	1.27	1.27	1.28	1.28
25	TC	5.11	5.52	5.81	5.98	6.13
	SC	3.47	3.68	3.88	3.99	4.07
	PI	1.36	1.37	1.38	1.39	1.40
30	TC	4.78	5.21	5.63	5.83	6.00
	SC	3.36	3.57	3.80	3.91	3.98
	PI	1.47	1.49	1.51	1.52	1.53
35	TC	4.43	4.80	5.30	5.57	5.83
	SC	3.20	3.43	3.71	3.82	3.89
	PI	1.59	1.61	1.64	1.65	1.66
40	TC	4.03	4.38	4.78	5.23	5.50
	SC	3.01	3.24	3.51	3.62	3.70
	PI	1.71	1.74	1.77	1.79	1.81
46	TC	3.49	3.82	4.20	4.64	5.00
	SC	2.77	2.97	3.20	3.31	3.39
	PI	1.87	1.90	1.94	1.97	1.99

LEGEND

- TC – Total Cooling Capacity, kW
- SC – Sensible Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor

5.1.3 Heating Capacity (kW)


ENTERING WB OD COIL(°C)	ENTERING AIR DB ID COIL(°C)					
	15		20		25	
	TH	PI	TH	PI	TH	PI
-10	2.99	1.34	2.88	1.42	2.76	1.49
-7	3.22	1.37	3.11	1.44	2.99	1.52
-2	3.42	1.39	3.31	1.47	3.19	1.55
2	4.16	1.45	3.99	1.54	3.82	1.64
6	5.87	1.56	5.70	1.67	5.50	1.77
10	6.38	1.65	6.21	1.76	6.04	1.88
15	6.90	1.72	6.73	1.85	6.56	1.97
20	7.27	1.77	7.10	1.92	6.90	2.07

LEGEND


- TH – Total Heating Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor

5.1.6 Curves

5.1.6.1 Cooling

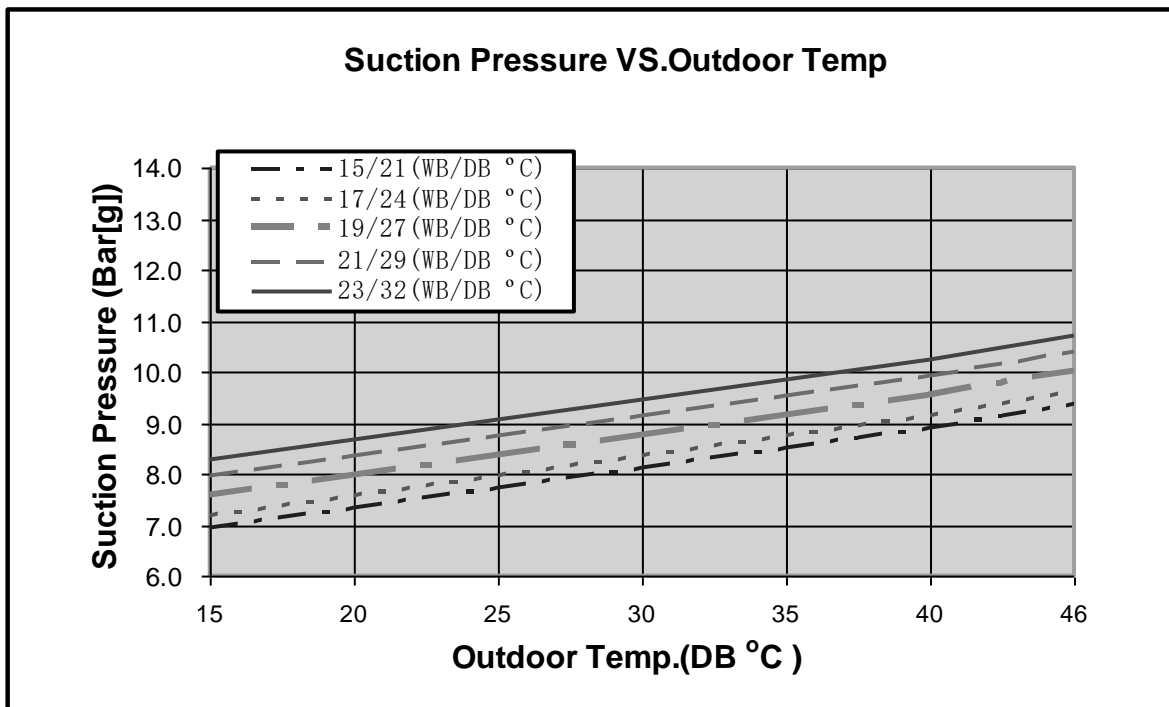

5.1.6.2 Heating

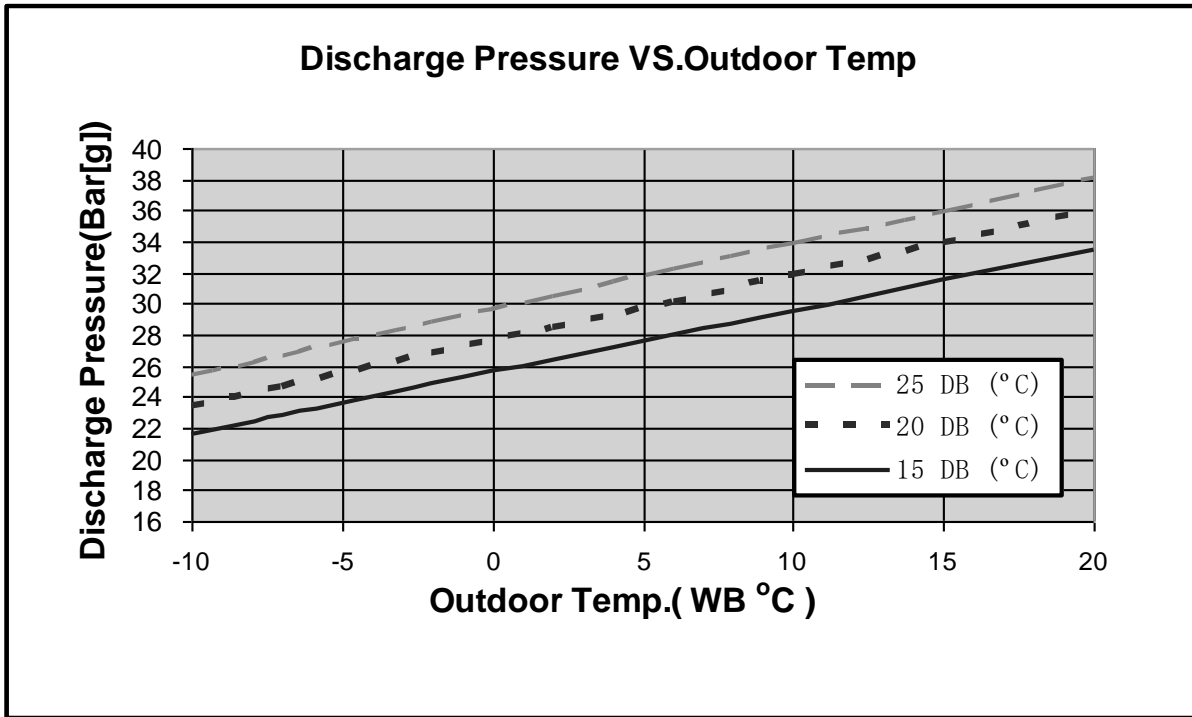

5.4 HGF024 / HHF024 // YGF024

5.4.1 Cooling Capacity (kW)

Entering Air DB OD Coil(°C)	Data	Entering Air WB/DB ID Coil(°C)				
		15/21	17/24	19/27	21/29	23/32
20	TC	6.28	6.62	6.82	6.99	7.14
	SC	4.14	4.36	4.54	4.67	4.76
	PI	1.46	1.47	1.47	1.48	1.48
25	TC	5.94	6.41	6.74	6.95	7.11
	SC	4.03	4.28	4.51	4.64	4.72
	PI	1.58	1.59	1.60	1.61	1.62
30	TC	5.55	6.05	6.53	6.77	6.97
	SC	3.90	4.15	4.41	4.54	4.63
	PI	1.70	1.73	1.74	1.76	1.77
35	TC	5.14	5.58	6.16	6.46	6.77
	SC	3.71	3.98	4.31	4.43	4.52
	PI	1.84	1.87	1.90	1.91	1.93
40	TC	4.68	5.09	5.55	6.07	6.39
	SC	3.50	3.76	4.08	4.21	4.29
	PI	1.98	2.01	2.05	2.07	2.09
46	TC	4.06	4.44	4.88	5.39	5.81
	SC	3.22	3.45	3.72	3.85	3.93
	PI	2.17	2.20	2.25	2.28	2.31

LEGEND

- TC – Total Cooling Capacity, kW
- SC – Sensible Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor


5.4.2 Heating Capacity (kW)

ENTERING WB OD COIL(°C)	ENTERING AIR DB ID COIL(°C)					
	15		20		25	
	TH	PI	TH	PI	TH	PI
-10	3.41	1.52	3.28	1.62	3.15	1.70
-7	3.67	1.56	3.54	1.64	3.41	1.73
-2	3.90	1.58	3.77	1.67	3.64	1.77
2	4.75	1.65	4.55	1.76	4.36	1.86
6	6.70	1.78	6.50	1.90	6.27	2.02
10	7.28	1.88	7.09	2.00	6.89	2.14
15	7.87	1.96	7.67	2.11	7.48	2.24
20	8.29	2.01	8.09	2.19	7.87	2.36


LEGEND

- TH – Total Heating Capacity, kW
- PI – Power Input, kW
- WB – Wet Bulb Temp., (°C)
- DB – Dry Bulb Temp., (°C)
- ID – Indoor
- OU – Outdoor

5.1.7 Curves
5.1.7.1 Cooling

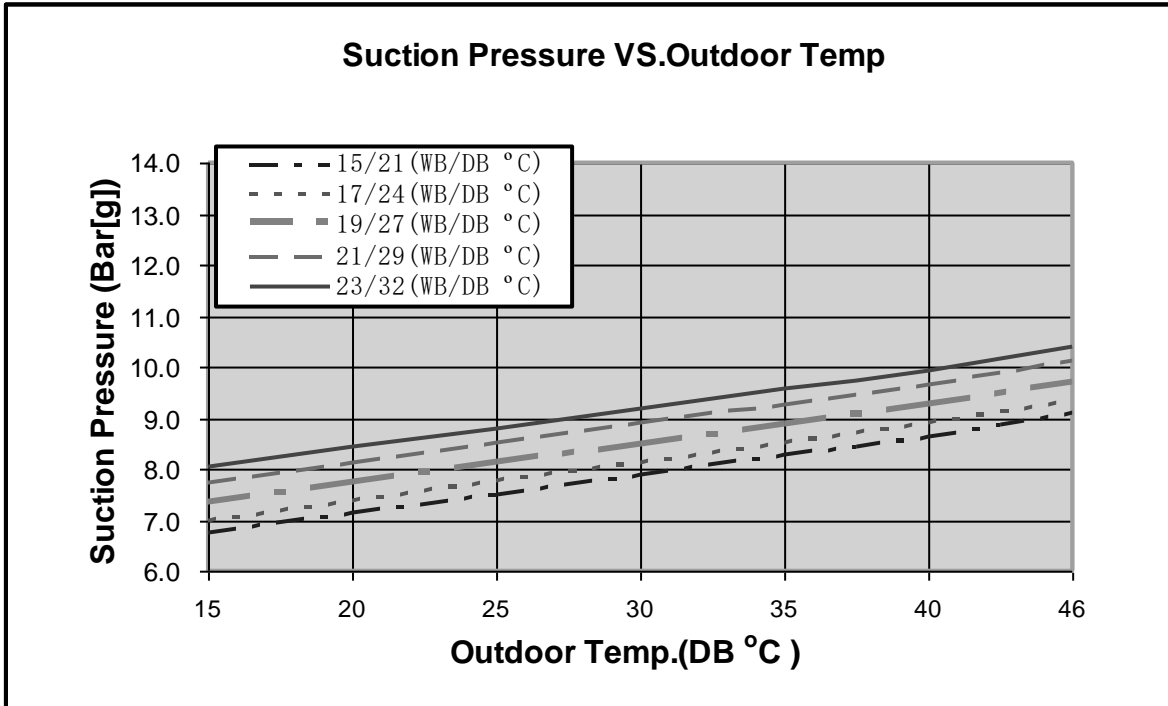

5.1.7.2 Heating

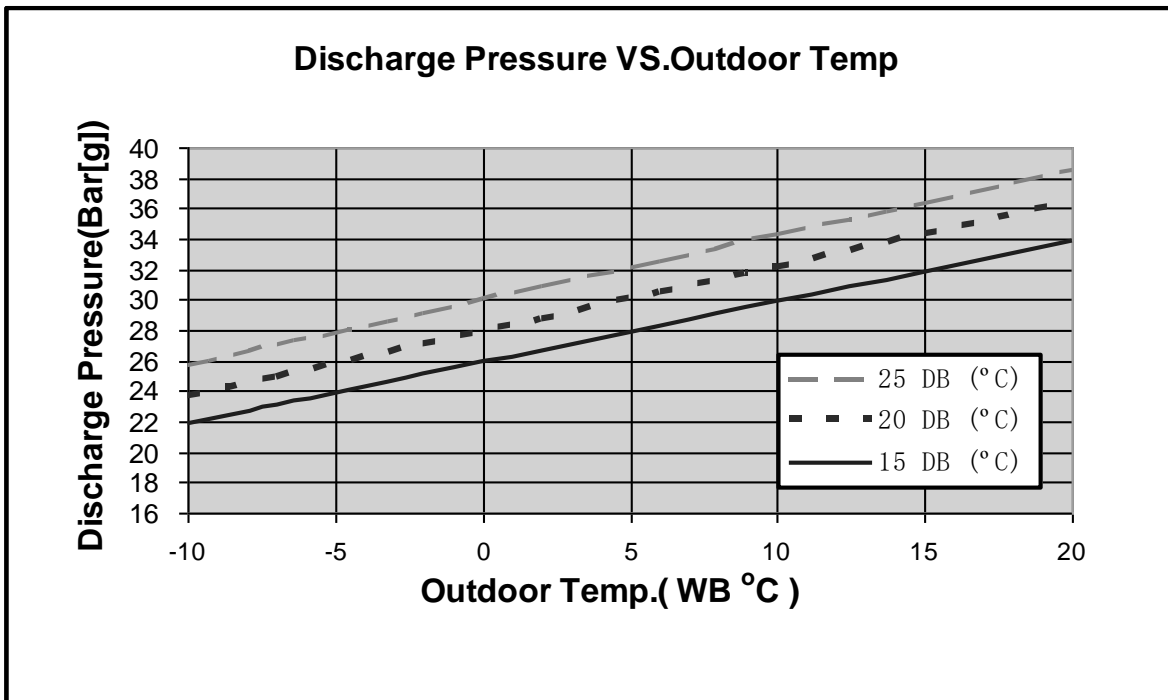

6. SOUND LEVEL CHARACTERISTICS

6.1 Sound Pressure Level - Indoor


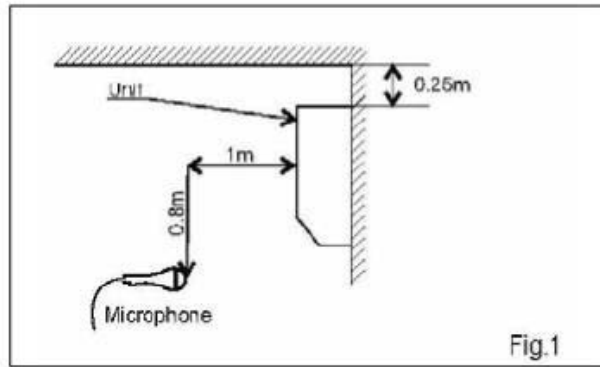



Figure 1. Wall Mounted

6.2 Sound Pressure Level Spectrum - Indoor (Measured as Figure 1)


HGF007 / HHF007 / HGF009 / HHF009
Cooling

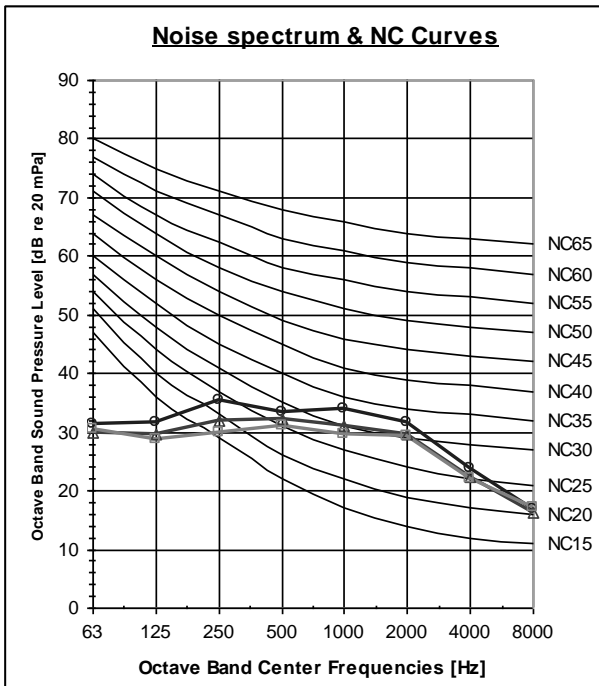


HGF007 / HHF007 / HGF009 / HHF009
Heating

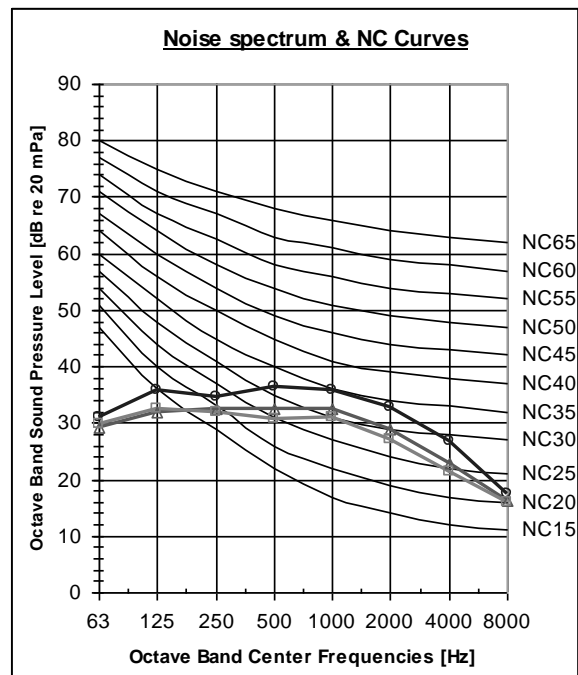


HGF012 / HHF012
Cooling

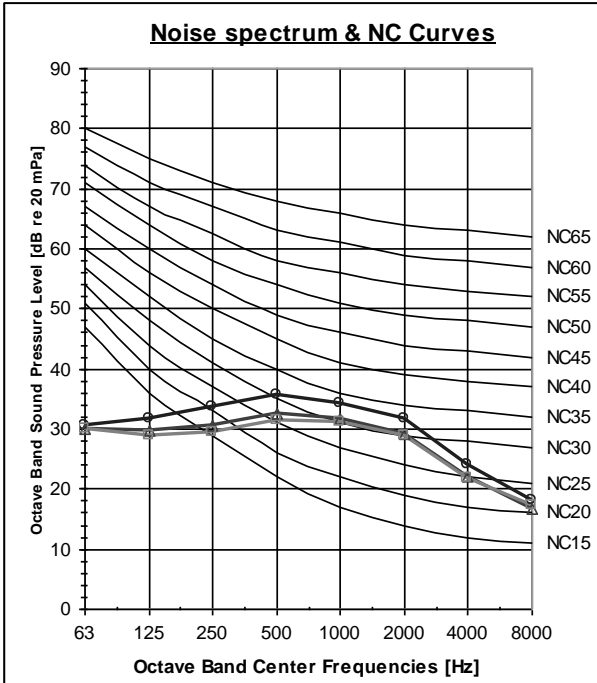


HGF012 / HHF012
Heating

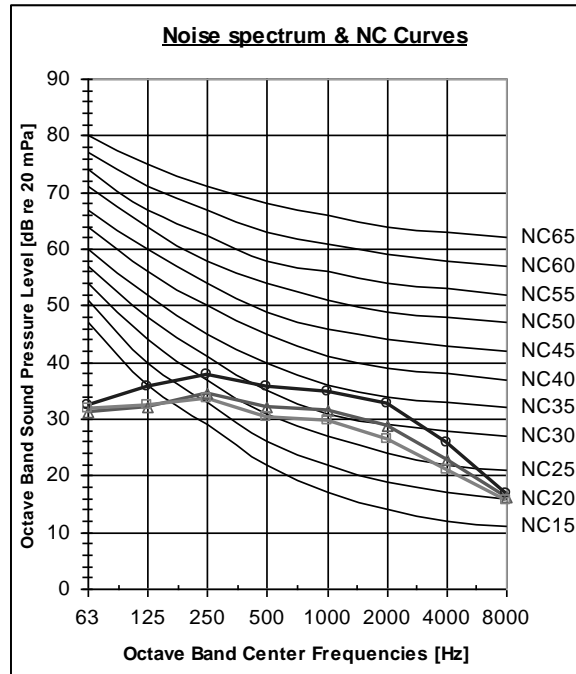


HGF018 / HHF018
Cooling

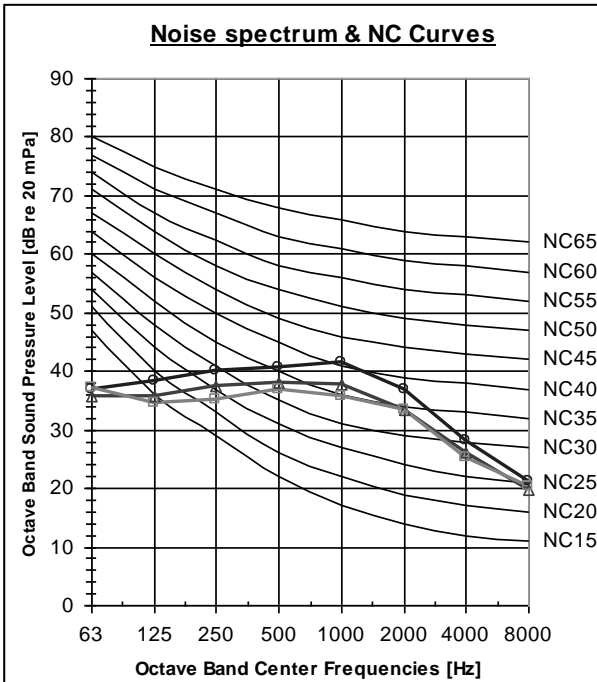


HGF018 / HHF018
Heating

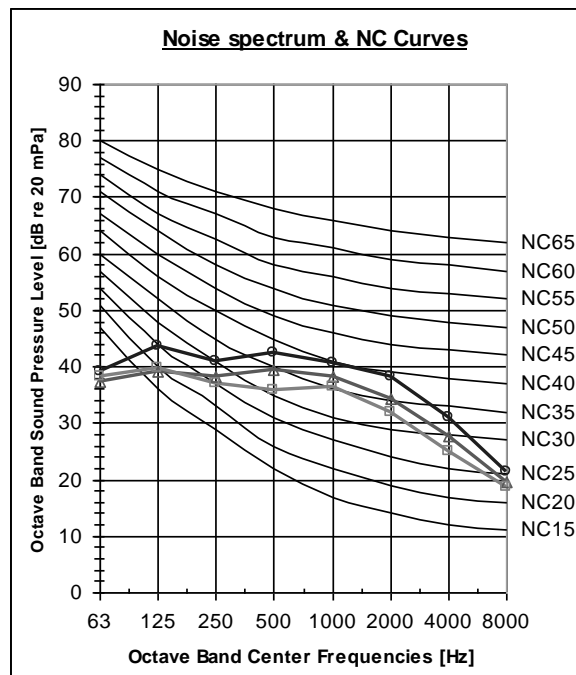


**HGF024 / HHF024
Cooling**

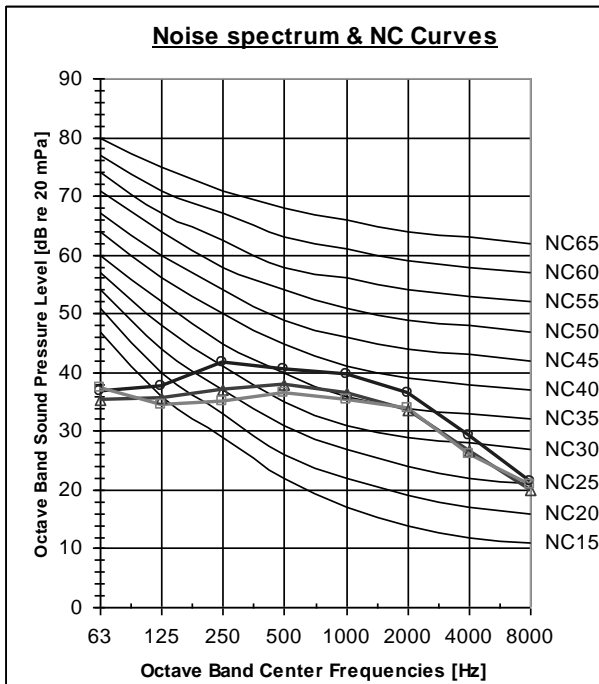

**HGF024 / HHF024
Heating**

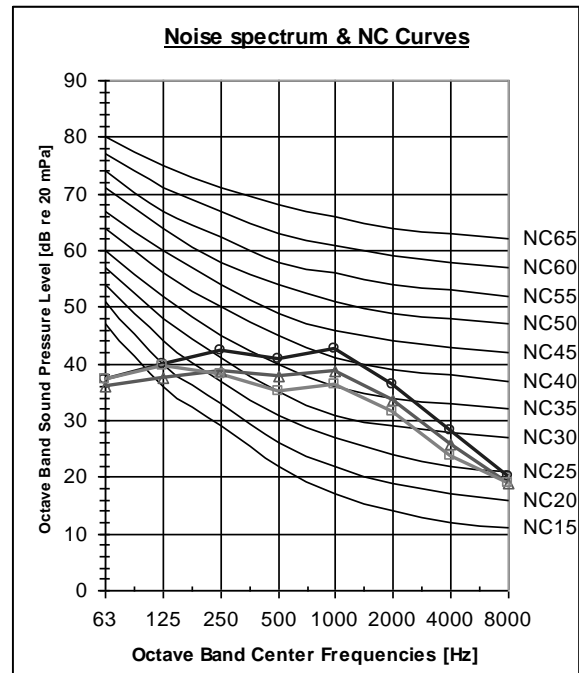



6.3 Sound Pressure Level - Outdoor

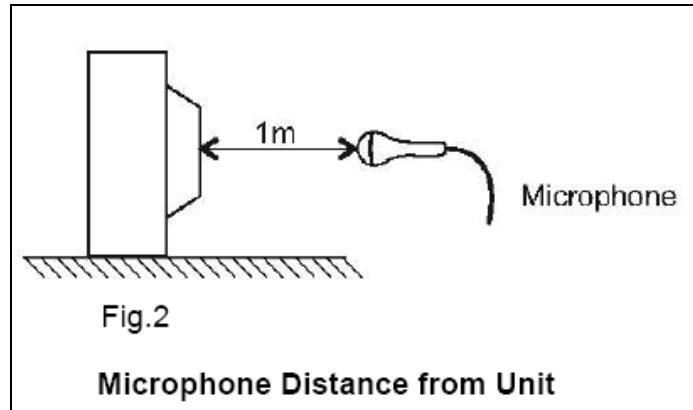


6.4 Sound Pressure Level Spectrum - Outdoor (Measured as Figure 1)

**YGF007
Cooling**


**YGF007
Heating**

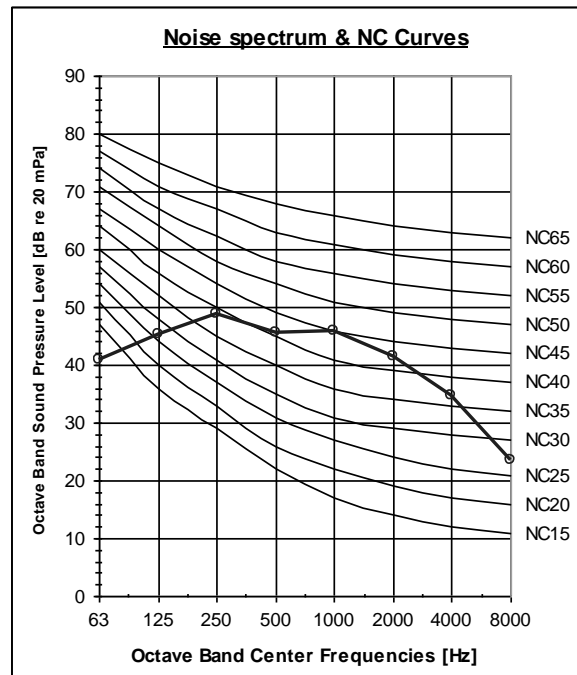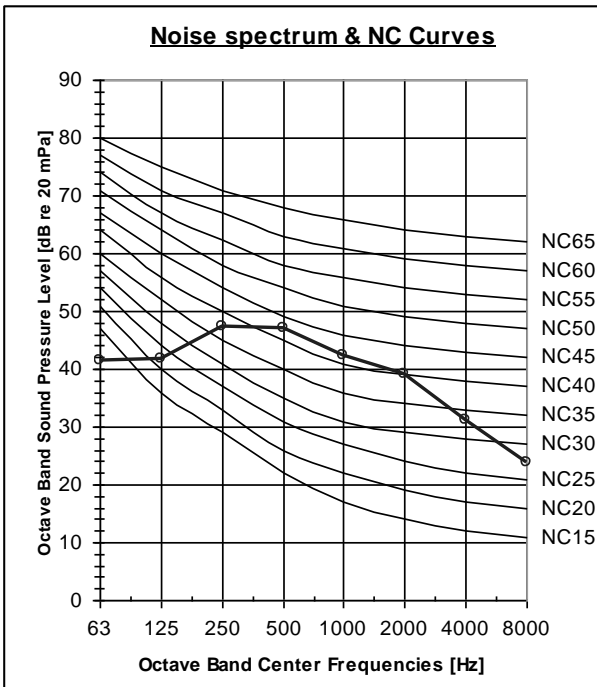


**YGF009
Cooling**

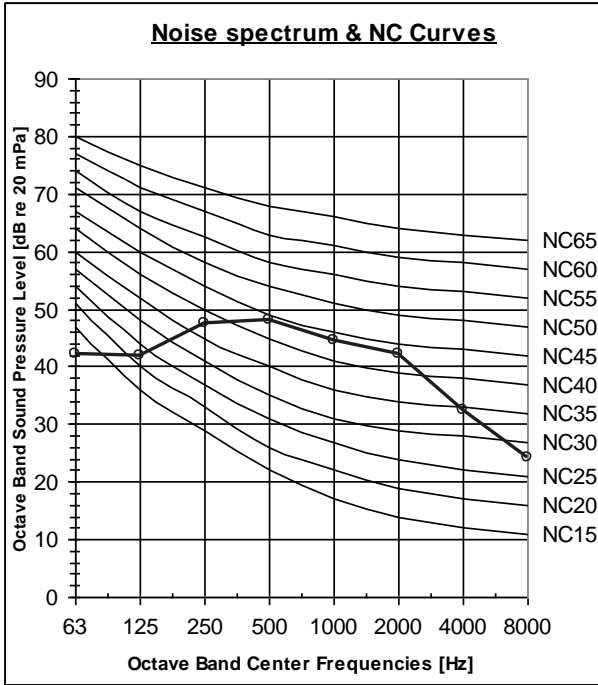


**YGF009
Heating**

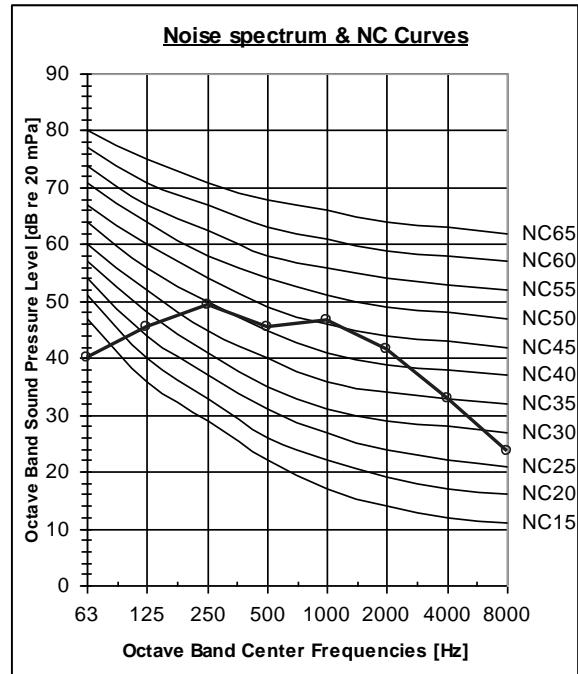


**YGF012
Cooling**

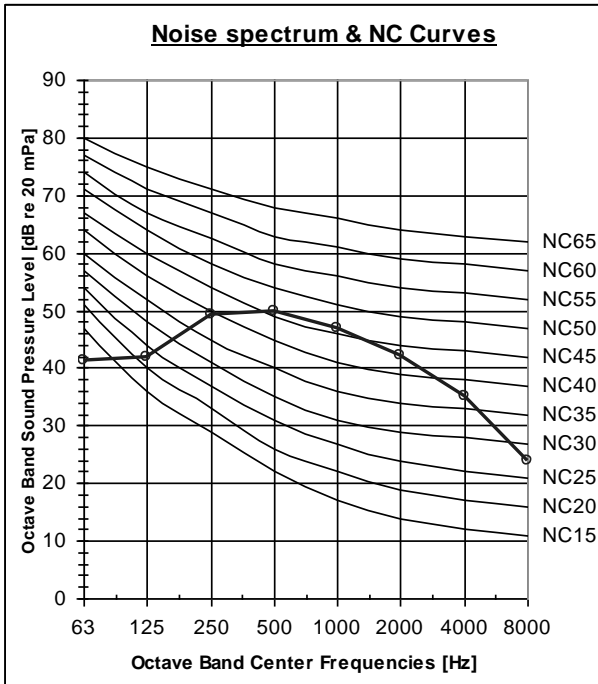


**YGF012
Heating**

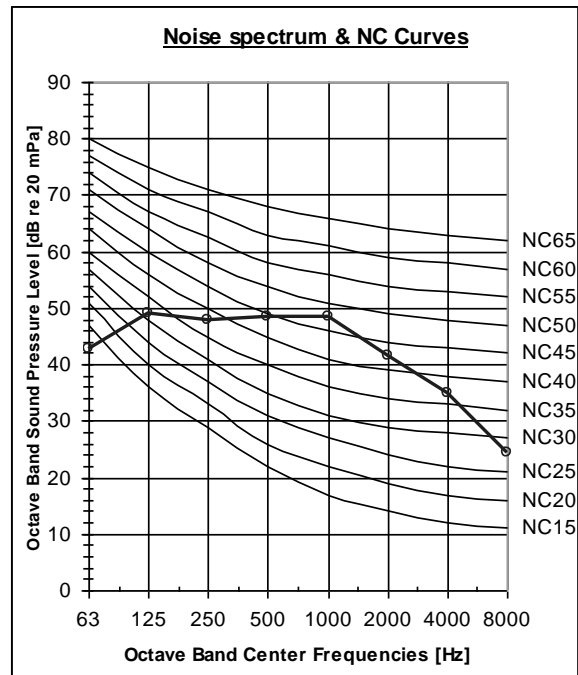


**YGF018
Cooling**

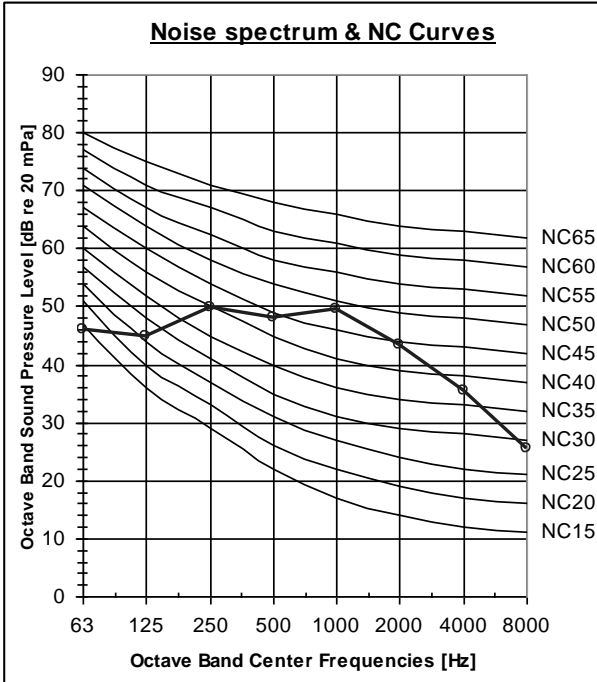


**YGF018
Heating**

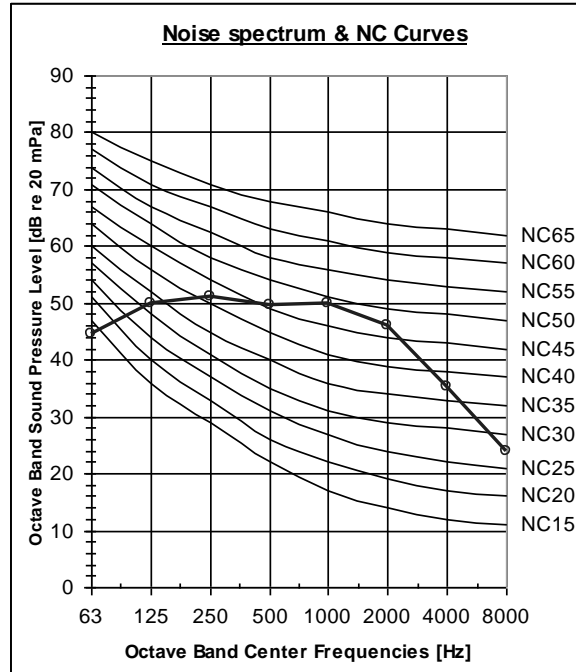

**YGF024
Cooling**

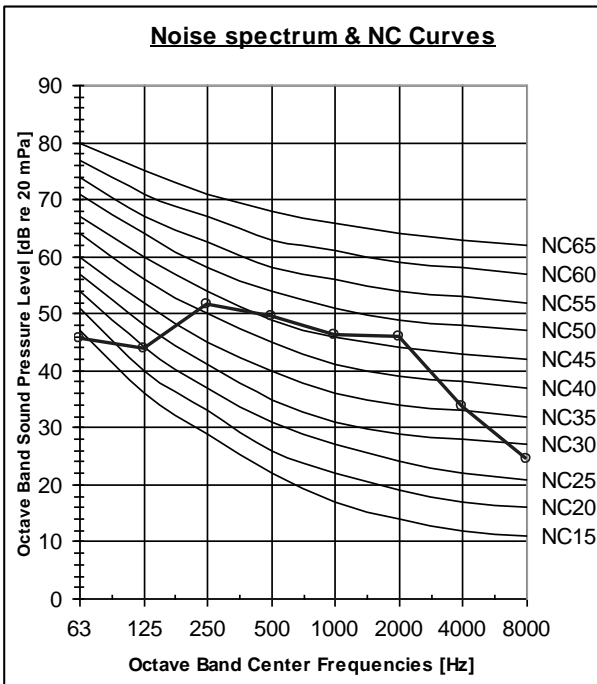

**YGF024
Heating**

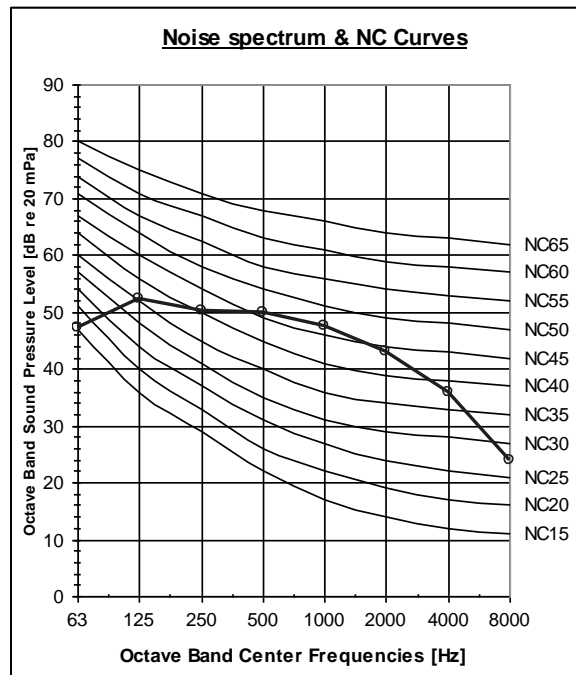

7. ELECTRICAL DATA


MODEL	YGF007	YGF009	YGF012	YGF018	YGF024
Power Supply	To indoor				
	1PH-220-240V-50Hz				
Max Current, A	5.0A	5.3A	6.8A	11.3A	12.7
Circuit Breaker, A	10A	10A	16A	25A	25A
Power Supply No. X Cross Section mm ²	3x1.0			3x2.5	3x2.5
Interconnecting Cable No. X Cross Section mm ²	3X1.0+2X0.75			5x2.5	6x2.5

NOTE


Power wiring cord should comply with local laws and electrical regulations requirements.

8. WIRING DIAGRAM


8.1 HHF007 // YGF007, HGF009 / HHF009 // YGF009

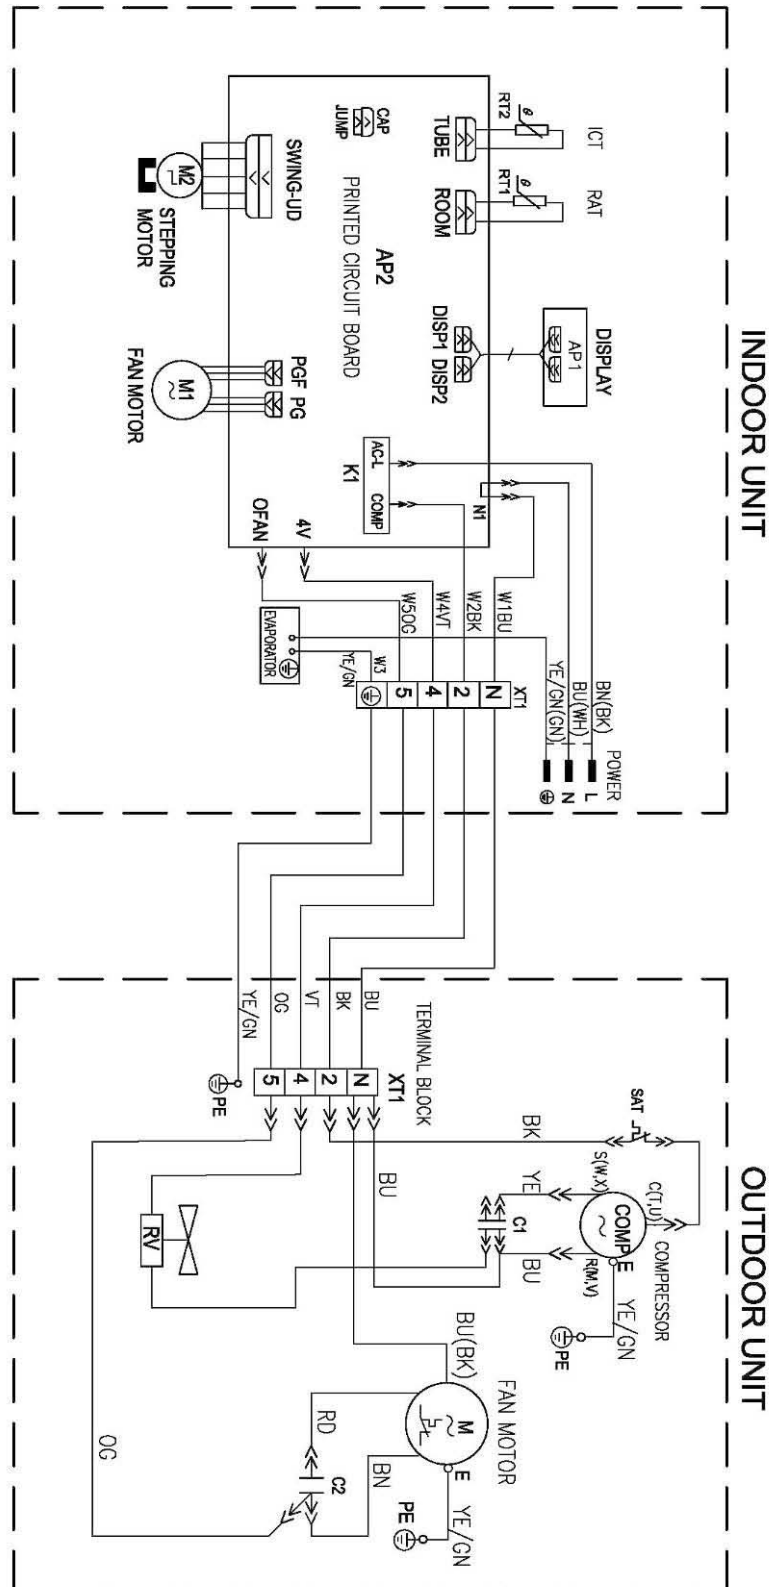


8.2 HGF012 / HGF012 // YGF012

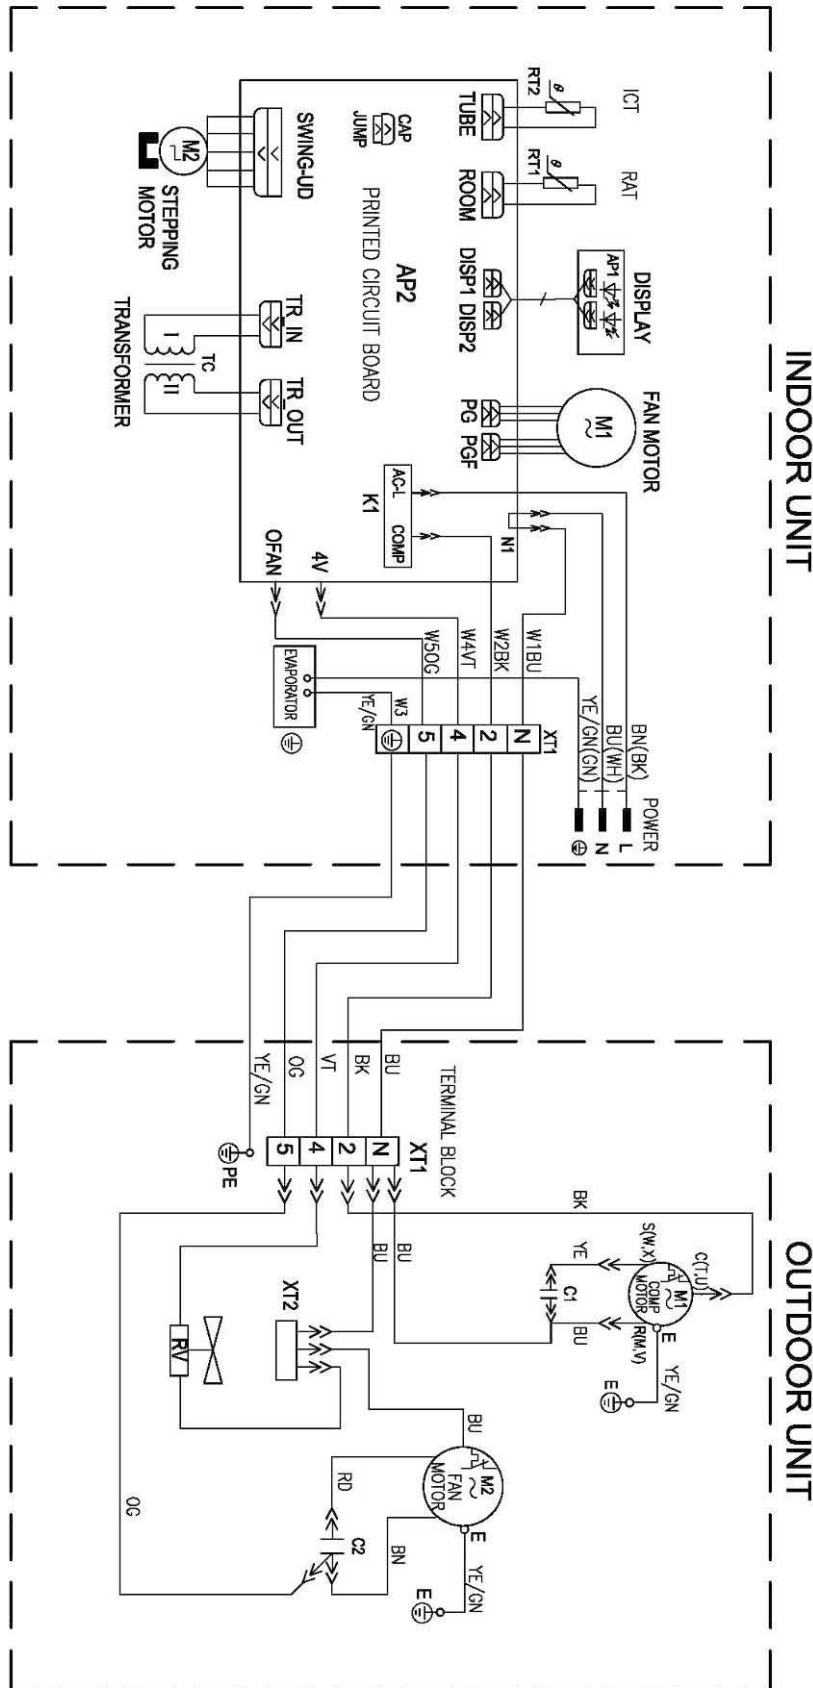


8.3 HGF018 / HHF018 // YGF018

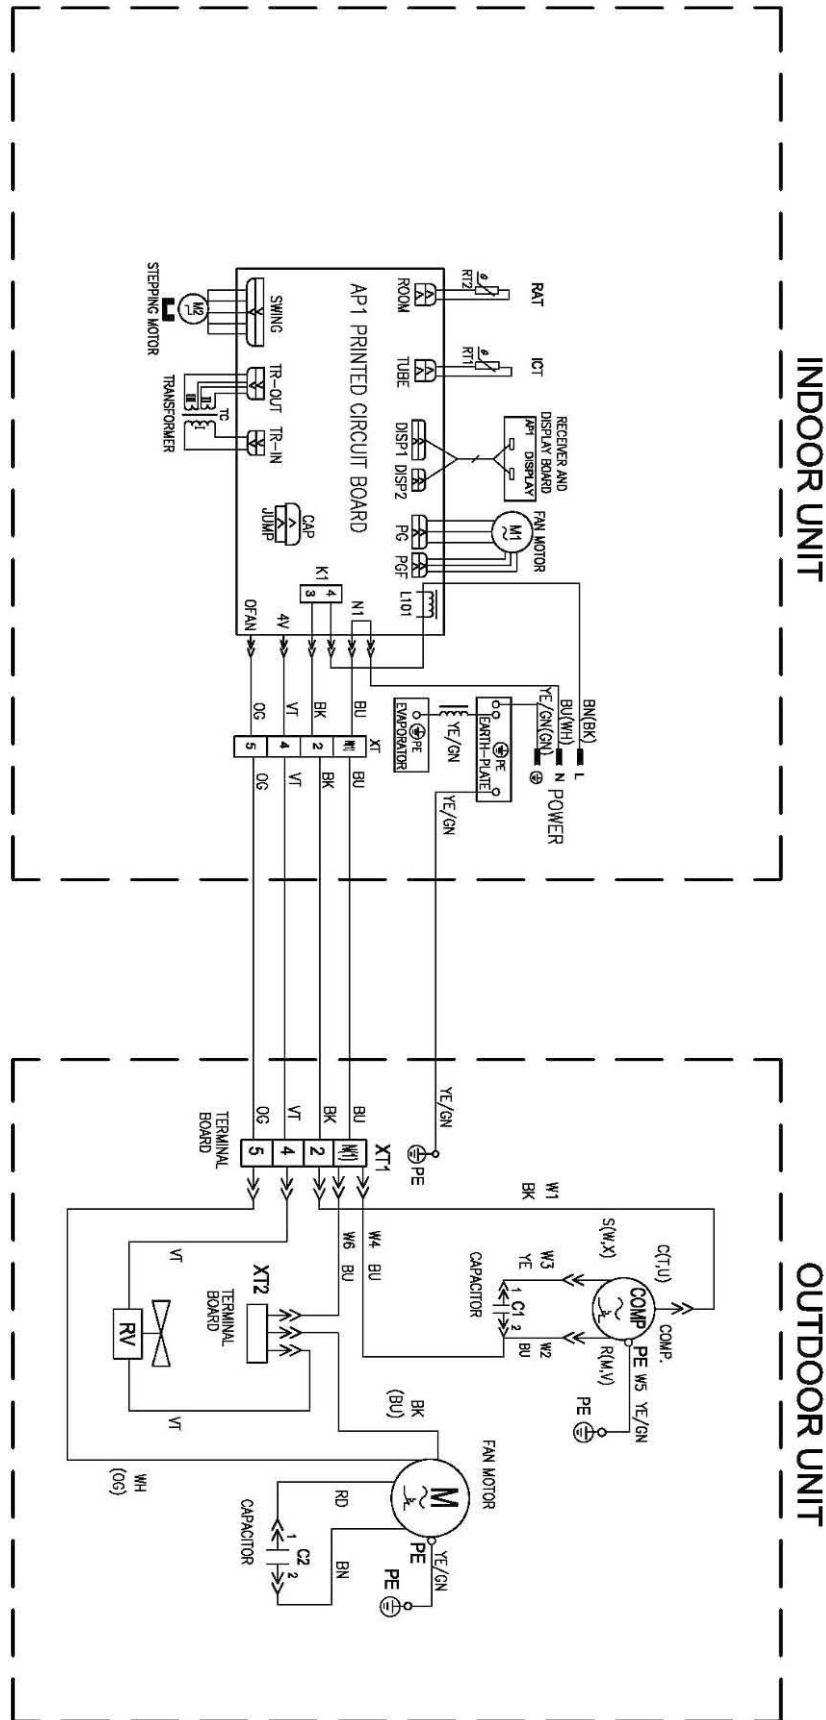



8.4 HGF024 / HHF024 // YGF024

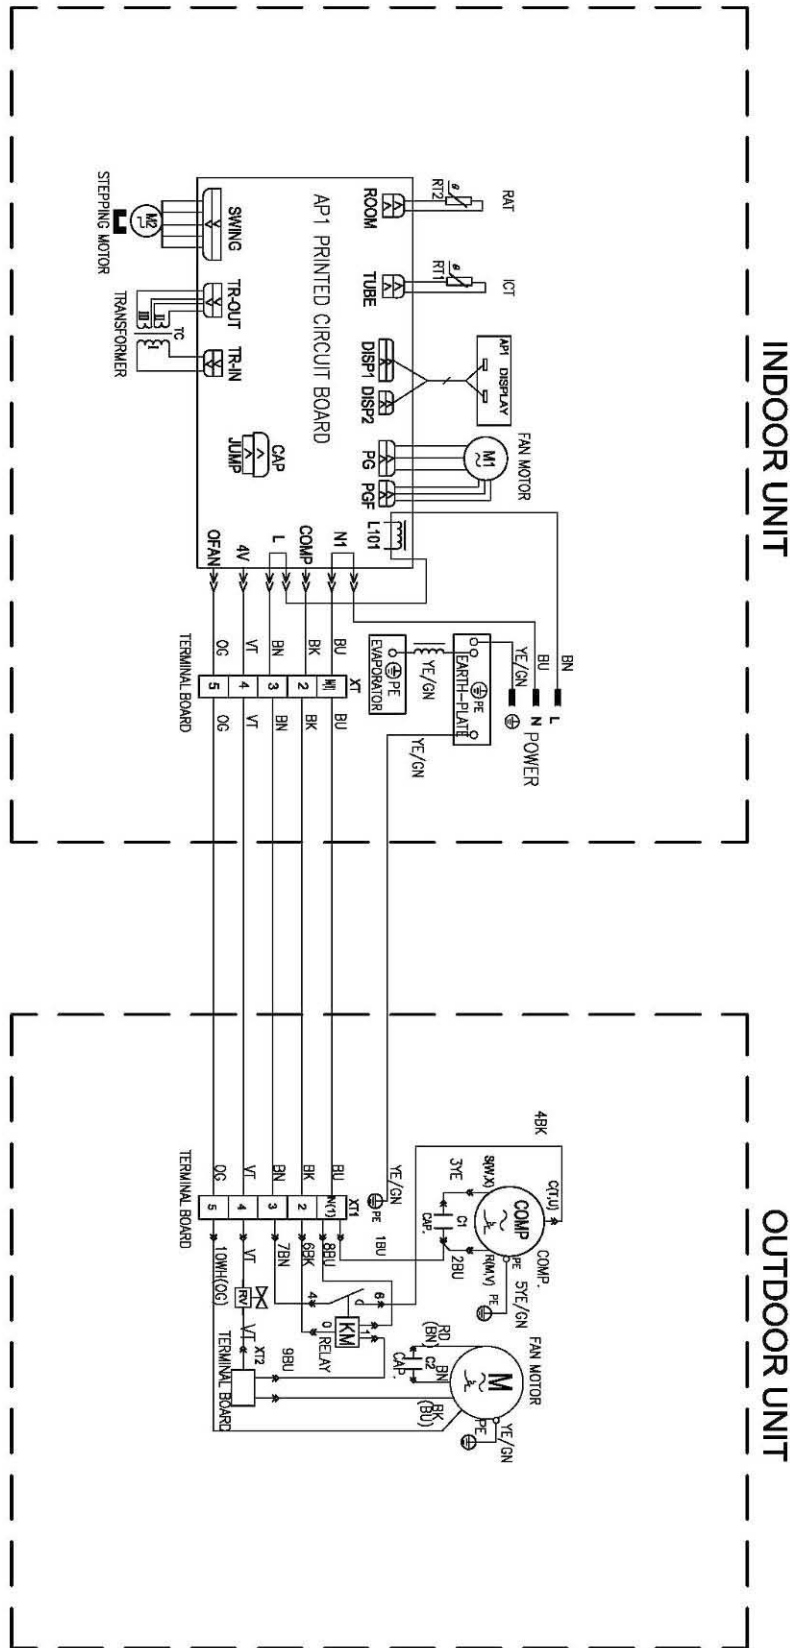

9. REFRIGERATION DIAGRAMS

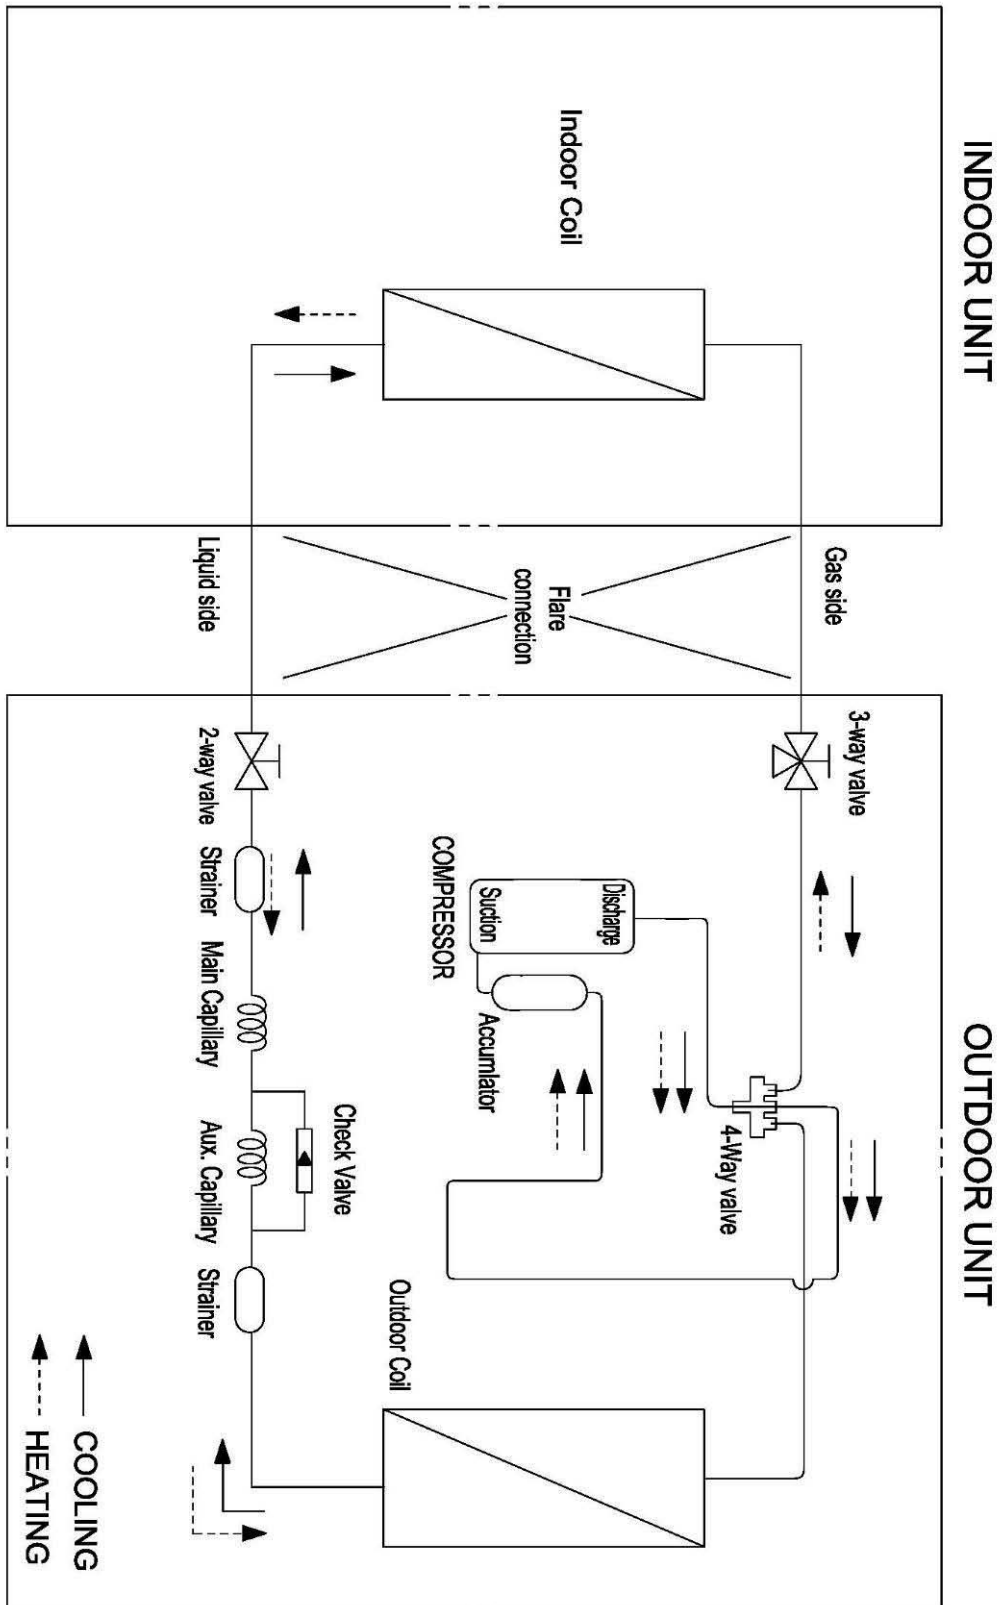

10. TUBING CONNECTIONS

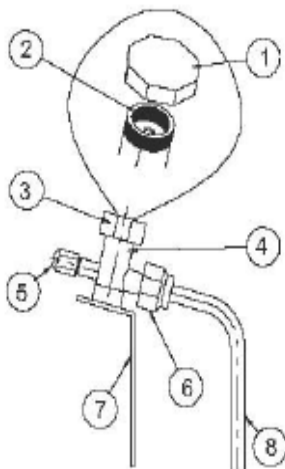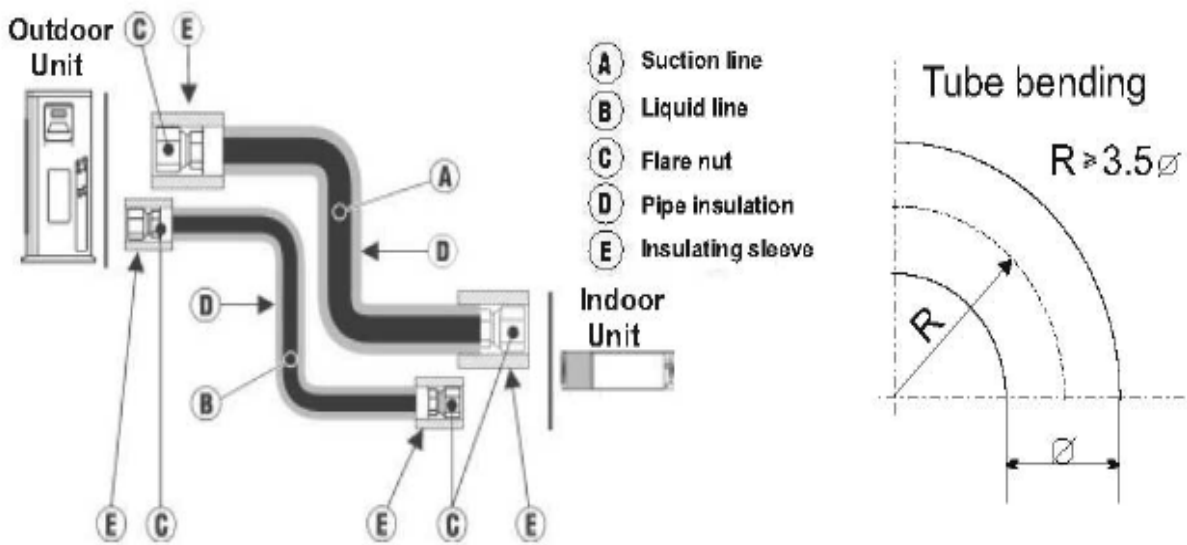

TUBE (Inch)	1/4"	3/8"	1/2"	5/8"	3/4"
TORQUE (Nm)					
Flare Nuts	15-18	40-45	60-65	70-75	80-85
Valve Cap	13-20	13-20	18-25	18-25	40-50
Service Port Cap	11-13	11-13	11-13	11-13	11-13

1. Valve Protection Cap-end
2. Refrigerant Valve Port (use Allen wrench to open/close)
3. Valve Protection Cap
4. Refrigerant Valve
5. Service Port Cap
6. Flare Nut
7. Unit Back Side
8. Copper Tube

When the outdoor unit is installed above the indoor unit an oil trap is required every 5m along the suction line at the lowest point of the riser. In case the indoor unit is installed above the outdoor, no trap is required.

11. CONTROL SYSTEM

11.1 Electronic Control

11.1.1 Abbreviations

AC	-Alternate Current
A/C	- Air-Conditioner
ANY	- ON or OFF status
COMP	- Compressor
CPU	- Central Processing Unit
E2PROM, EEP	- Erase Enable Programmable Read Only Memory
H/W	- Hardware
ICT	- Indoor Coil Temperature sensor
IF, IFAN	- Indoor Fan
IR	- Infra Red
Max	- Maximum
Min	- Minimum
min	- Minute (time)
NA	- Not Applicable
OCT	- Outdoor Coil Temperature sensor
OF, OFAN	- Outdoor Fan OPER - Operate Para. - Paragraph
RAT	- Return Air Temperature (RT1) sensor
RC	- Reverse Cycle (Heat Pump)
R/C	- Remote Control
RCT	- Remote Control Temperature
RH	- Resistance Heater
RV	- Reversing Valve
SB, STBY	- Stand-By
Sec	- Second (time)
Sect	- Section
SH	- Supplementary Heater
SPT	- Set Point Temperature
ST	- Standard (a Model with Cooling Only)
S/W	- Software
TEMP	- Temperature
W/O	- Without

11.1.2 System Operation Concept

11.1.3 Compressor operation

For each Mode including POWER OFF & SB, a Min time delay of 3 min before COMP restarting except during outdoor deicing.

Whenever COMP starts, it will not stop in 6 min even the RAT is changed.

* For the units with memory function, the 1st time of Power ON, there will be no 3 min delay if the previous stage of unit is OFF.

11.1.4 Indoor Fan Control

8 Indoor fan speeds are determined for each model. 4 speeds for COOL modes and 4 speeds for HEAT mode.

Unit Model	Mode	Turbo(Super high)	High	Medium	Low
07	Cooling	1390	1280	1180	1080
	Heating	1350	1250	1140	1040
09	Cooling	1390	1280	1180	1080
	Heating	1350	1250	1140	1040
12	Cooling	1350	1250	1100	950
	Heating	1350	1250	1100	950
18	Cooling	1350	1200	1050	900
	Heating	1350	1200	1050	900
24	Cooling	1350	1200	1050	900
	Heating	1420	1250	1150	900

In high/ medium/ low indoor fan user setting, unit will operate fan in selected speed.

In AutoFan user setting, fan speed will be adjusted automatically according to the difference between actual room temperature(RAT) and user set point temperature(SPT).

Indoor Fan speed		High	Medium	Low
RAT-SPT	Cooling	≥ 2	(0,2)	≤ 0
	Heating	≤ 1	(1,3)	≥ 3

During Auto Fan operating, one speed should keep at least 210sec operating before switching to other speeds.

In DRY mode, the automatic fan speed is forced to be low.

11.1.4.1 Turbo Speed

In COOL and HEAT mode (not available in AUTO, DRY, FAN mode), press the Turbo button, the super high fan speed is selected on Remote control and the indoor fan rotates at super high speed.

CONTROL SYSTEM

11.1.5 Outdoor Fan Control

11.1.5.1 OFAN Speed Type

The OFAN motor is a one speed AC motor and controlled by the relay on outdoor controller.

11.1.5.2 General rules

1. The OFAN is ON when COMP ON during Cool, Dry and Heat Mode.
2. When the unit is off by remote control, in safety stops and stop after reaching to the temperature point, the outdoor fan stops.
3. Outdoor fan OFF will compressor when COMP is OFF during cooling and heating mode.

11.1.6 Refrigerant control

Capillary is used in each mode.

11.1.7 Reversing Valve (RV) Control

Reversing valve is on in heat mode.

Switching of RV state is done only after COMP is off for over 2 minutes.

11.2 Fan Mode

In this mode, the IFAN may run at high, medium, low and automatic speed. The COMP, OFAN and RV will be OFF.

In this mode, the range of setting temperature is 16~30C

11.3 Cool Mode

If $RAT \geq SPT + 1$, the unit starts cooling operation. In this case, the COMP and OFAN will operate and the IFAN will run at the setting speed.

If $RAT \leq SPT - 1$, the COMP and OFAN will stop operating, while the IFAN will run at the setting speed.

If $SPT - 1 < RAT \leq SPT + 1$, the unit will maintain the previous status.

In AutoFan user setting, fan speed will be adjusted automatically according to the SPT and RAT, refer to 11.1.4

11.4 Heat Mode

If $RAT \leq SPT + 2$, the unit will operate in heating mode. The COMP, OFAN and RV will operate and the IFAN will delay 3min to start at the latest

If $SPT + 2 \leq RAT \leq SPT + 4$, the unit will maintain the previous status.

If $RAT \geq SPT + 4$, the COMP and OFAN will stop and the IFAN will blow for 60s at setting speed.

During this period, the fan speed cannot be switched.

11.4.1 Indoor Fan Control in Heat Mode

IFAN speed depends on the indoor coil temperature

Anti-cold air function

When starting the heating mode, anti-cold air function will be activated and IFAN can run at low speed or stop running. This function will terminate after the unit runs for 2min or the ICT reaches 40 degree.

Residual heat blowing function

During heating, when the stopping condition for the COMP is reached, the COMP and OFAN stop running while the louver moves to position L. The IFAN will stop after running for 60s at setting speed.

11.5 Auto Cool/Heat Mode

In AUTO mode, the system selects the running mode (COOL/HEAT/FAN) automatically according to the room temperature. The display shows the actual running mode and setting temperature.

There will be 30s delay for mode conversion.

1. When $RAT \geq 25$ degree, the cooling mode is selected.
2. When $RAT \leq 20$ degree, the unit runs in heating mode
3. When $20 \text{ degree} < RAT < 25 \text{ degree}$, upon initial startup, the unit will enter auto mode and run in automatic fan mode. If the other mode changes into auto mode, the previous running mode will remain.

11.6 Dry Mode

If $RAT \geq SPT + 2$, the unit starts cooling operation. In this case, the COMP and OFAN will operate and the IFAN will run at the low speed.

If $RAT \leq SPT - 2$, the COMP and OFAN will stop. While IFAN will run at low speed.

If $SPT - 2 < RAT \leq SPT + 2$, While IFAN will run at low speed. COMP and OFAN will operation in 6 min ON and 4 min OFF in cycling.


In this mode, the RV will be OFF and the temperature setting range is 16~30.

11.7 Louver Control

After power on, the up and down swing louver will automatically open and then close completely.

In heating mode, if the swing function is not set, the up and down louver will rotate to maximum in clockwise direction. Then it will rotate to position D. Under other states, the upper and lower air deflector will rotate to level L.

If the swing function is set when starting the unit, the louver will swing between Position L and D. there are 7 states for louver: in

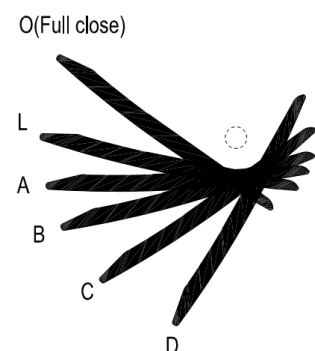

position L, A, B, C, D, and swing between L and D, stop in any place between Position L and position D. When the unit is turned off, the air deflector will stay in position 0.

The swing is available only when the swing function is set and the indoor fan is running. The louver swing can also be set between L and B, between A and C, between B and D.

11.8 Protections

11.8.1 Indoor Coil Defrost Protection

During Cool Mode/Dry Mode, this protection prevents freezing of the indoor heat exchanger.

When $ICT \leq 0\text{ C}$ for continuous 3 mins, COMP and OFAN will stop and IFAN will run at its setting speeds.

The system will resume its previous status if the protection is cleared and COMP OFF time is 3 min. (COMP OFF time will be 4 min during the 6 min ON and 4 min OFF cycling during Dry Mode)

11.8.2 Indoor Coil over Heating Protection

During Heat Mode, this protection prevents abnormal high pressure.

When ICT reaches 58C, OFAN will stop operating and resume operating if the ICT go to normal.

11.8.3 Over Current Protection

Detect an input current by the CT during the COMP is running.

If the current is high than 22A for continuous 3 sec, COMP and OFAN will stop, IFAN will run at setting speed.

The system will resume its previous status if the protection is cleared and COMP stops for 3 min.

If the unit stops as such protection for 6 times,(the counter will be cleared after the compressor has run for 6min), it cannot resume running automatically and display malfunction, it can resume by pressing ON/OFF.

11.8.4 Outdoor Coil Deicing Protection

This protection is for Heat Pump Only

This protection is carried out by the cooling cycle (reverse cycle). The defrosting time or outdoor heat exchanger temperature must be more than its setting values when finishing the deicing protection.

In the deicing protection, IFAN is forced OFF.

11.8.4.1 Deicing Starting Conditions

The starting conditions must be made with the room air temperature (RAT) and indoor coil temperature (ICT) and the trend of changing. Under the conditions that the system is in heating

operation, after the time for defrosting is judged to be satisfied, the deicing operation will start.

The minimum operating time of heating mode before deicing:

- a) 40 min after 1st time of power on
- b) 5 min after system is STBY by RC or temperature condition.

11.8.4.2 Deicing Protection Procedure

- 1. Start to defrost: COMP stops and starts up 55S later
- 2. Start to defrost: Outdoor fan will stop after COMP stops for 50S.
- 3. Defrosting finish: COMP stops and starts up 55S later.
- 4. Defrosting finish: Outdoor fan will start up when the COMP is stopping.







11.8.4.3 Exiting Deicing

The deicing operation depends:

- 1. RAT & ICT and the trend of changing
- 2. The continuous running time of deicing reaches to 12min.

11.9 Indoor Unit Controllers and Indicators


The following shows the indicators of the indoor unit (Layout of display in HGF/HHF has some difference.)

<p>STBY/RUN INDICATOR </p>	<p>Lights up in RED in when the Air Conditioner is connected to power and the mode is STBY. Lights up in GREEN when the when the unit is turned on.</p>
<p>COOL INDICATOR </p> <p>FAN INDICATOR </p> <p>DRY INDICATOR </p> <p>HEAT INDICATOR </p>	<p>Lights up during specified operation mode (COOL/DRY/HEAT).</p>
<p>2* 7 segments display</p> 	<ul style="list-style-type: none"> 1. In normal situation, the setting temperature is displayed. 2. Shows room temperature when receiving the corresponding demand from controller. When received effective RC command, setting temperature will be shown for 5 sec, and then go back to room temperature display. 3. Shows the fault code when there is a fault(Refer to 12.1.3)

11.10 Characteristics of sensor


11.10.1 RAT/OAT

RAT/OAT R-T chart

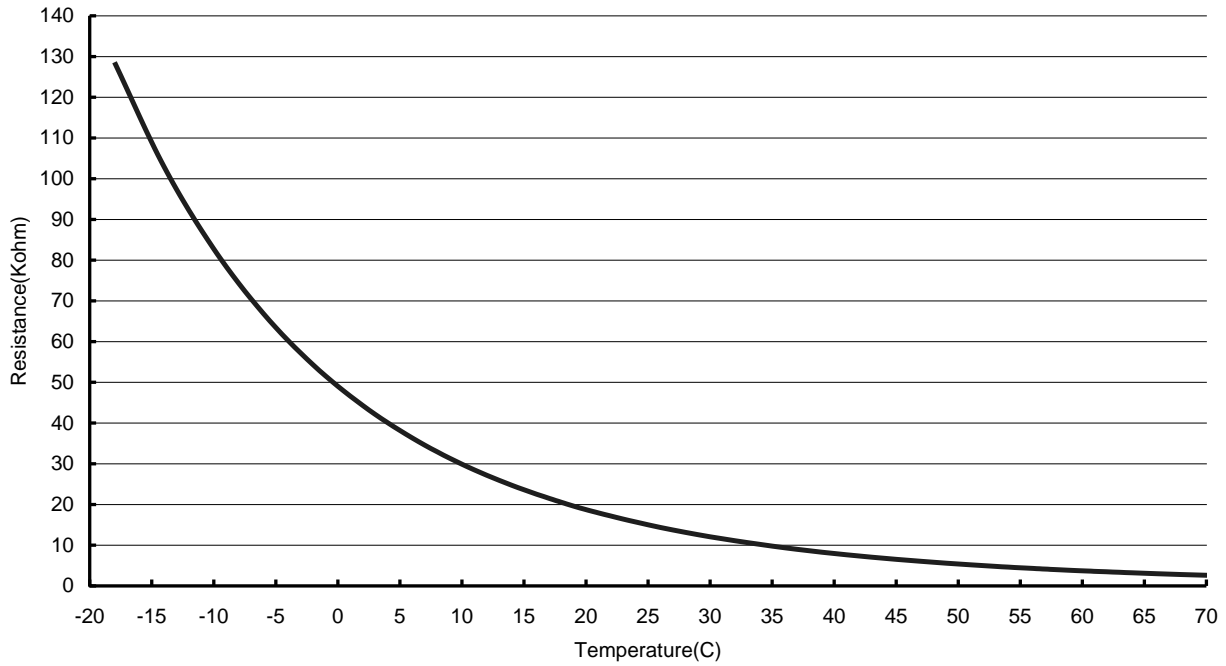


11.10.2 ICT/OCT

ICT/OCT R-T Chart

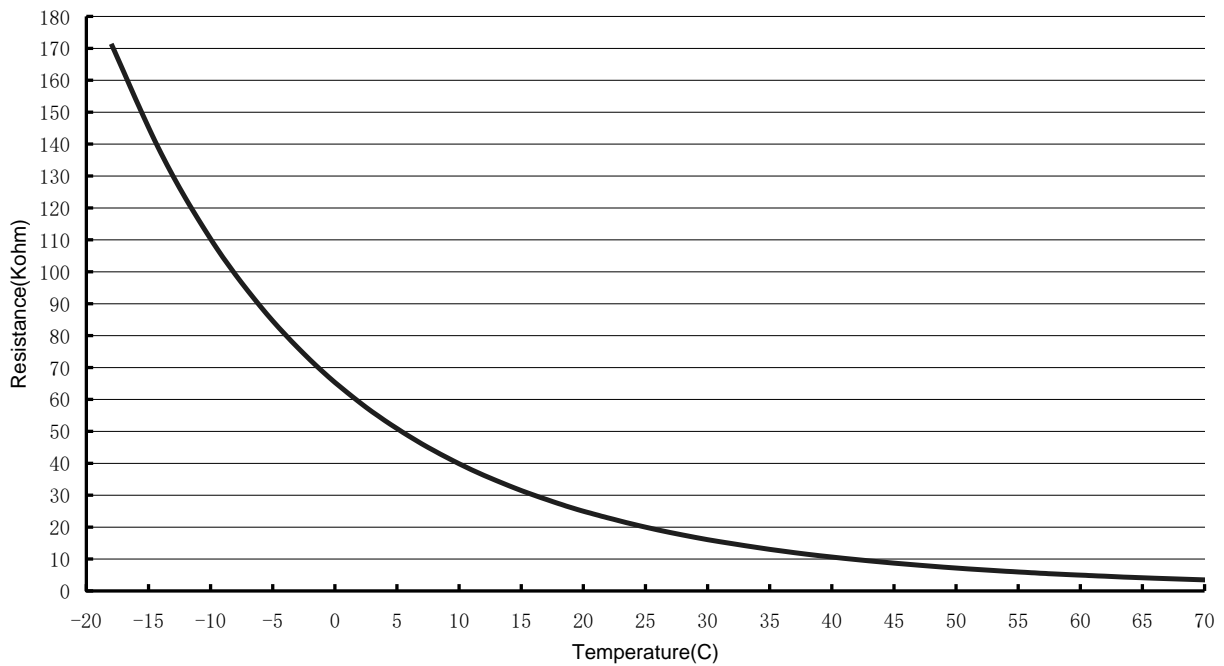

11.10.3 CTT

CTT R-T Chart

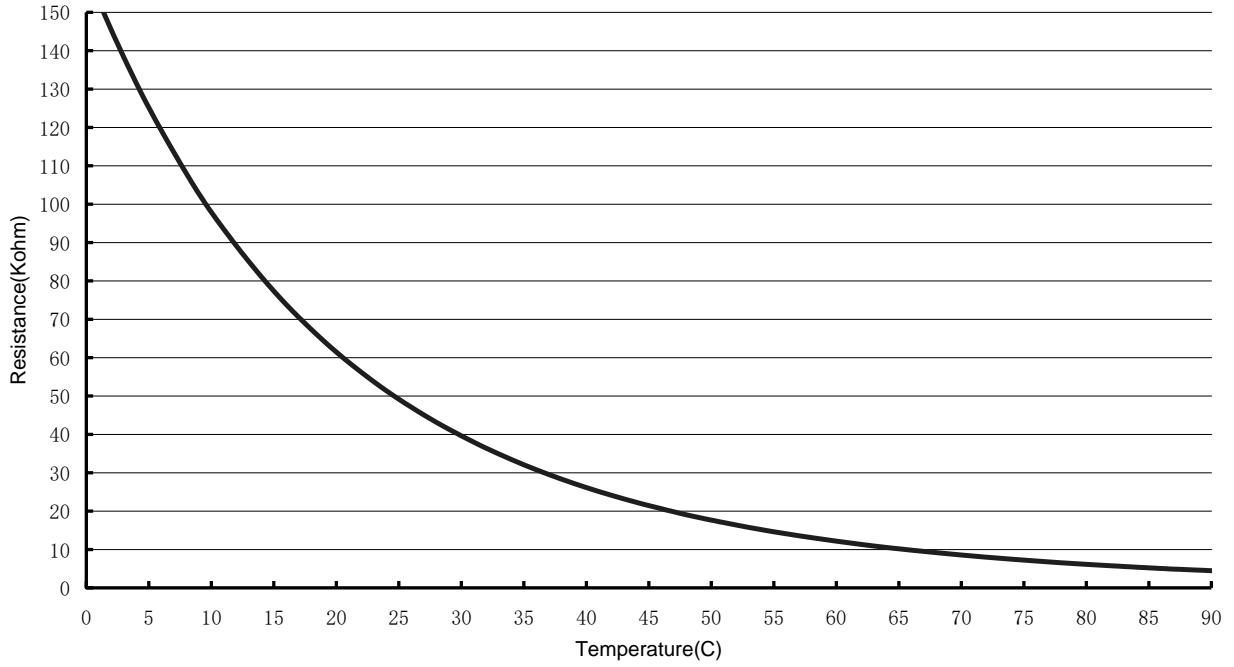

12. TROUBLESHOOTING

12.1 ELECTRICAL & CONTROL TROUBLESHOOTING

12.1.1 Precautions before Performing Inspection or Repair

Be cautious during installation and maintenance. Do operation following the regulations to avoid electric shock and casualty or even death due to drop from high attitude.

* **Static maintenance** is the maintenance during de-energization of the air conditioner. For static maintenance, make sure that the unit is de-energized and the plug is disconnected.

***Dynamic maintenance** is the maintenance during energization of the unit. Before dynamic maintenance, check the electricity and ensure that there is ground wire on the site. Check if there is electricity on the housing and connection copper pipe of the air conditioner with voltage tester. After ensure insulation place and the safety, the maintenance can be performed.

Take sufficient care to avoid directly touching any of the circuit parts without first turning off the power. At time such as when the circuit board is to be replaced, place the circuit board assembly in a vertical position. Normally, diagnose troubles according to the trouble diagnosis procedure as described below. (Refer to the checkpoints in servicing written on the wiring diagrams attached to the indoor/outdoor units.)

12.1.2 Confirmation

12.1.2.1 Confirmation of Power Supply Confirm that the power breaker operates(ON) normally;

12.1.2.2 Confirmation of Power Voltage Confirm that power voltage is AC220~240V +/- 10%. If power voltage is not in this range, the unit may not operate normally.

12.1.3 Judgment by Indoor/Outdoor Unit Diagnostics

If the malfunction still exists 4min later after stop of unit due to compressor protection, error code will be directly displayed though indoor display. In other situations, error code can be displayed by pressing LIGHT button 6 times within 4s.

Fault description	2* 7 segments	LEDs blinking (0.5s ON and 0.5s OFF)			Possible Reason
		RUN	COOL	HEAT	
No feedback of indoor motor	H6	11			1. IFAN motor damaged 2. IFAN motor blocked 3. IDU PCB problem
Malfunction protection of jumper cap	C5	15			Poor connection of the jumper on indoor PCB.
Zero-crossing protection (IDU)	U8	17			1. IFAN motor damaged 2. Zero-crossing circuit damaged on IDU PCB
RAT failure	F1		1		1. Sensor connection is not good 2. Sensor was broken or damaged (Refer to Sect 14 to check the sensor value)
ICT failure	F2		2		3. PCB temperature detection circuit has problem

12.2 Simple procedures for checking the Main Parts

12.2.1 Checking Mains Voltage.

Confirm that the Mains voltage is between 198 and 264 VAC. If Mains voltage is out of this range, abnormal operation of the system is expected. If in range check the Power (Circuit) Breaker and look for broken or loosed cable lugs or wiring mistake(s).

12.2.2 Checking Power Input.

If Indoor unit power LED is unlighted, power down the system and check the fuse of the Indoor unit. If the fuse is OK replace the Indoor unit controller. If the fuse has blown, replace the fuse and power up again.

12.2.3 Checking the Outdoor Fan Motor.

Run the unit in Cool/Heat/Dry mode (where the OFAN speed is high)
Check the voltage between two terminals(N and 5), normal voltage is 220-240VAC.

12.2.4 Checking the Compressor.

The compressor is rotary compressor with single-phase power input. It includes two windings of main and auxiliary. Check the resistance of terminal R and C and resistance of terminal S and C. If the windings is open or short, compressor should be replaced.


Pay attention, for the wiring connections, please refer to the wiring diagram and have double confirmation before checking the compressor.

12.2.5 Checking the Reverse Valve (RV).

Running in heating mode, check the voltage between two terminals(N and 4), normal voltage is 220-240VAC.

13. EXPLODED VIEW & SPARE PART LIST

13.1 Exploded view of indoor unit: HHF007/HHF009

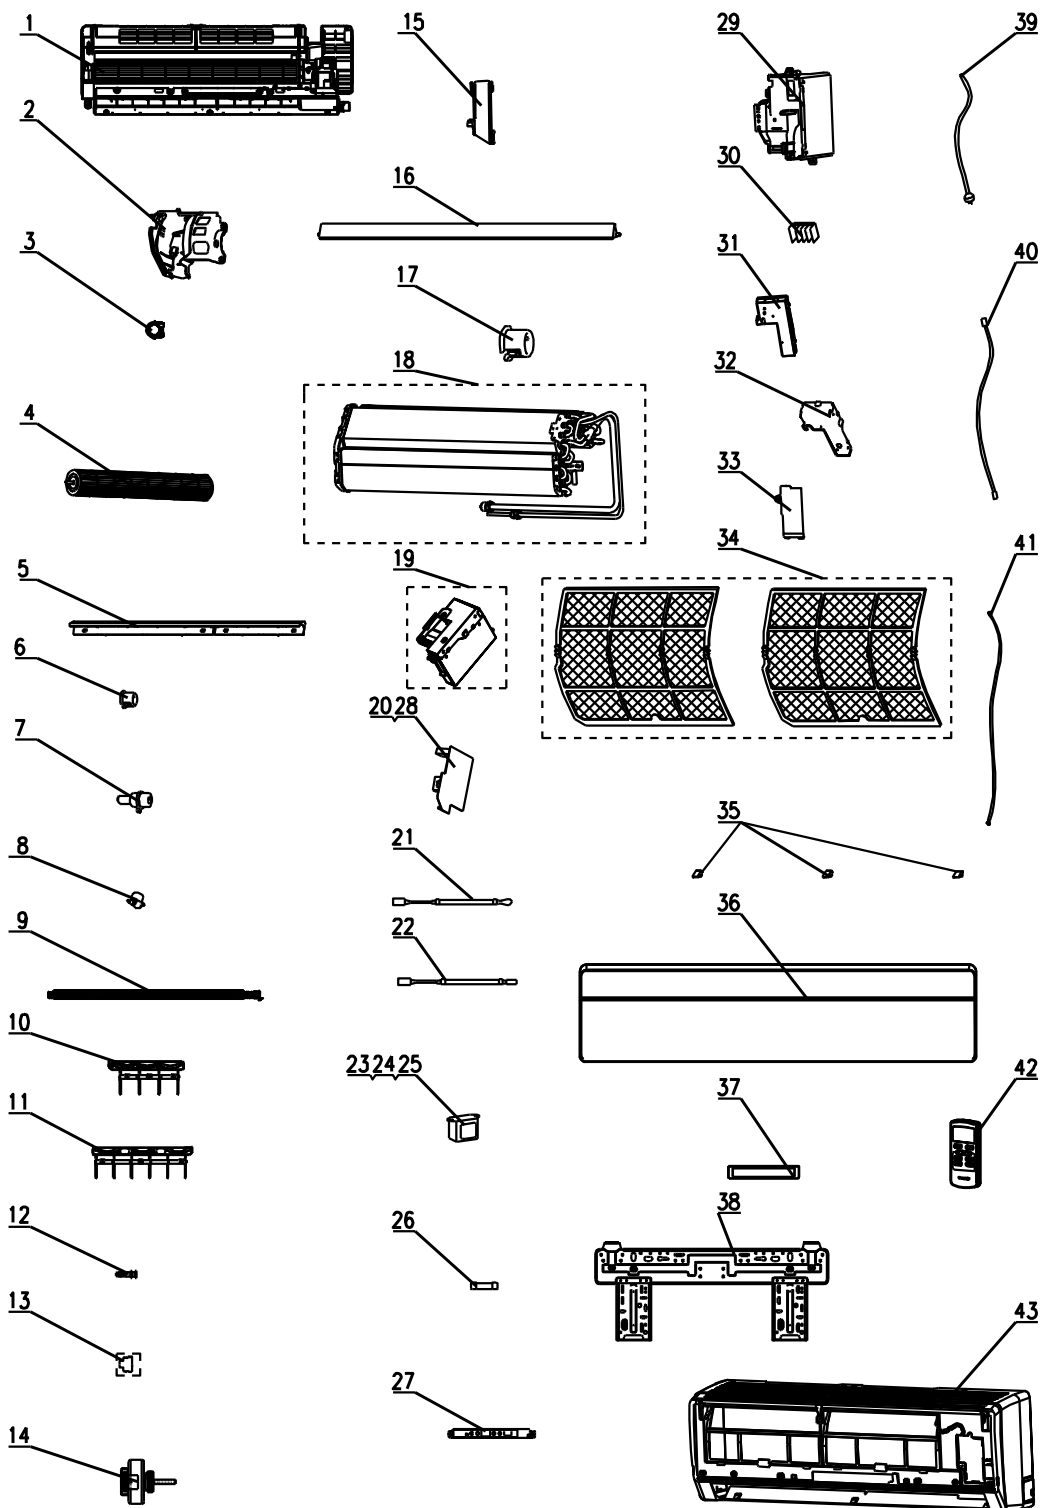


13.2 Spare part list of indoor Unit: HHF007

NO.	Part Code	Part Description	qty
1	2220213501	Rear Case assy	1
2	26112201	Motor Press Plate	1
3	26152022	Bearing cushion rubber base	1
4	10352034	Cross Flow Fan	1
5	26112202	Helicoid tongue	1
6	10542704	Axile Bush	1
7	10582070	Crank	1
8	1521210801	Motor MP24AA	1
9	0523001408	Drainage hose	1
10	10512113	Air Louver 1	1
11	10512114	Swing Louver	1
12	76712012	Water Tray Glue Plug	1
13	76512051	O-Gasket sub-assy of Bearing	1
14	15012115	Motor	1
15	26112199	Pipe Clamp	1
16	10512162	Guide Louver	1
17	10542008	Axile Bush (guide louver)	1
18	0100257702	Evaporator Assy	1
19	20302144	Electric Box Assy	1
20	30135353	Main Board	1
21	390000453	Ambient Temperature Sensor	1
22	390000591	Tube Sensor (20K black)	1
23	None	Relay	0
24	None	Relay	0
25	None	Relay	0
26	46010055	Fuse	1
27	30565156	Display Board	1
28	4202300115	Jumper	1
29	20112091	Electric Box	1
30	42010262	Terminal Board	1
31	20122114	Electric Box Cover	1
32	01592080	Shield box (electric box)	1
33	20122075	Electric Box Cover2	1
34	11122095	Filter Sub-Assy	2
35	24252016	Screw Cover	3
36	20012879	Front Panel Assy	1
37	None	Decorative Strip	0
38	01252231	Wall Mounting Frame	1
39	400220113	Power cord Sub-Assy	1
40	40020540	Connecting Cable	1
41	40020536	Connecting Cable	1
42	30510460	Remote Controller	1
43	2001239601	Front Case	1
	11012025	Air Cleaner	1
	111220071	Photocatalysis Filter	1

13.3 Spare part list of indoor Unit: HHF009

NO.	Part Code	Part Description	qty
1	2220213501	Rear Case assy	1
2	26112201	Motor Press Plate	1
3	26152022	Bearing cushion rubber base	1
4	10352034	Cross Flow Fan	1
5	26112202	Helicoid tongue	1
6	10542704	Axile Bush	1
7	10582070	Crank	1
8	1521210801	Motor MP24AA	1
9	0523001408	Drainage hose	1
10	10512113	Air Louver 1	1
11	10512114	Swing Louver	1
12	76712012	Water Tray Glue Plug	1
13	76512051	O-Gasket sub-assy of Bearing	1
14	15012115	Motor	1
15	26112199	Pipe Clamp	1
16	10512162	Guide Louver	1
17	10542008	Axile Bush (guide louver)	1
18	0100257702	Evaporator Assy	1
19	20202933	Electric Box Assy	1
20	30135353	Main Board	1
21	390000453	Ambient Temperature Sensor	1
22	390000591	Tube Sensor (20K black)	1
23	None	Relay	0
24	None	Relay	0
25	None	Relay	0
26	46010055	Fuse	1
27	30565156	Display Board	1
28	4202300114	Jumper	1
29	20112091	Electric Box	1
30	42010262	Terminal Board	1
31	20122114	Electric Box Cover	1
32	01592080	Shield box (electric box)	1
33	20122075	Electric Box Cover2	1
34	11122095	Filter Sub-Assy	2
35	24252016	Screw Cover	3
36	20012879	Front Panel Assy	1
37	None	Decorative Strip	0
38	01252231	Wall Mounting Frame	1
39	400220113	Power cord Sub-Assy	1
40	40020540	Connecting Cable	1
41	40020536	Connecting Cable	1
42	30510460	Remote Controller	1
43	2001239601	Front Case	1
	11012025	Air Cleaner	1
	111220071	Photocatalysis Filter	1


13.4 Exploded view of indoor unit: HHF012

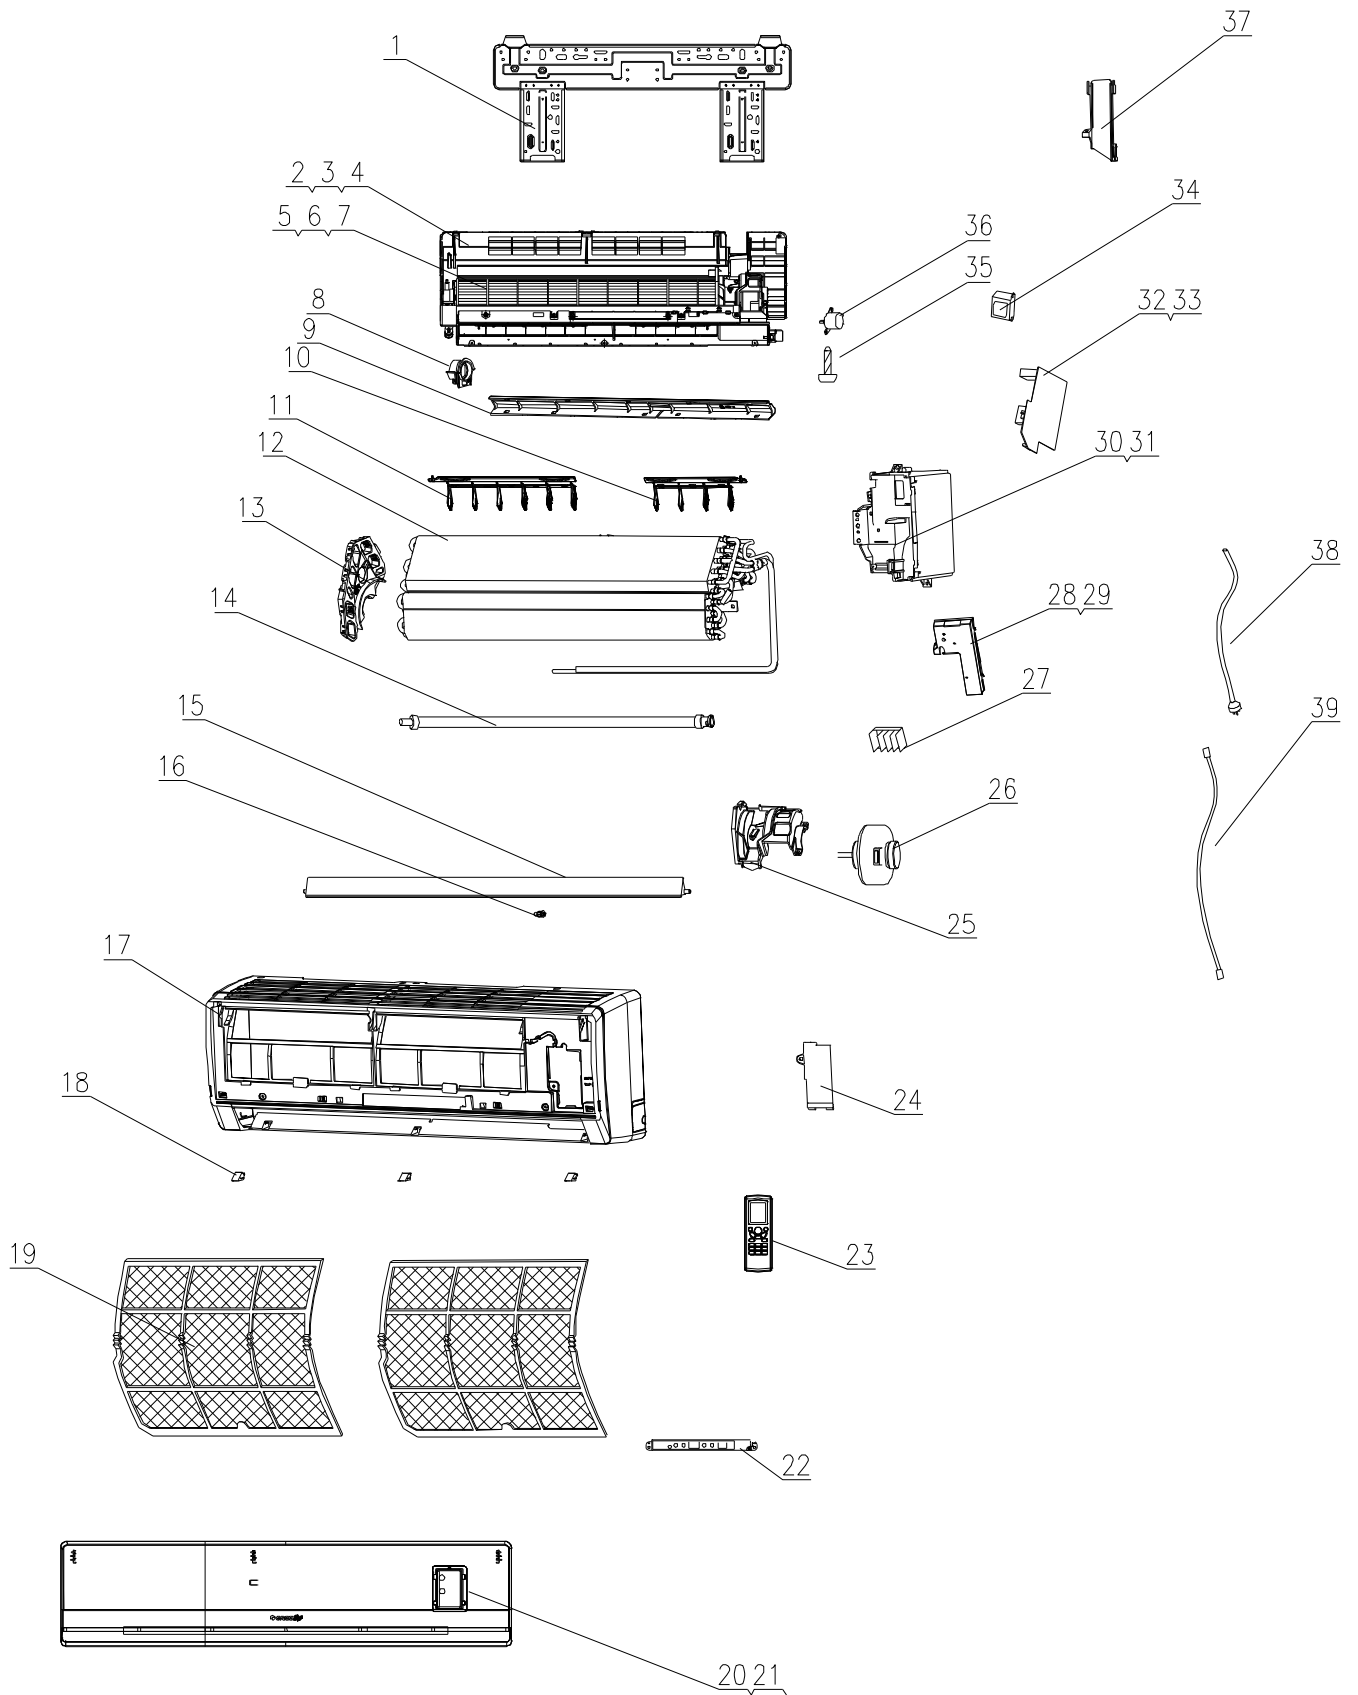

13.5 Spare part list of indoor Unit: HHF012

NO.	Part Code	Part Description	qty
1	01252015	Wall-Mounting Frame	1
2	2220210111	Rear Case assy	1
3	10542704	Axile Bush	1
4	10582070	Crank	1
5	10352043	Cross Flow Fan	1
6	76512051	O-Gasket sub-assy of Bearing	1
7	76512203	O-Gasket of Cross Fan Bearing	1
8	26152022	Ring of Bearing	1
9	26112162	Helicoid tongue	1
10	10512114	Swing Louver	1
11	10512113	Air Louver 1	1
12	0100255202	Evaporator Assy	1
13	24212090	Evaporator Support	1
14	0523001406	Drainage hose	1
15	10512111	Guide Louver1	1
16	10542036	Axile Bush	1
17	20012120	Front Case	1
18	24252016	Screw Cover	1
19	11122081	Filter Sub-Assy	2
20	20012880	Front Panel Assy	1
21	20192465	Decorative Strip	1
22	30565156	Display Board	1
23	30510460	Remote Controller	1
24	20122075	Electric Box Cover2	1
25	26112160	Motor Press Plate	1
26	15012115	Fan Motor	1
27	42010262	Terminal Board	1
28	22242135	Electric Box Cover1	1
29	0159207301	Shield cover of Electric Box sub-assy	1
30	20302676	Electric Box Assy	1
31	2011208201	Electric Box	1
32	30135283	Main Board	1
33	43110236	Transformer	1
34	4202300128	Jumping Connector	1
35	76712012	Water Tray Glue Plug	1
36	1521212901	Step Motor	1
37	26112164	Pipe Clamp	1
38	4002046413	Power Cord	1
39	40020536	Connecting Cable	0
	390000597	Temperature Sensor	1
	11012025	Air Cleaner Screen	1
	111220071	Photocatalysis Filter	1
	40020540	Connecting Cable	0
	390000453	Ambient Temperature Sensor	1


13.6 Exploded view of indoor unit: HHF018

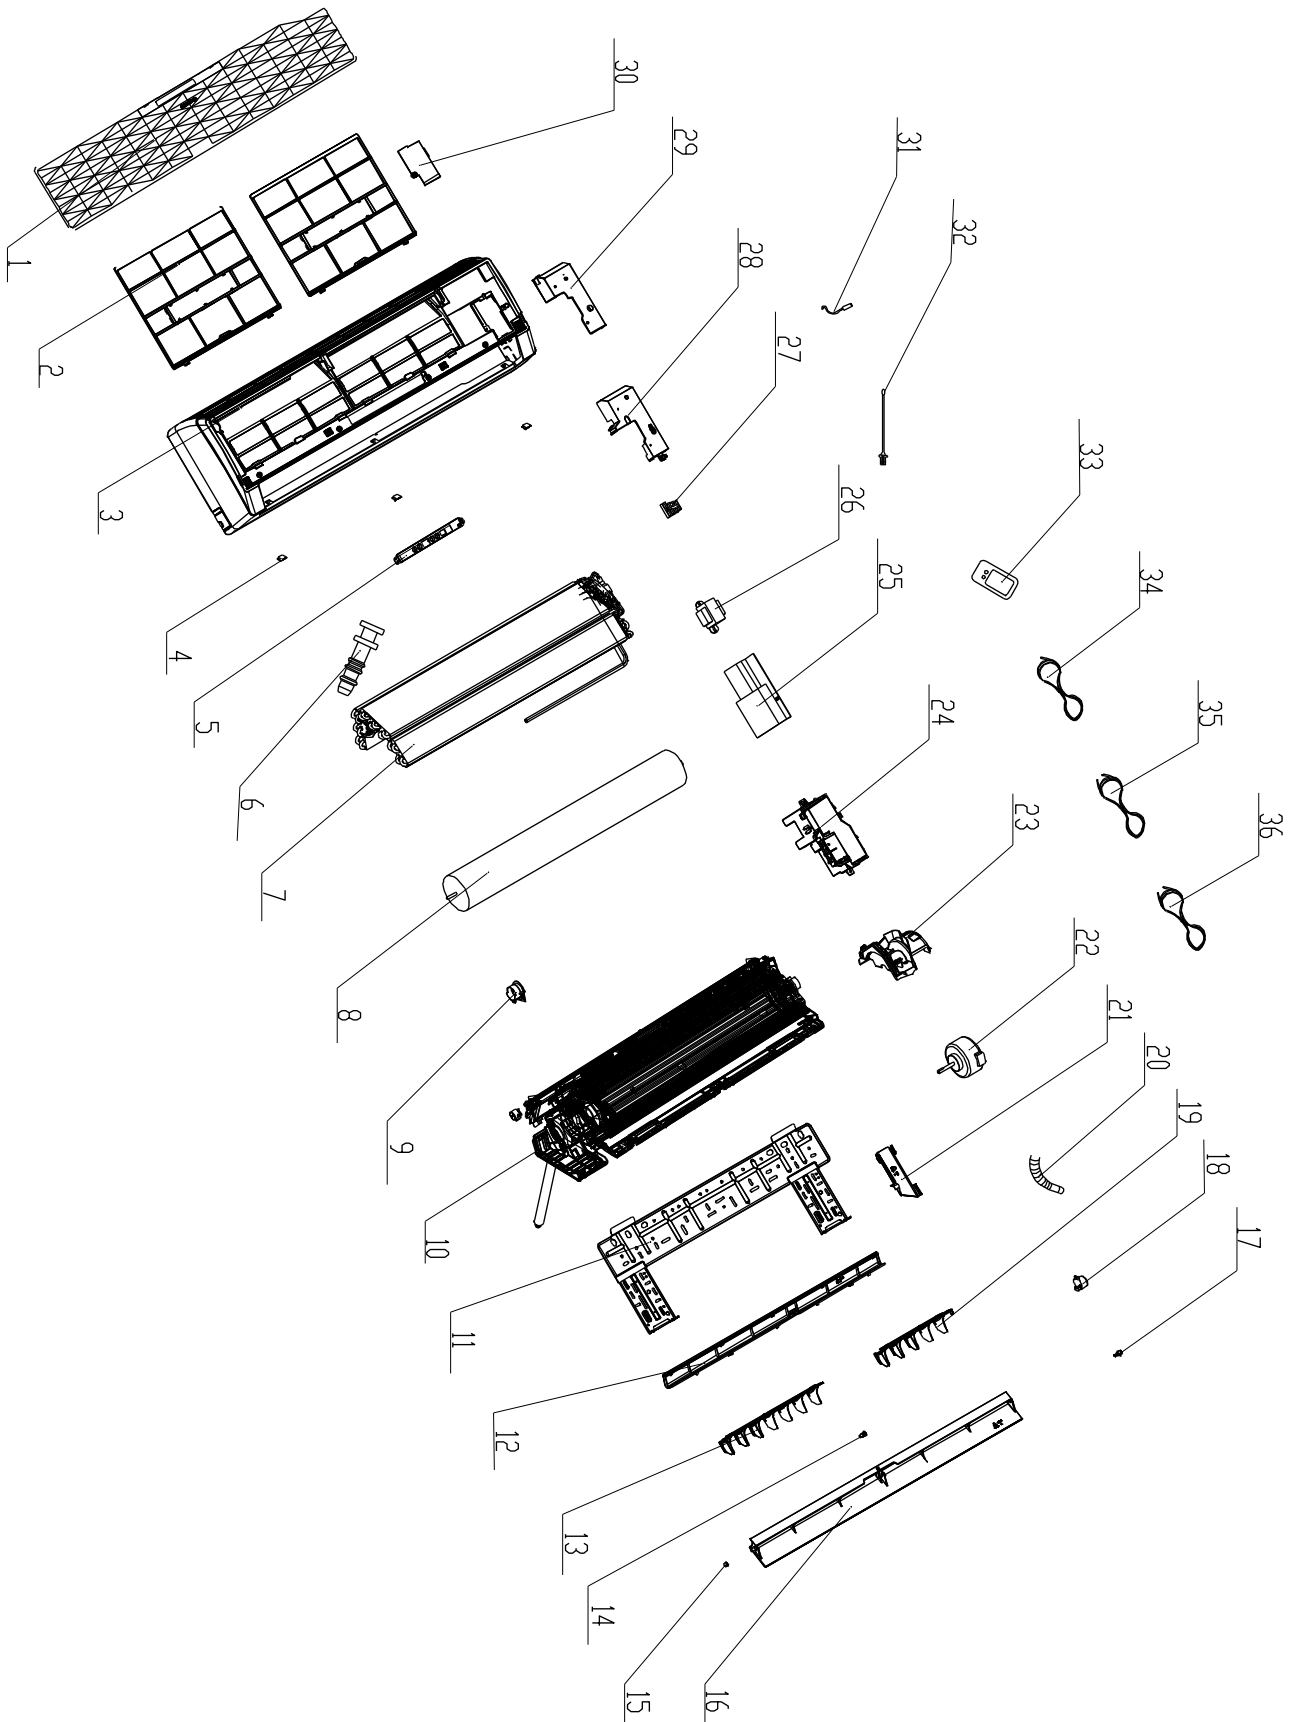

13.7 Spare part list of indoor Unit: HHF018

NO.	Part Code	Part Description	qty
1	20012924	Front Panel Assy	1
2	1112208901	Filter Sub-Assy	2
3	20022172	Front Case Sub-assy	1
4	24252016	Screw Cover	3
5	30565156	Display Board	1
6	76712012	Water Tray Glue Plug	1
7	01002575	Evaporator Assy	1
8	10352019	Cross Flow Fan	1
9	26152022	Ring of Bearing	1
10	22202227	Rear Case assy	1
11	01252218	Wall Mounting Frame	1
12	26112238	Helicoid Tongue	1
13	10512116	Air Louver 1	1
14	10542036	Axile Bush	1
15	10512037	Left Axile Bush	1
16	10512115	Guide Louver	1
17	10582070	Crank	1
18	15012086	Step Motor	1
19	10512117	Air Louver 2	1
20	05230014	Drain Pipe	1
21	26112164	Pipe Clamp	1
22	15012116	Fan Motor	1
23	26112494	Motor Press Plate	1
24	20302641	Electric Box Assy	1
25	30135454	Main Board	1
26	none	Transformer	0
27	42010268	Terminal board	1
28	20122154	Electric Box Cover1	1
29	01592092	Shield Cover of Electric Box	1
30	20112081	Electric Box Cover2	1
31	390000591	Temperature Sensor	1
32	390000453	Ambient Temperature Sensor	1
33	30510460	Remote Controller	1
34	400205401	Connecting Cable	0
35	4002053603	Connecting Cable	0
36	400203253	Power Cord	1
	4202300109	Jumper	1
	11012025	Air Cleaner Screen	1
	111220071	Photocatalysis Filter	1
	76512051	O-Gasket sub-assy of Bearing	1


13.8 Exploded view of indoor unit: HHF024

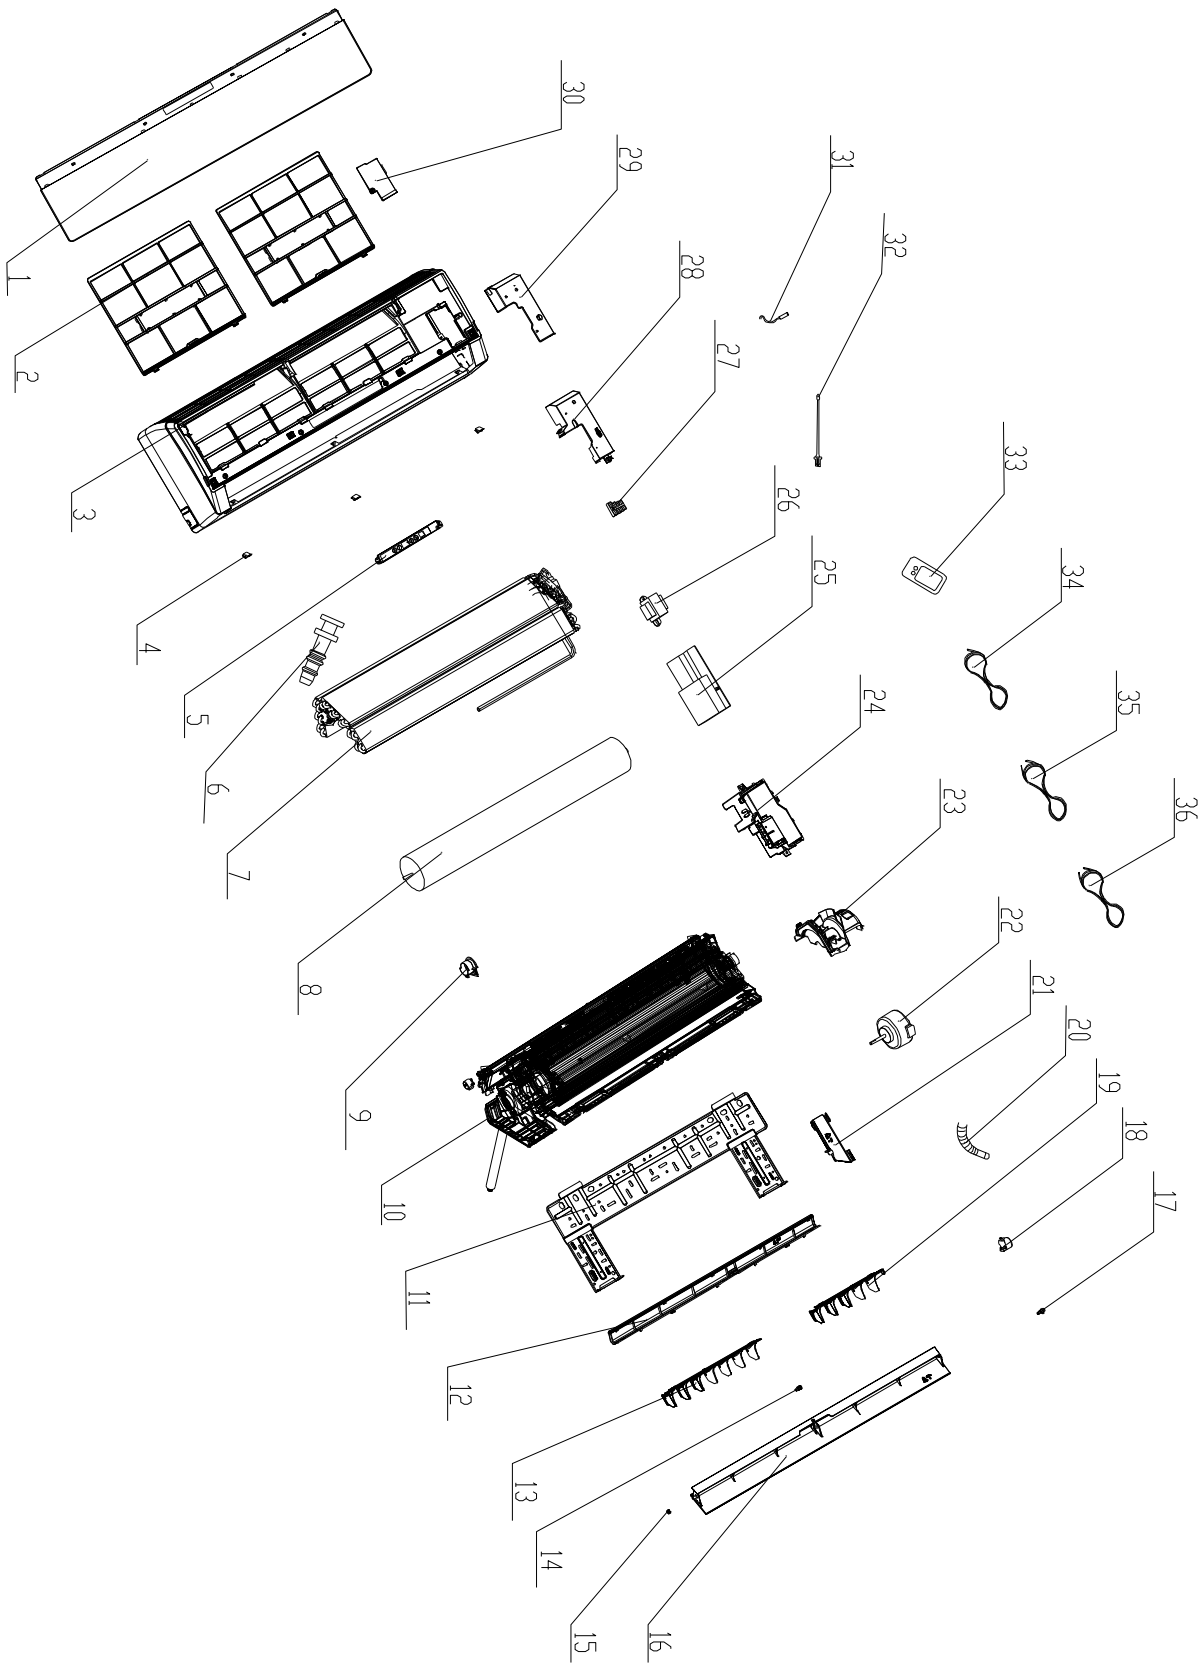

13.9 Spare part list of indoor Unit: HHF024

NO.	Part Code	Part Description	qty
1	2001228601	Front Panel Assy	1
2	1112208901	Filter Sub-assy	2
3	20012288	Front Case Sub-Assy	1
4	24252016	Screw Cover	3
5	30565156	Display Board	1
6	76712012	Water Tray Glue Plug	1
7	20112081	Electric Box cover 2	1
8	10352019	Cross Flow Fan	1
9	26152022	Bearing cushion rubber base	1
10	12312214	Rear Case assy	1
11	01252218	Wall Mounting Frame	1
12	26112238	Helicoid tongue	1
13	10512116	Air Louver 1	1
14	10542008	Axile Bush (guide louver)	1
15	10512037	Left Axile Bush	1
16	10512115	Guide Louver	1
17	10582070	Crank	1
18	15012086	Step Motor	1
19	10512117	Air Louver 2	1
20	05230014	Drain Pipe	1
21	26112164	Pipe Clamp	1
22	15012116	Motor	1
23	26112178	Motor Press Plate	1
24	20112108	Electric Box	1
25	30135295	Main Board	1
26	43110237	Transformer 57X25C	1
27	4201026201	Terminal Board	1
28	20202909	Electric Box Assy	1
29	01592092	Shield cover of Electric Box	1
30	20122128	Electric Box Cover1	1
31	390000591	Tube Sensor (20K black)	1
32	390000451	Ambient Temperature Sensor	1
33	30510460	Remote Controller	1
34	400205382	Connecting Cable	0
35	4002053603	Connecting Cable	1
36	400203253	Power Wire	1
	4202300109	Jumper	1
	76512203	O-Gasket of Cross Fan Bearing	1
	42020063	Sensor Insert	1
	76512051	O-Gasket sub-assy of Bearing	1
	49010104	Magnetic Ring	1
	11012025	Air Cleaner	1
	01002590	Evaporator Assy	1
	24212100	Evaporator Support	1
	26112228	Baffle Plate	1


13.10 Exploded view of outdoor unit: YGF007

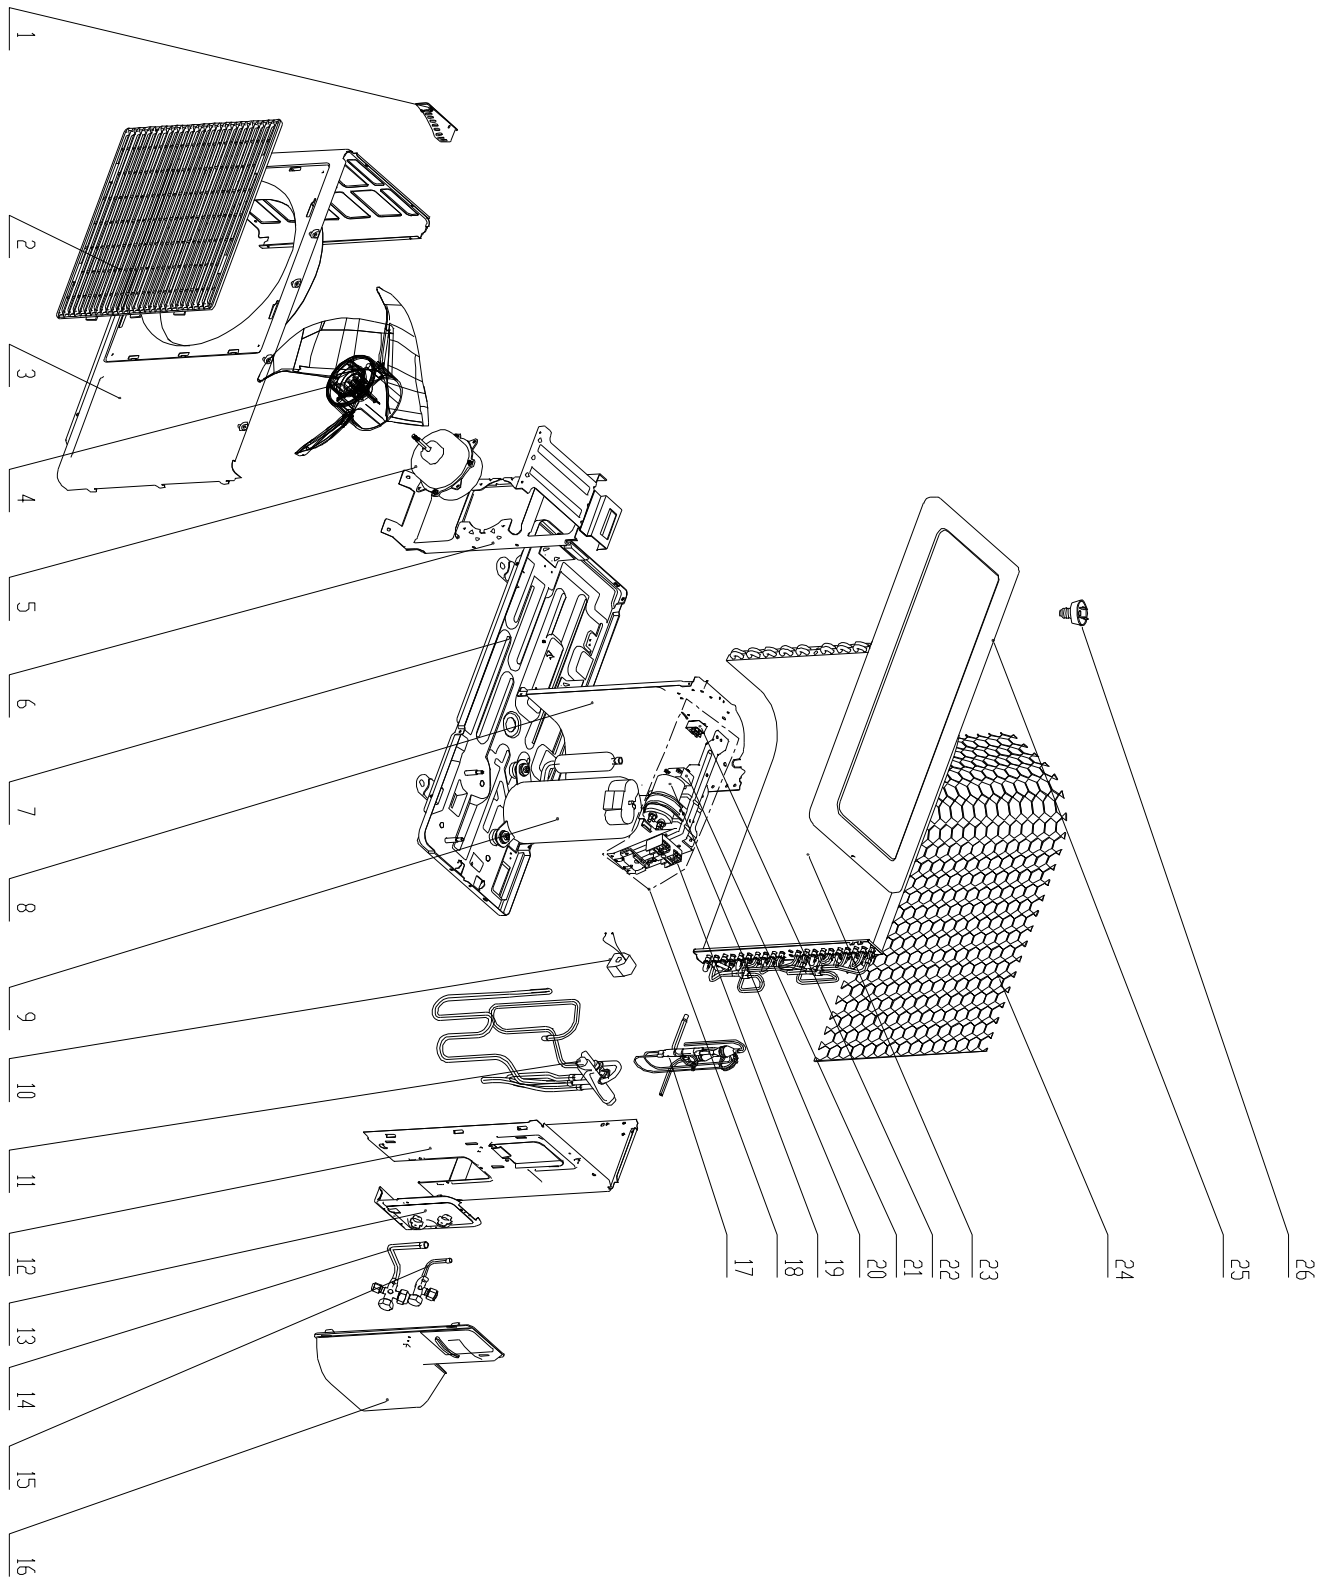

13.11 Spare part list of outdoor Unit: YGF007

NO.	Part Code	Part Description	qty
1	26233100	Small Handle	1
2	22263002	Front Grill	1
3	01533255P	Front Panel	1
4	10333002	Axial Flow Fan	1
5	1501315604	Fan Motor	1
6	01703022	Motor Support Sub-Assy	1
7	01203783P	Chassis Sub-assy	1
8	01233107	Clapboard Sub-Assy	1
9	00101076	Compressor and fittings	1
10	43000400	Magnet Coil	1
11	03123281	4-way Valve Assy	1
12	01303243	Right Side Plate Sub-Assy	1
13	01713041	Valve Support	1
14	07100005	Valve	1
15	07100003	Valve	1
16	26233042	Big Handle	1
17	03063015	Capillary Sub-Assy	1
18	02603239	Electric Box Assy	1
19	42010265	Terminal Board	1
20	33000017	Capacitor CBB65	1
21	33010020	Capacitor CBB61	1
22	42010265	Terminal Board	1
23	01113467	Condenser Assy	1
24	11123204	Rear Grill	1
25	01253045P	Top Cover Plate	1
26	06123401	Drainage Connector	1


13.12 Exploded view of outdoor unit: YGF009

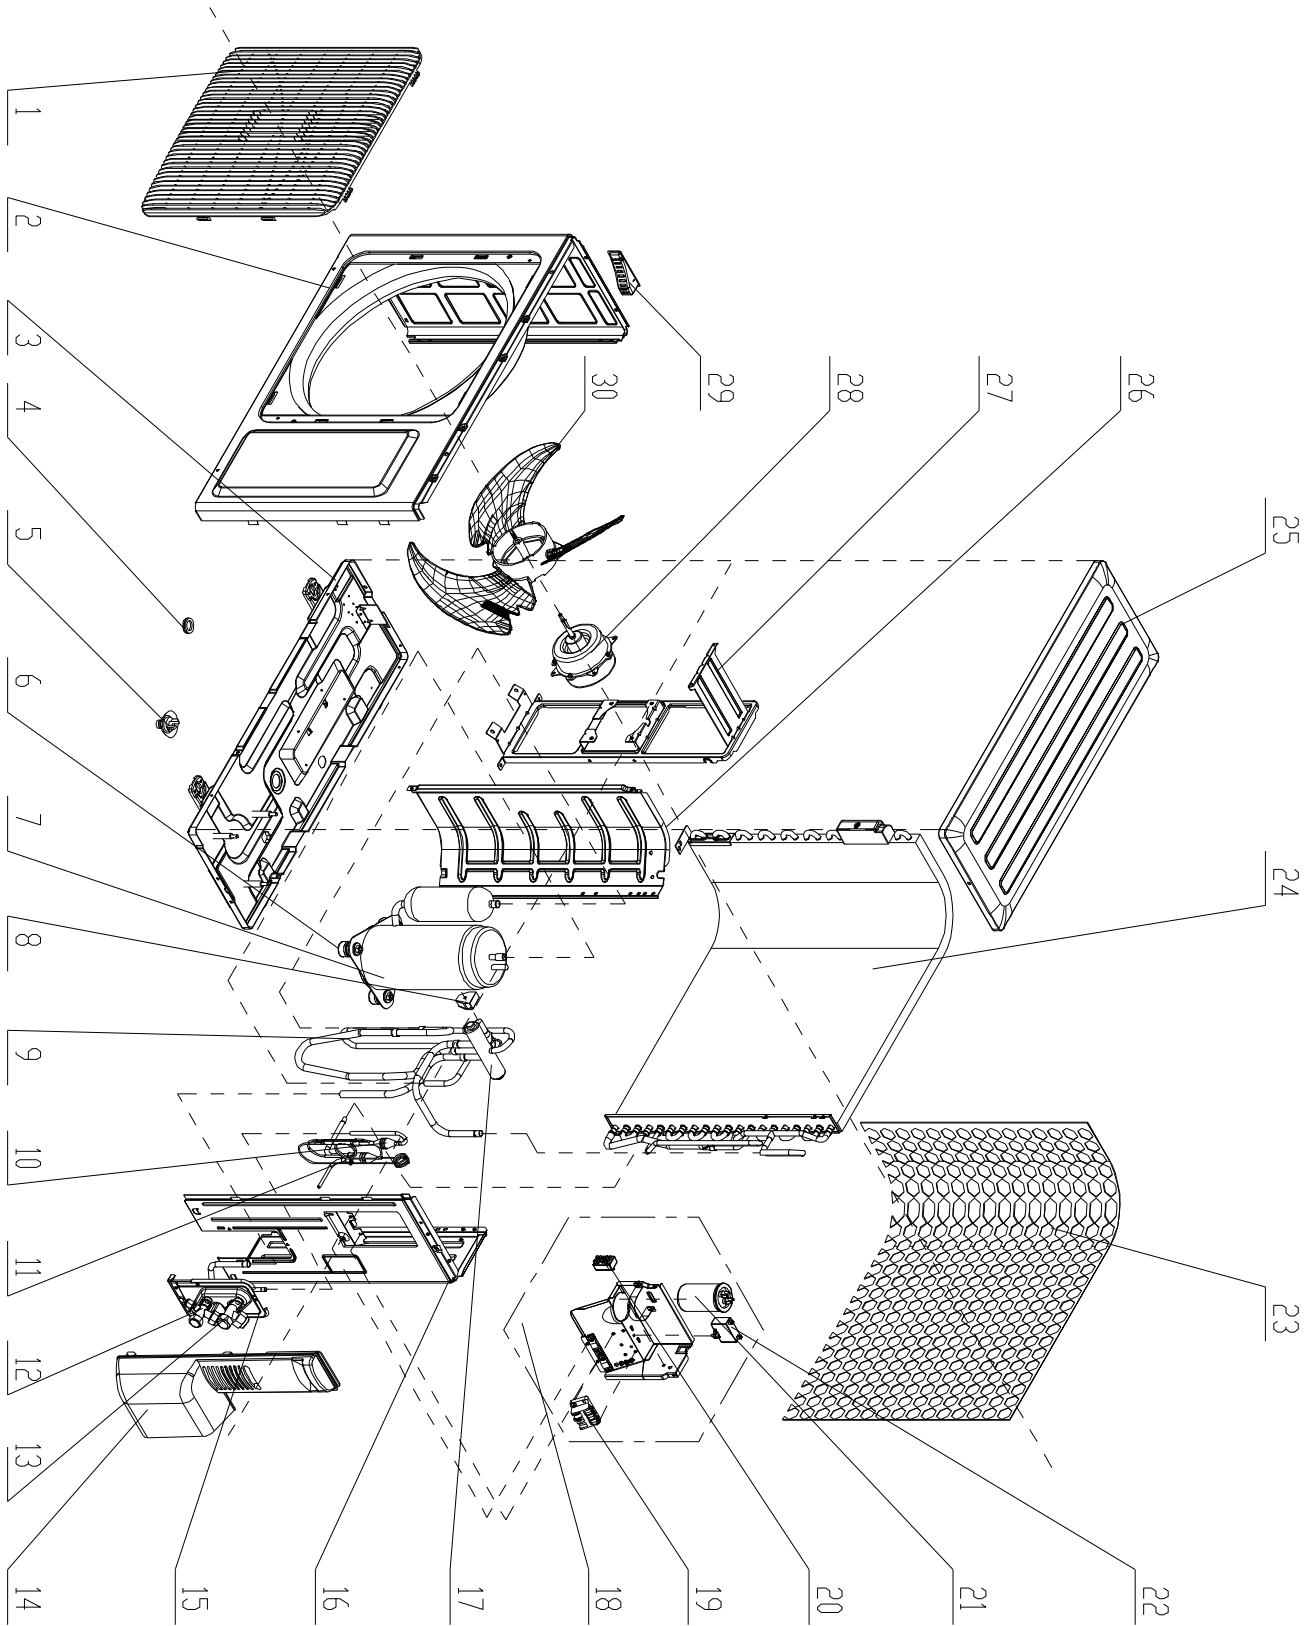


13.13 Spare part list of outdoor Unit: YGF009

NO.	Part Code	Part Description	qty
1	22413007	Front Grill	1
2	01533034P	Front Panel	1
3	01203748P	Chassis Sub-assy	1
4	none	Drainage Plug	0
5	06123401	Drainage Connector	1
6	76710247	Compressor Gasket	3
7	00103804	Compressor and Fittings	1
8	430004002	Magnet Coil	1
9	03123646	4-Way Valve Assy	1
10	07210022	StrainerA	1
11	03063533	Capillary Sub-assy	1
12	07100003	Valve	1
13	07100005	Valve	1
14	26233433	Big Handle	1
15	0170308901P	Valve Support	1
16	01303183	Right Side Plate Sub-Assy	1
17	430004022	4-Way Valve	1
18	02603599	Electric Box Assy	1
19	42010265	Terminal Board	1
20	40040007_GY1	Signal Wire	1
21	33000017	Capacitor CBB65	1
22	33010026	Capacitor CBB61	1
23	1112320501	Grill	1
24	01163041	Condenser Assy	1
25	01253031	Top Cover Sub-Assy	1
26	01233066	Isolation Sheet	1
27	01703104	Motor Support	1
28	150130671	Fan Motor	1
29	26233100	Small Handle	1
30	10333427	Axial Flow Fan	1

13.14 Exploded view of outdoor unit: YGF012

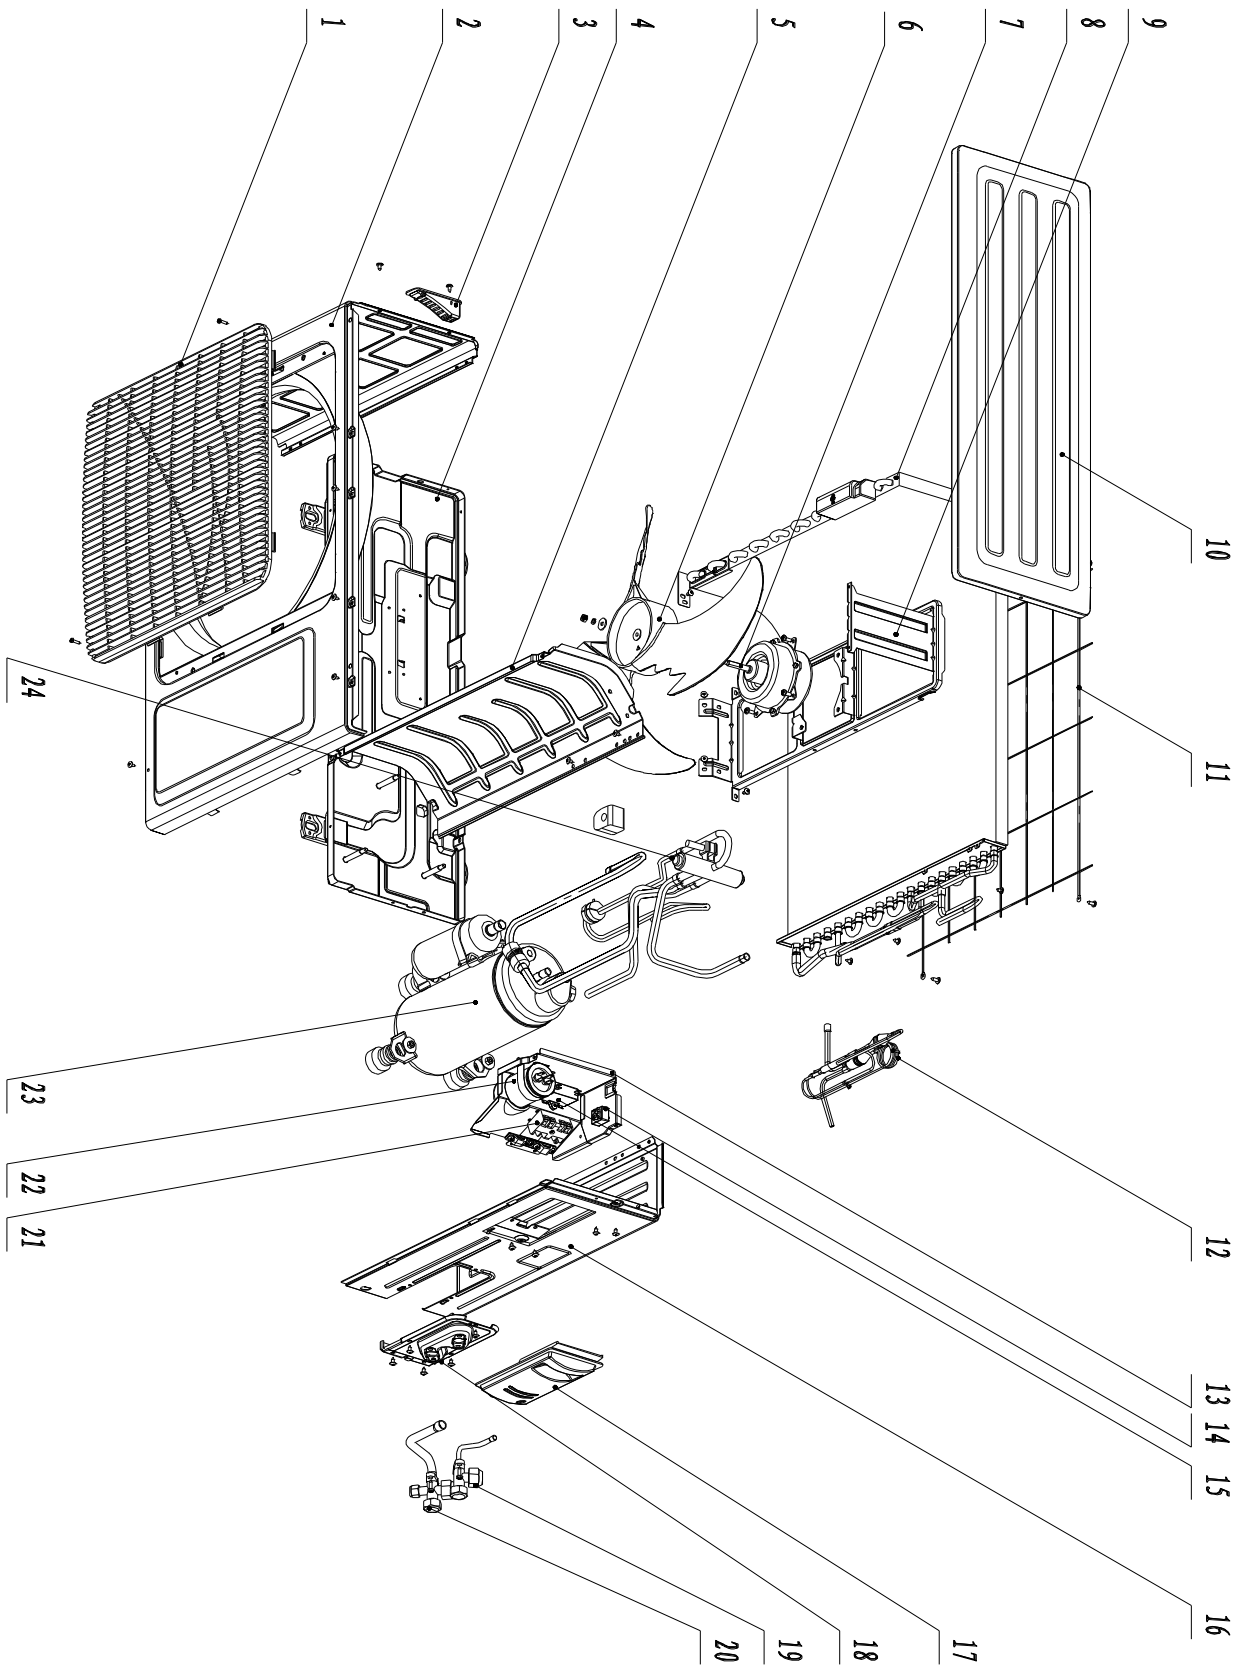


13.16 Exploded view of outdoor unit: YGF018

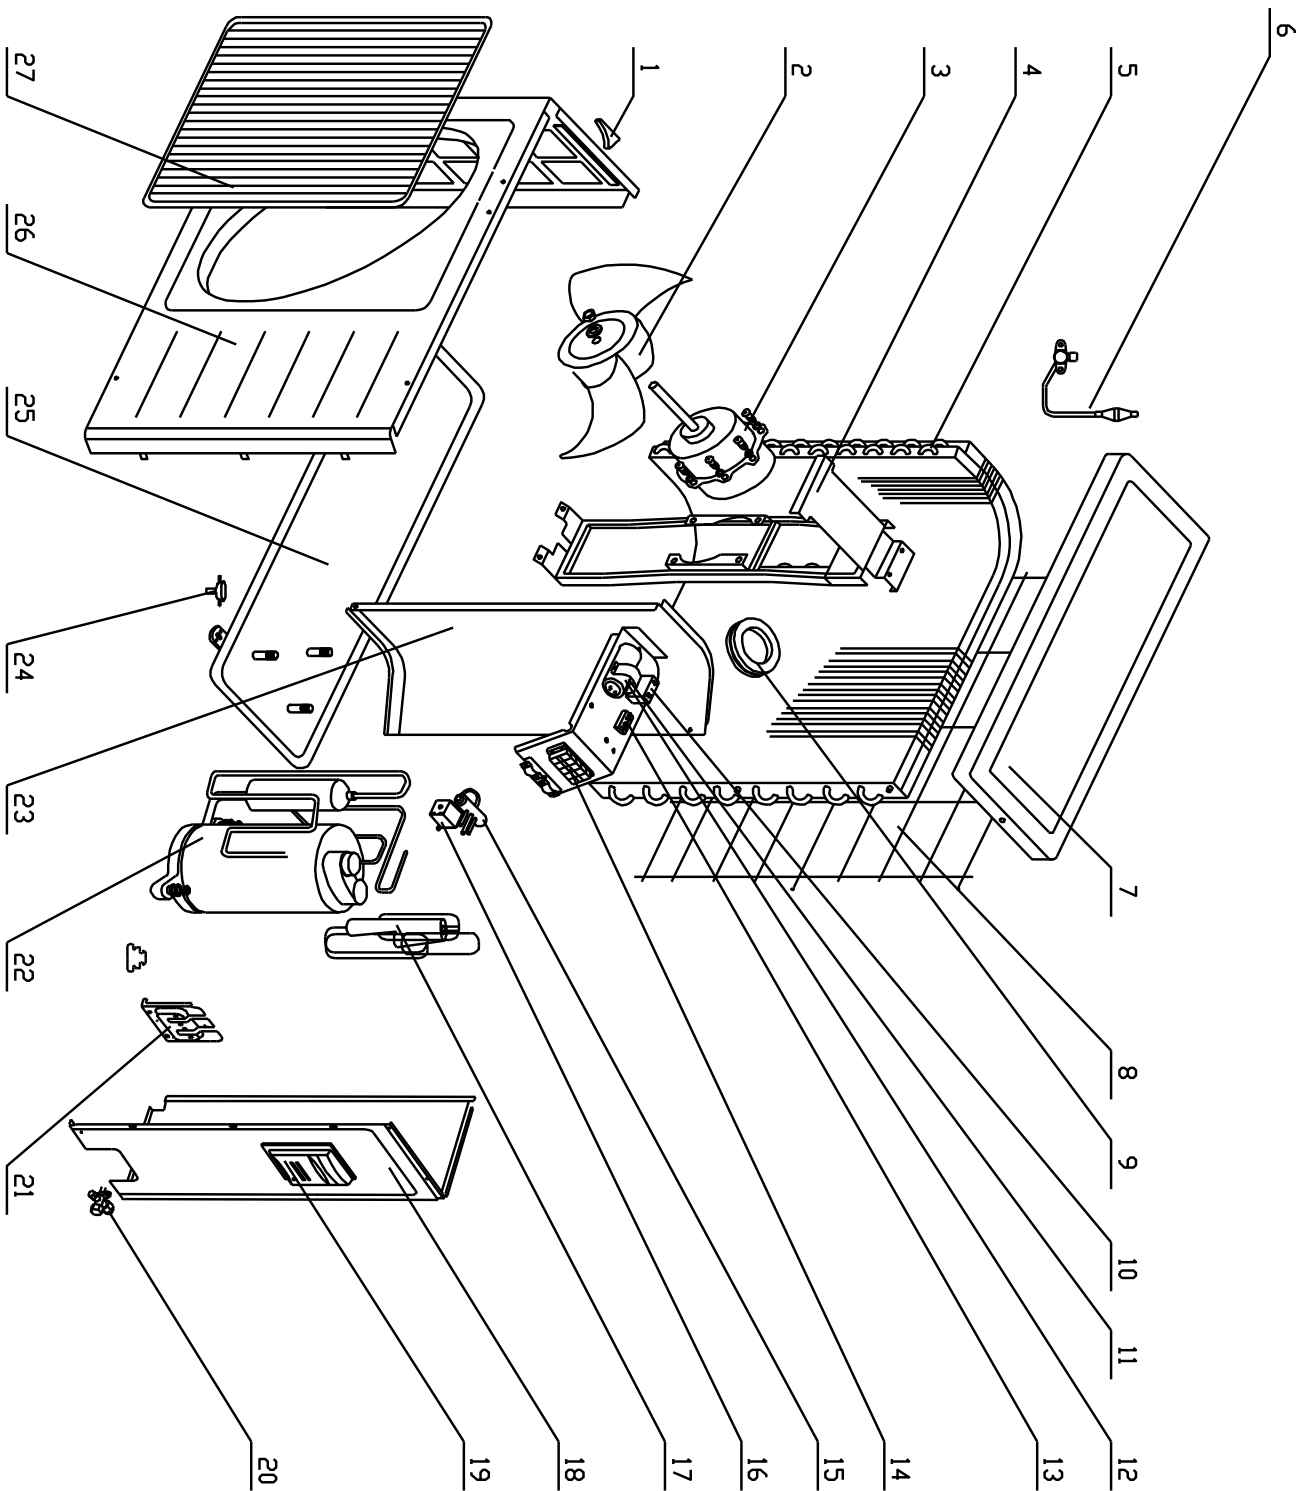

13.17 Spare part list of outdoor Unit: YGF018

NO.	Part Code	Part Description	qty
1	26235401	Left Handle	1
2	10335257	Axial Flow Fan	1
3	15015057	Fan Motor	1
4	0170305901	Motor Support Sub-Assy	1
5	01113642	Condenser Assy	1
6	07130213	Gas Valve Assy	1
7	01255001	Top Cover	1
8	0147500401	Rear Grill	1
9	06813401	Drainage Hole Cap	3
10	33000012	Capacitor CBB65	1
11	02603341	Electric Box Assy	1
12	33010027	Capacitor CBB61	1
13	42011147	Terminal Board	1
14	42010265	Terminal Board	1
15	03123375	4-way Valve Assy	1
16	430004002	Magnet Coil	1
17	03063173	Capillary Sub-Assy	1
18	01305095P	Right Side Plate	1
19	26235254	Handle	1
20	07100003	Valve	1
21	01713075	Valve Support Sub-Assy	1
22	00101079	Compressor and fittings	1
23	01233035	Clapboard Sub-Assy	1
24	06123401	Drainage Connector	1
25	01203932P	Chassis Sub-assy	1
26	01305015	Front Side Plate	1
27	22415001	Front Grill	1
	07245007	Silencer Mounting	1
	430004032	4-Way Valve	1
	01705003	Motor Support	1
	76812805	Compressor Gasket	3
	07210022	StrainerA	1

13.18 Exploded view of outdoor unit: YGF024

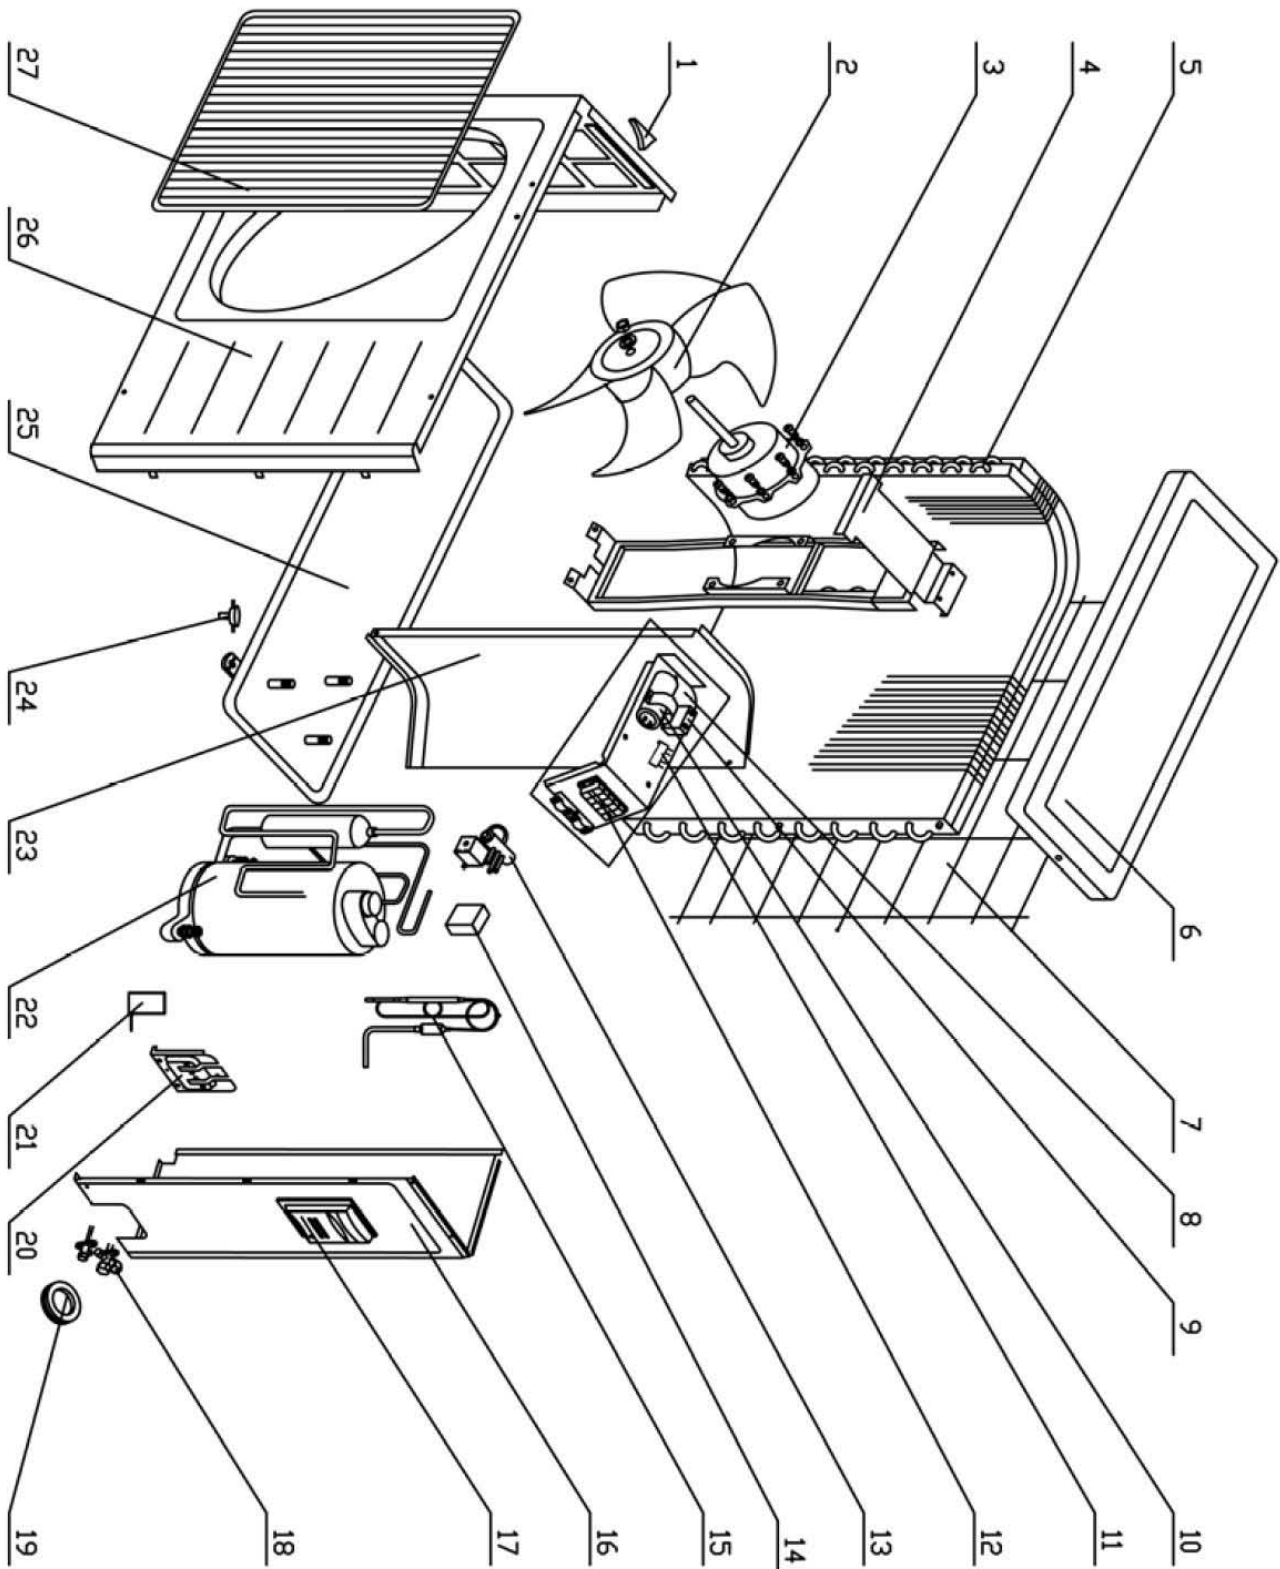

13.19 Spare part list of outdoor Unit: YGF024

NO.	Part Code	Part Description	qty
1	26235401	Small Handle	1
2	10335257	Axial-flow Fan	1
3	15015057	Fan Motor	1
4	0170305901	Motor Support Sub-Assy	1
5	01113396	Condenser Assy	1
6	01255001	Top Cover	1
7	0147500401	Rear Grill	1
8	02603219	Electric Box Assy	1
9	33000039	Capacitor	1
10	33010027	Capacitor CBB611A(3uF/450V)	1
11	42011147	Terminal Board	1
12	420101941	Terminal Board	1
13	03123248	4-way Valve Assy	1
14	00180157	Overload Protector	1
15	03103946	Capillary Sub-Assy	1
16	01305013	Right Side Plate	1
17	26235254	Handle	1
18	07130213	Gas Valve Assy	1
19	06813401	Choke Plug	3
20	01713075	Valve Support Sub-Assy	1
21	430004002	4-way Valve Accessary	1
22	00103702	Compressor and Fittings	1
23	01233035	Clapboard Sub-Assy	1
24	06123401	Drainage Connector	1
25	0120362602P	Chassis	1
26	01305015	Front Side Plate	1
27	22415001	Front Grill	1
	02141375	Capacitor Clamp	1
	07245007	Silencer Mounting	1
	44010245	AC Contactor CJX9B-25S/D	1
	430004032	4-way Valve	1
	76710202	Compressor Gasket 4CYC00008	3
	07100003	Cut-off Valve (1/4)	1

APPENDIX